


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	01/01/2025	Ripple PV System cut-off:	
Start of Curtailment	8:15	Start of cut-off:	9:30
End of Curtailment	15:30	End of cut-off:	15:15
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1223.1 MWh	Ripple cut-off Total Estimated energy	315.5 MWh
Total Estimated Curtailed Energy:	966.3 MWh		
Percentage of Curtailed Energy	79.0%		

Scada PVs Generation on 01/01/2025 (curtailment time: 08:15 - 15:30)

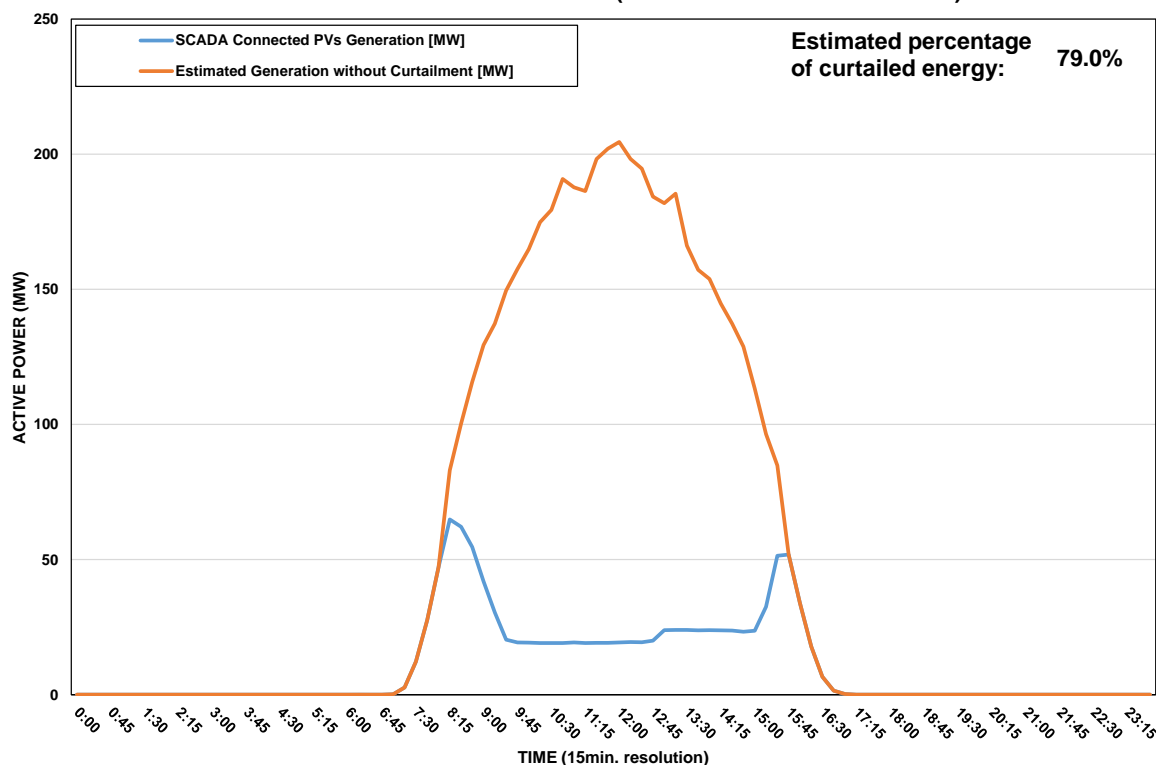


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/01/2025
Start of Curtailment	8:45
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1258.1 MWh
Total Estimated Curtailed Energy:	780.3 MWh
Percentage of Curtailed Energy	62.0%

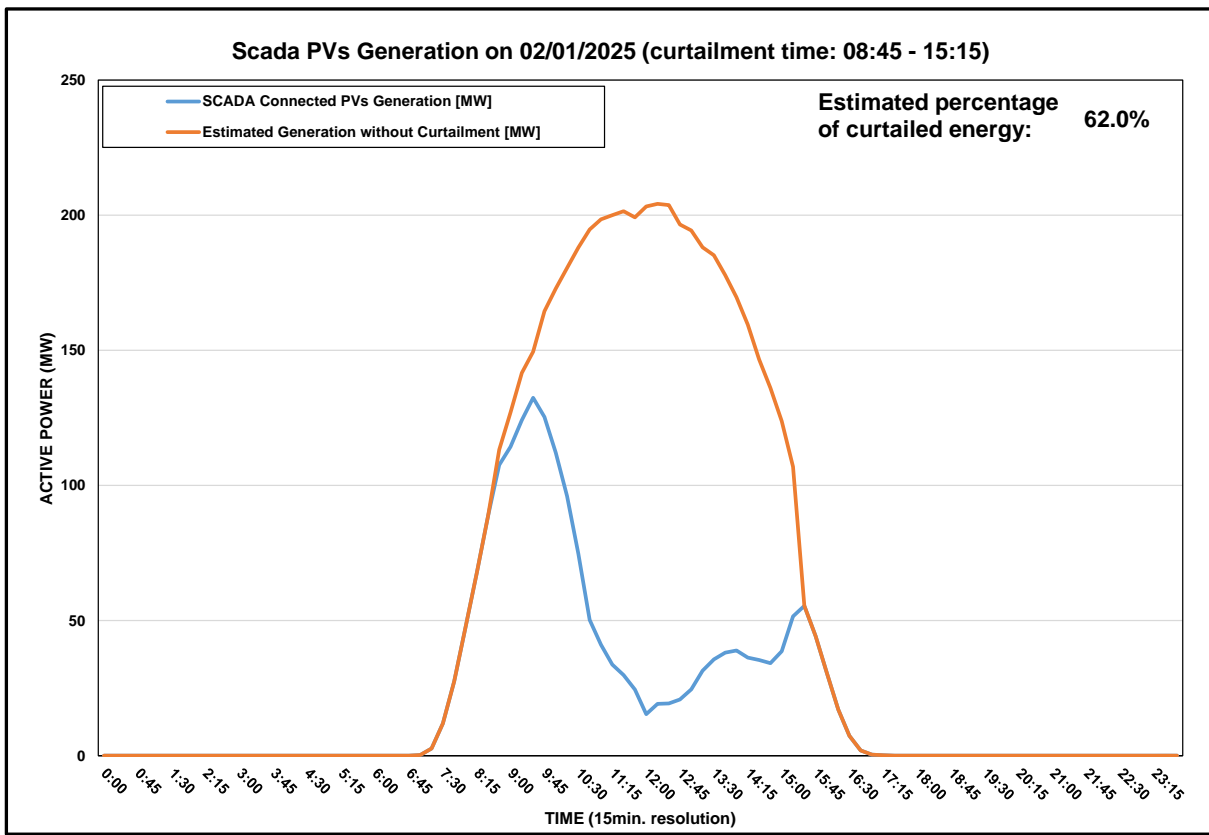


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/01/2025
Start of Curtailment	9:15
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1240.6 MWh
Total Estimated Curtailed Energy:	511.8 MWh
Percentage of Curtailed Energy	41.3%

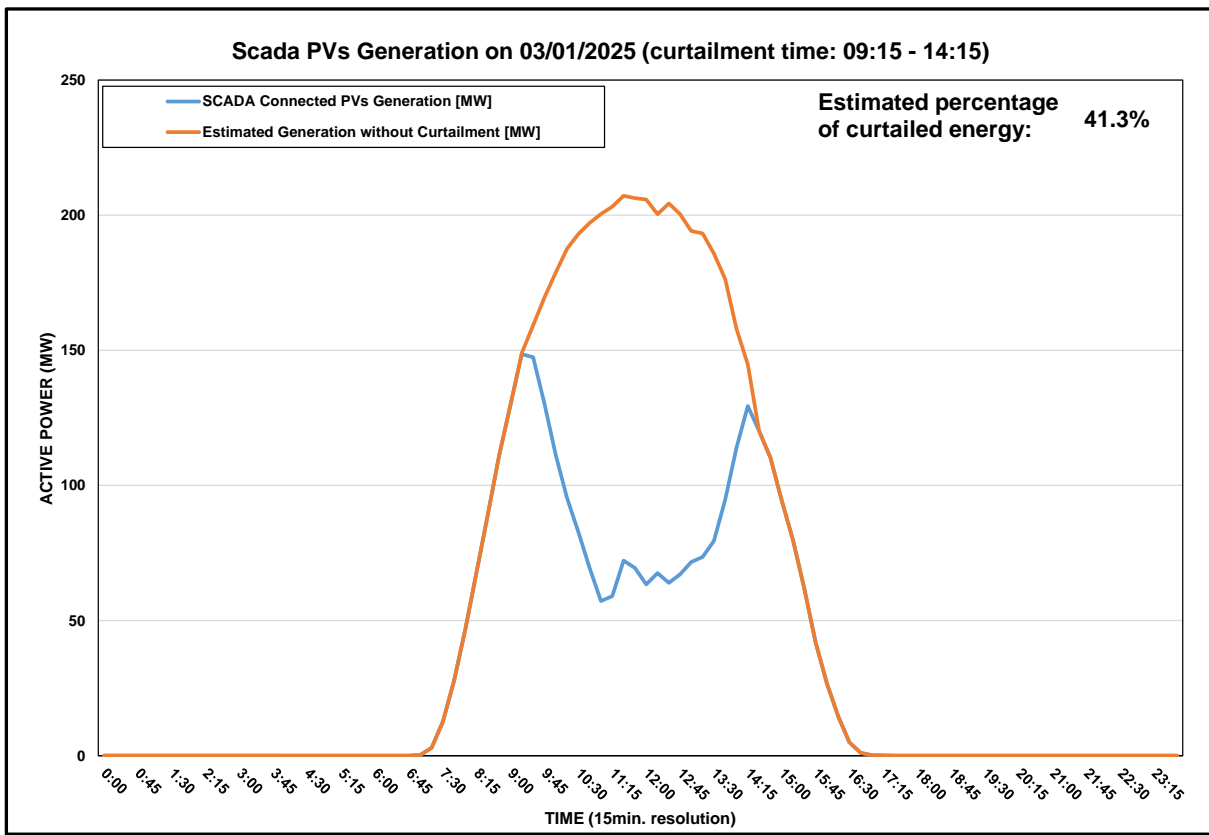


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	04/01/2025
Start of Curtailment	11:30
End of Curtailment	12:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	605.7 MWh
Total Estimated Curtailed Energy:	21 MWh
Percentage of Curtailed Energy	3.5%

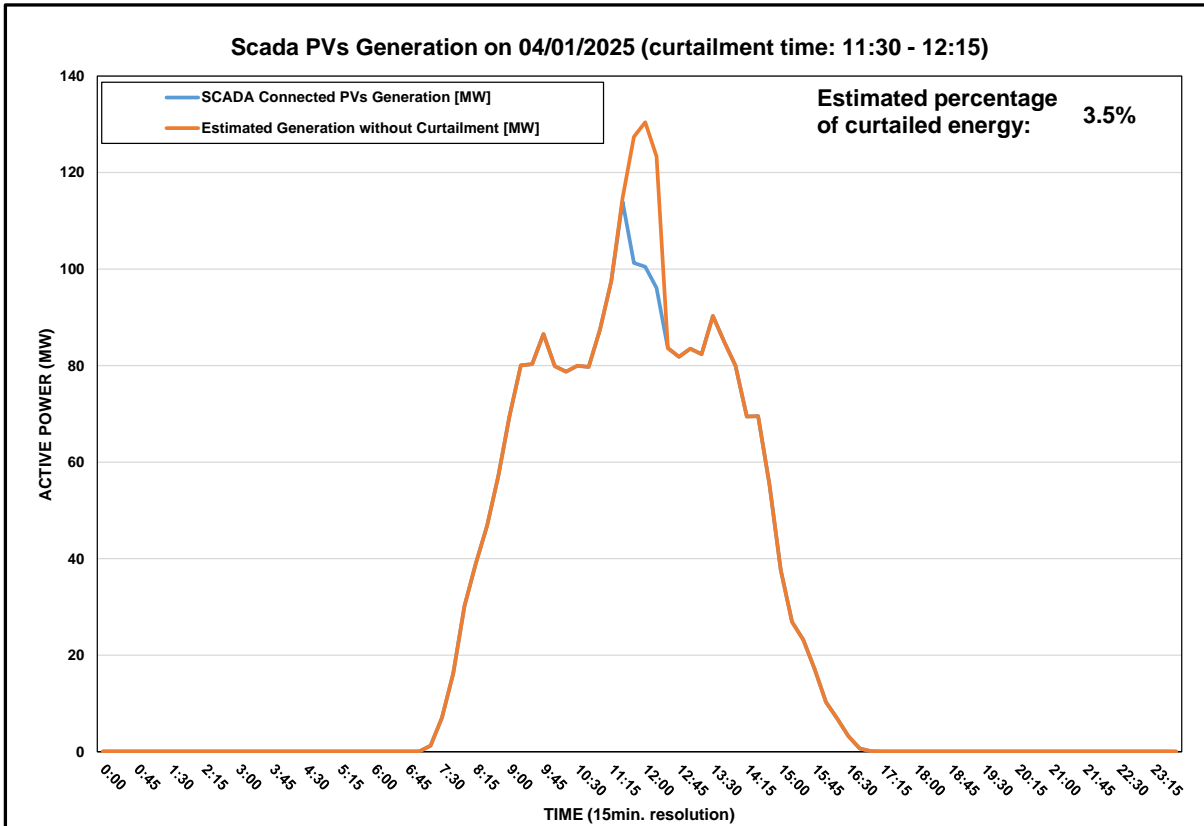


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/01/2025
Start of Curtailment	9:30
End of Curtailment	11:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	419.8 MWh
Total Estimated Curtailed Energy:	15.8 MWh
Percentage of Curtailed Energy	3.8%

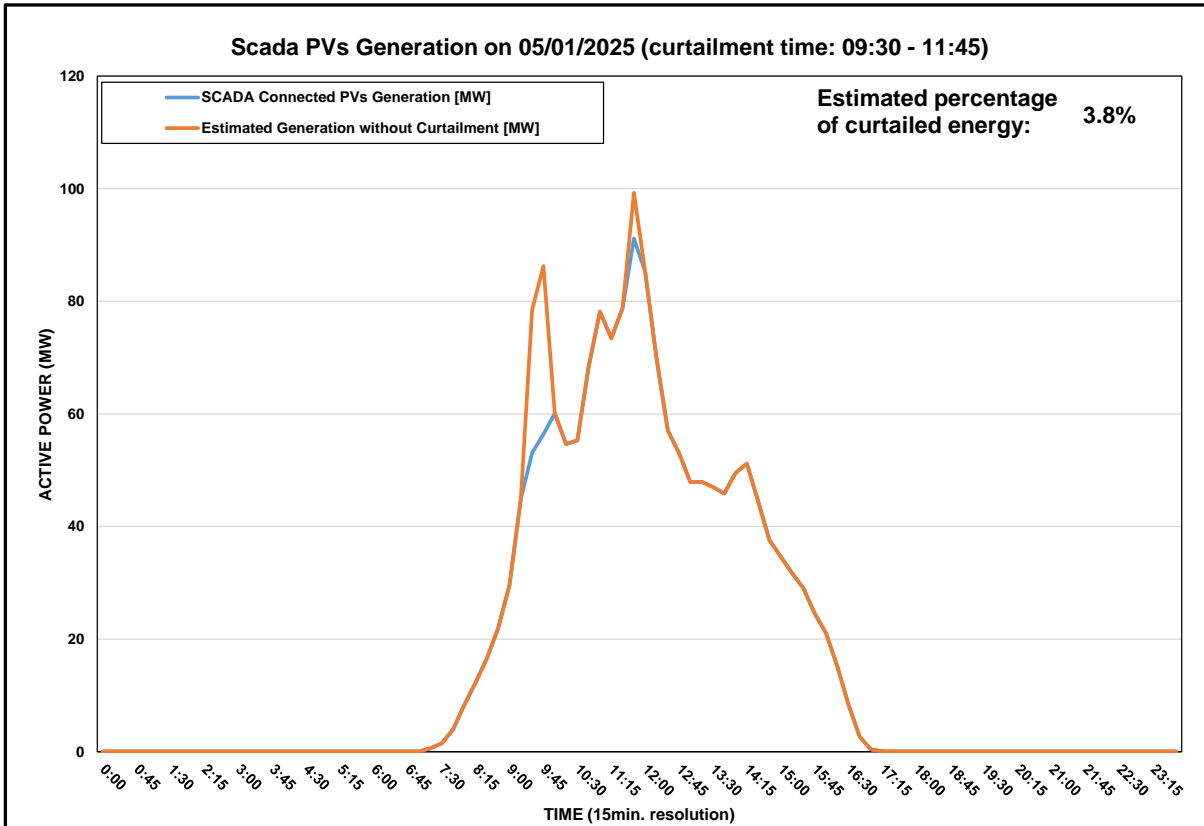


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	06/01/2025
Start of Curtailment	8:45
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1160.1 MWh
Total Estimated Curtailed Energy:	805.4 MWh
Percentage of Curtailed Energy	69.4%

Scada PVs Generation on 06/01/2025 (curtailment time: 08:45 - 15:15)

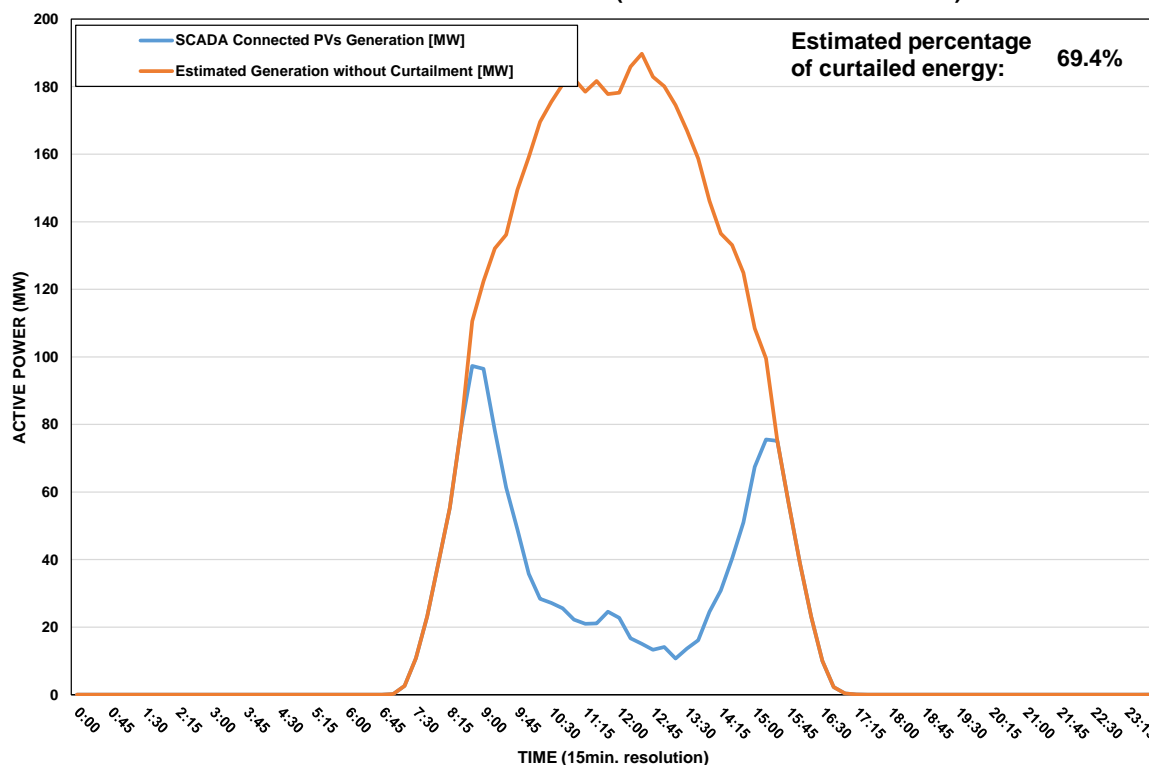


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	07/01/2025
Start of Curtailment	9:45
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1237 MWh
Total Estimated Curtailed Energy:	474.8 MWh
Percentage of Curtailed Energy	38.4%

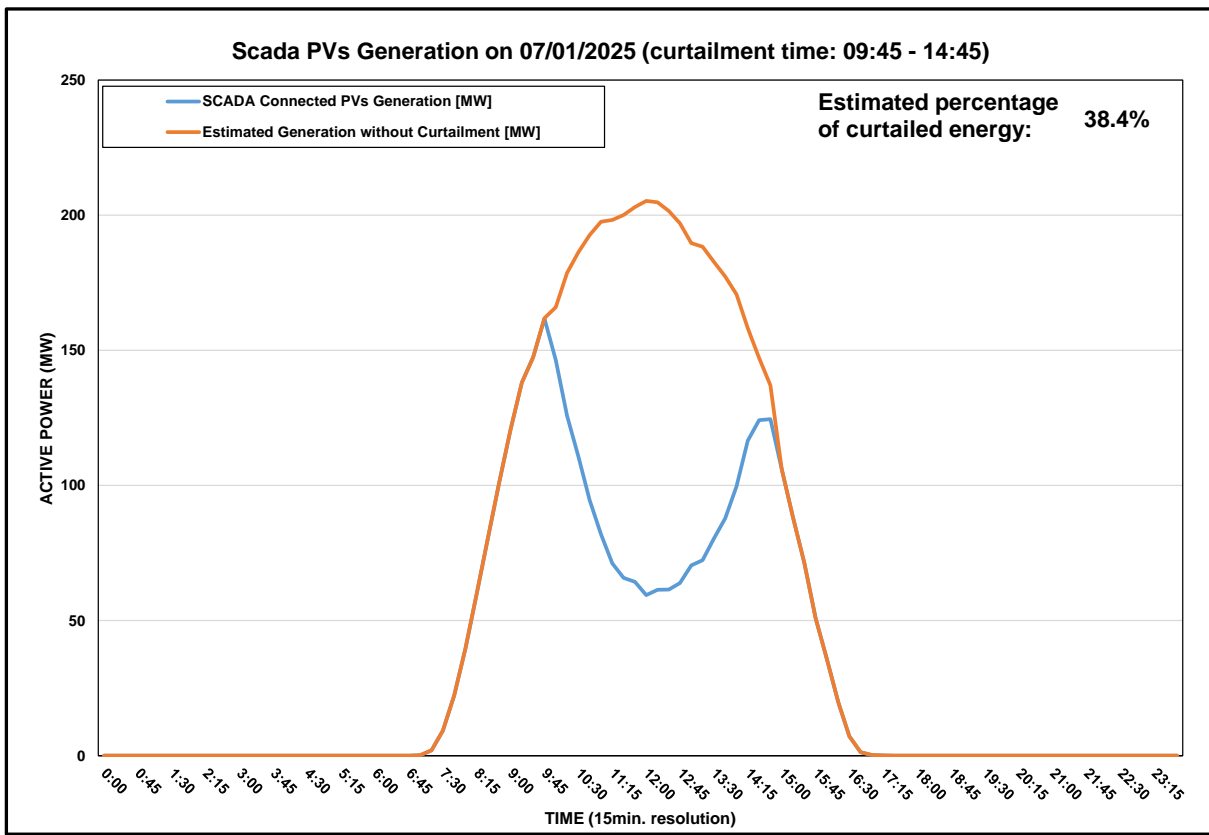


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/01/2025
Start of Curtailment	10:15
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	946.1 MWh
Total Estimated Curtailed Energy:	147.8 MWh
Percentage of Curtailed Energy	15.6%

Scada PVs Generation on 08/01/2025 (curtailment time: 10:15 - 13:15)

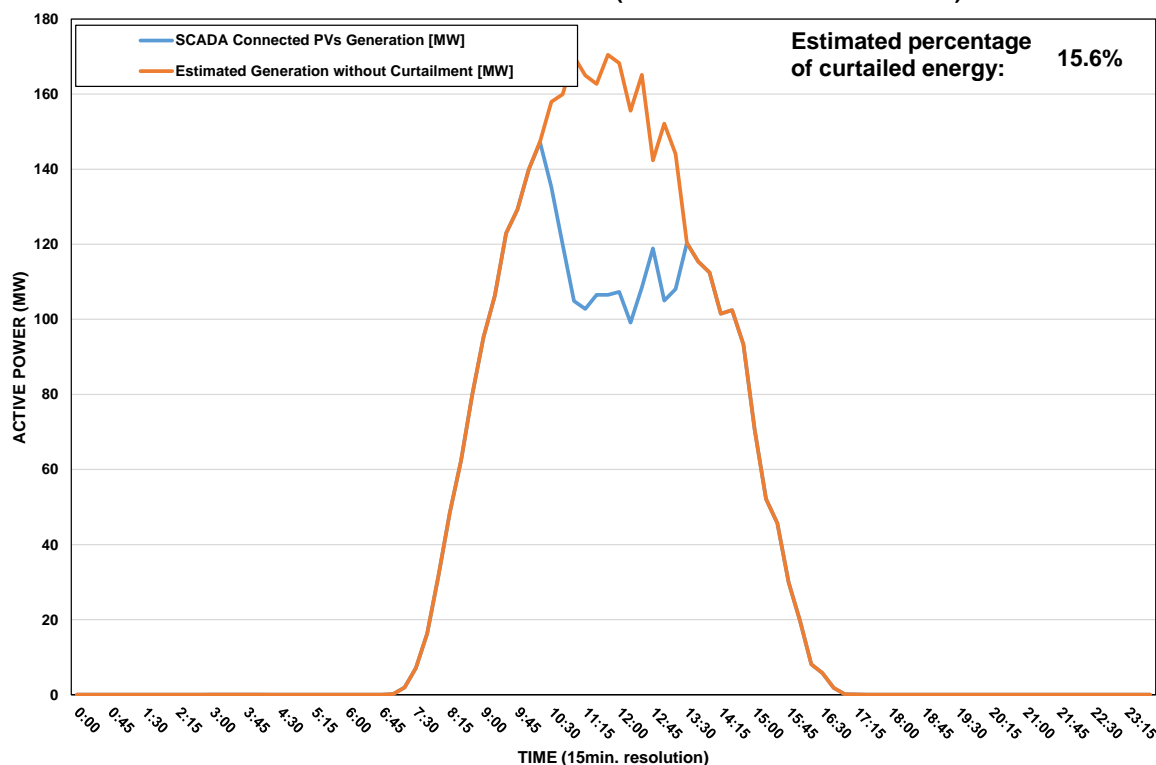


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/01/2025
Start of Curtailment	10:00
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1208.7 MWh
Total Estimated Curtailed Energy:	582.8 MWh
Percentage of Curtailed Energy	48.2%

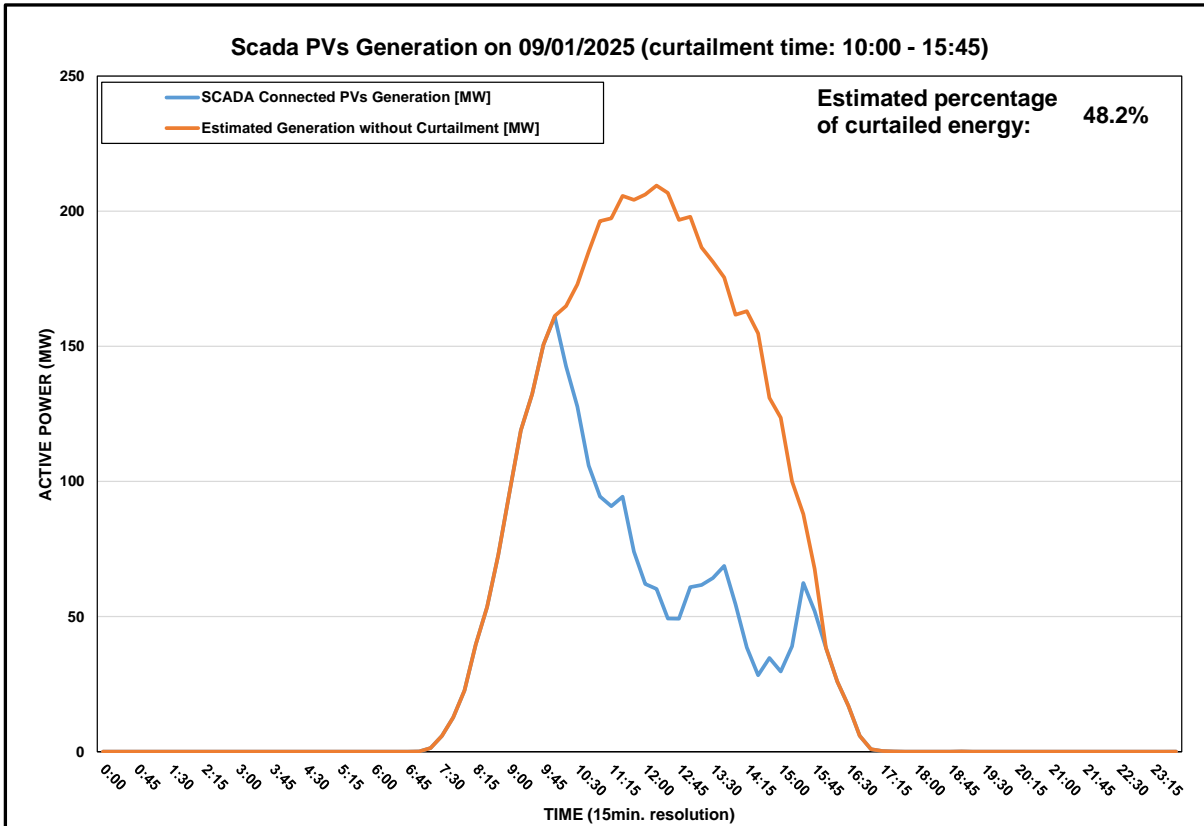


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	10/01/2025
Start of Curtailment	9:15
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1189.9 MWh
Total Estimated Curtailed Energy:	494.4 MWh
Percentage of Curtailed Energy	41.5%

Scada PVs Generation on 10/01/2025 (curtailment time: 09:15 - 15:15)

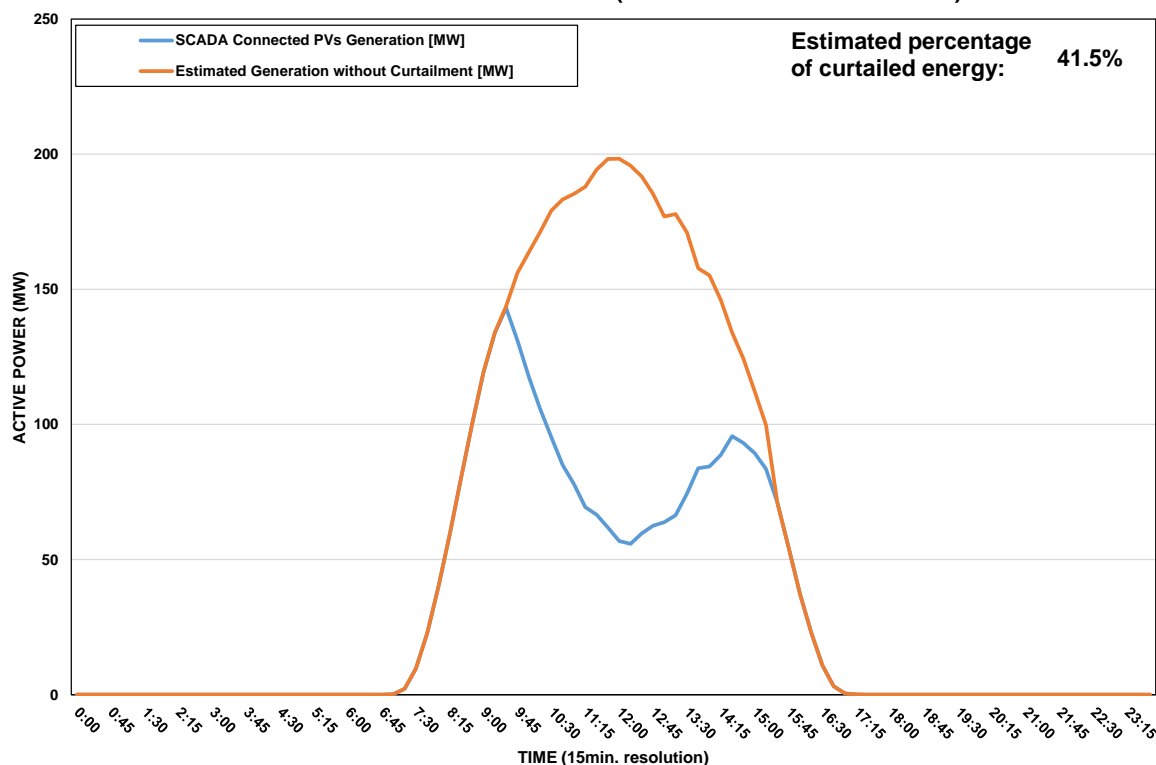


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/01/2025
Start of Curtailment	9:00
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1119.8 MWh
Total Estimated Curtailed Energy:	598.4 MWh
Percentage of Curtailed Energy	53.4%

Scada PVs Generation on 11/01/2025 (curtailment time: 09:00 - 14:30)

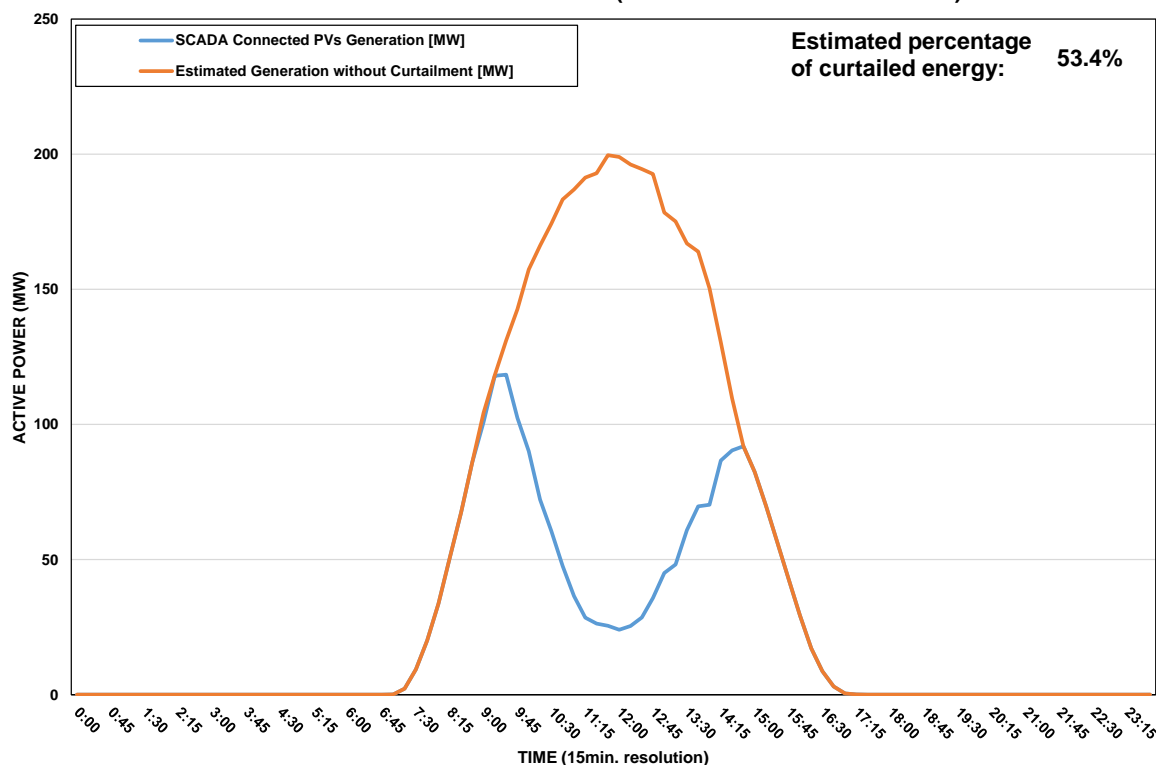


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	8:45	Start of cut-off:	10:00
End of Curtailment	14:15	End of cut-off:	14:00
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1124.1 MWh	Ripple cut-off Total Estimated energy	33 MWh
Total Estimated Curtailed Energy:	761.8 MWh	IoT cut-off Total Estimated energy	65.7 MWh
Percentage of Curtailed Energy	67.8%		

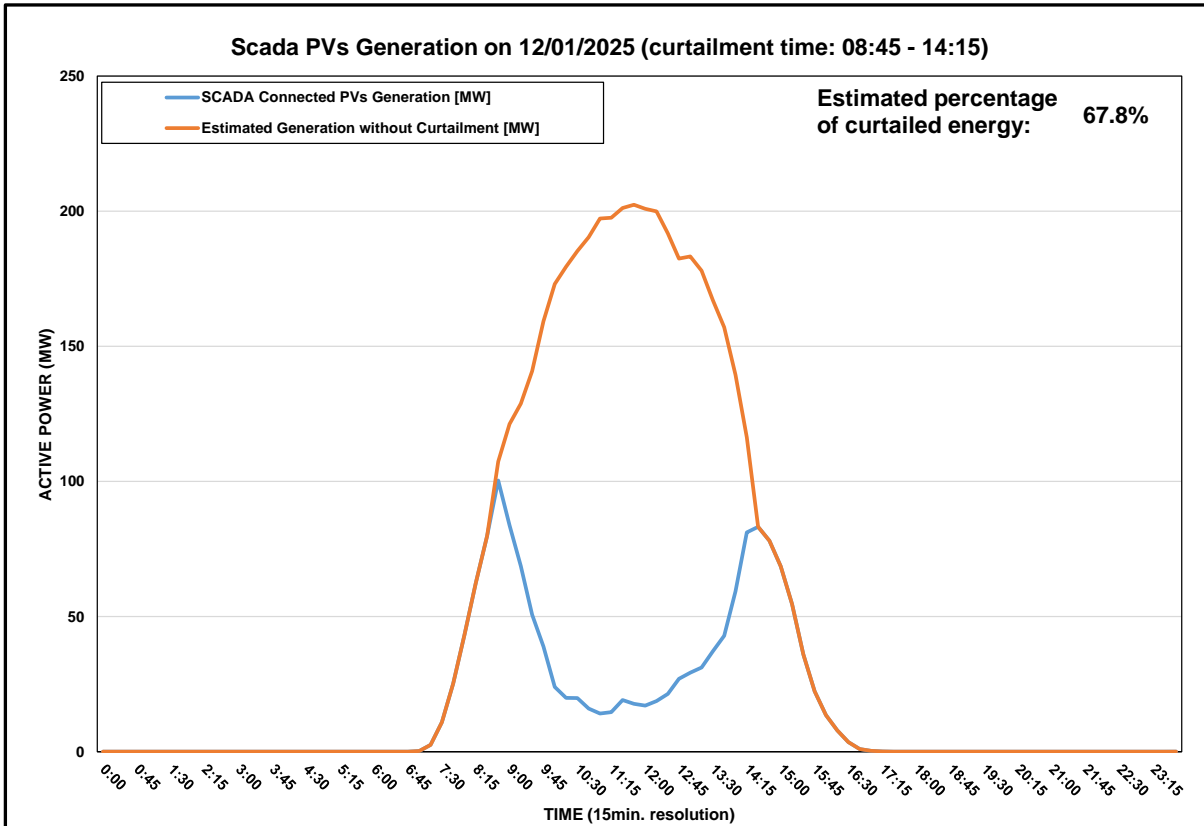


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	13/01/2025
Start of Curtailment	9:30
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1263.6 MWh
Total Estimated Curtailed Energy:	757 MWh
Percentage of Curtailed Energy	59.9%

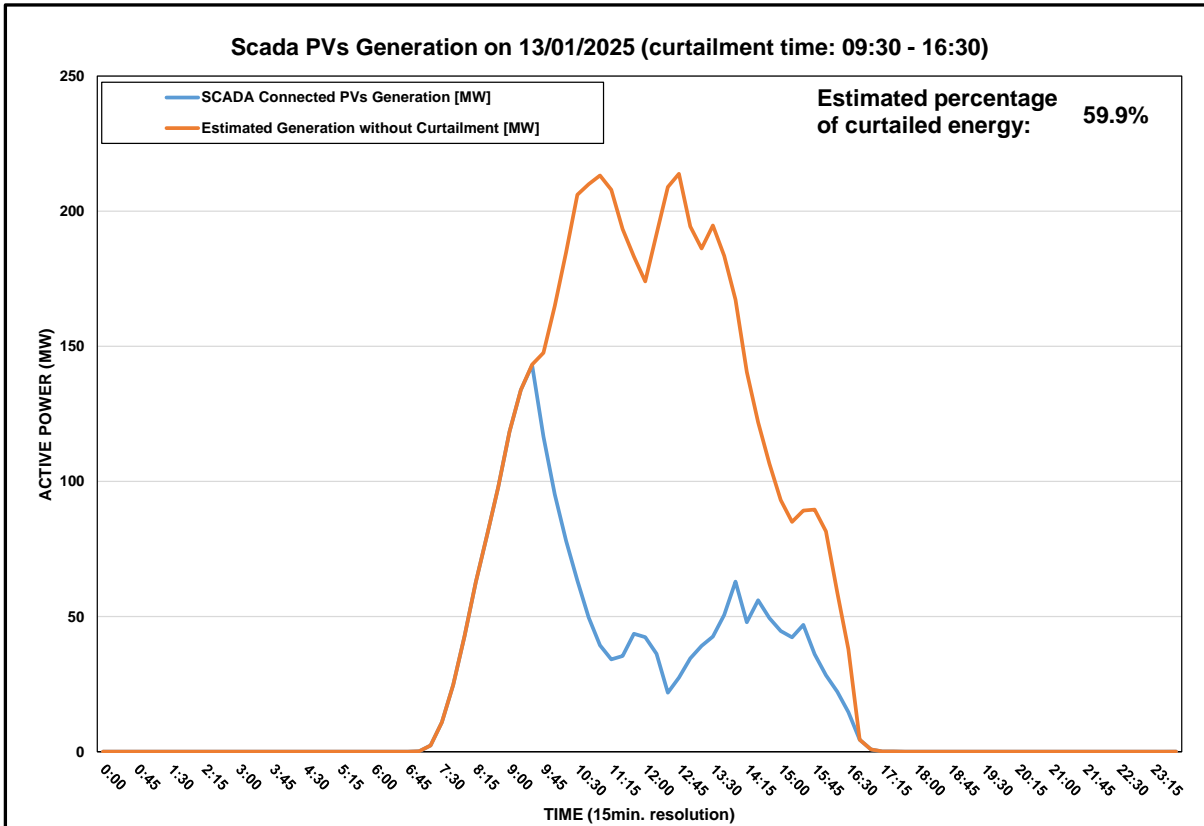


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	14/01/2025
Start of Curtailment	9:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1267.7 MWh
Total Estimated Curtailed Energy:	785.6 MWh
Percentage of Curtailed Energy	62.0%

Scada PVs Generation on 14/01/2025 (curtailment time: 09:15 - 16:30)

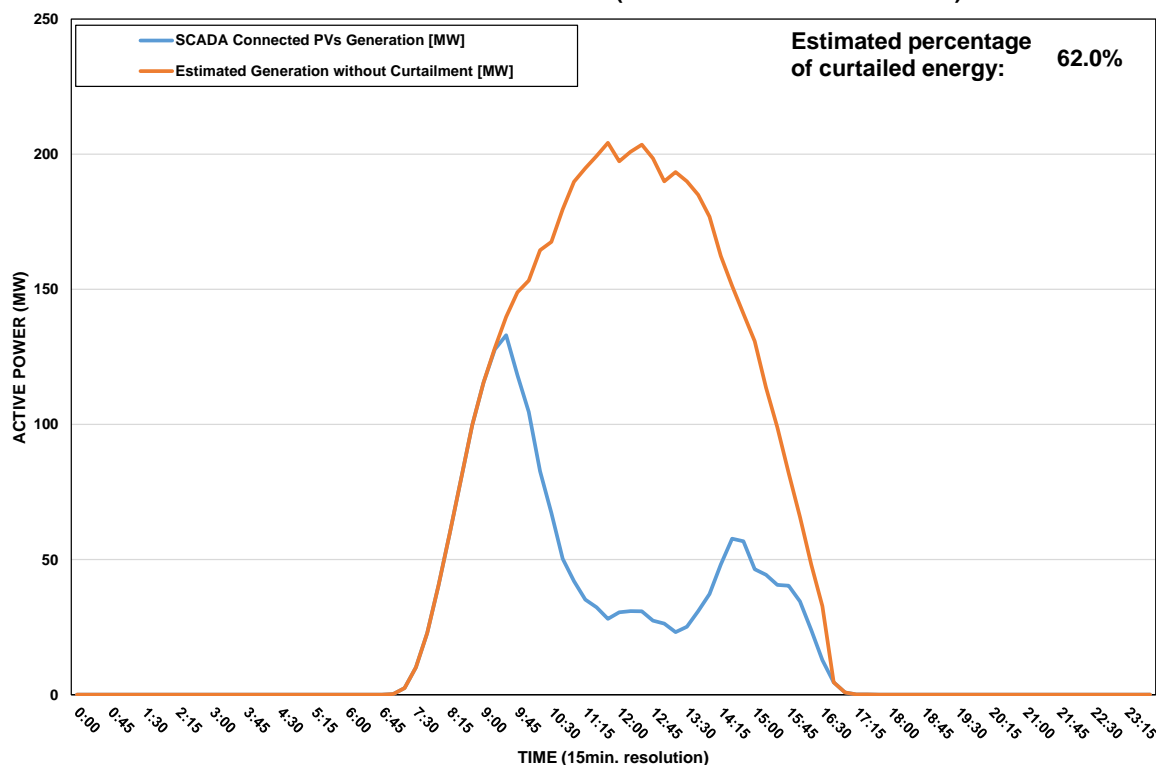


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	15/01/2025
Start of Curtailment	9:30
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1132.7 MWh
Total Estimated Curtailed Energy:	562 MWh
Percentage of Curtailed Energy	49.6%

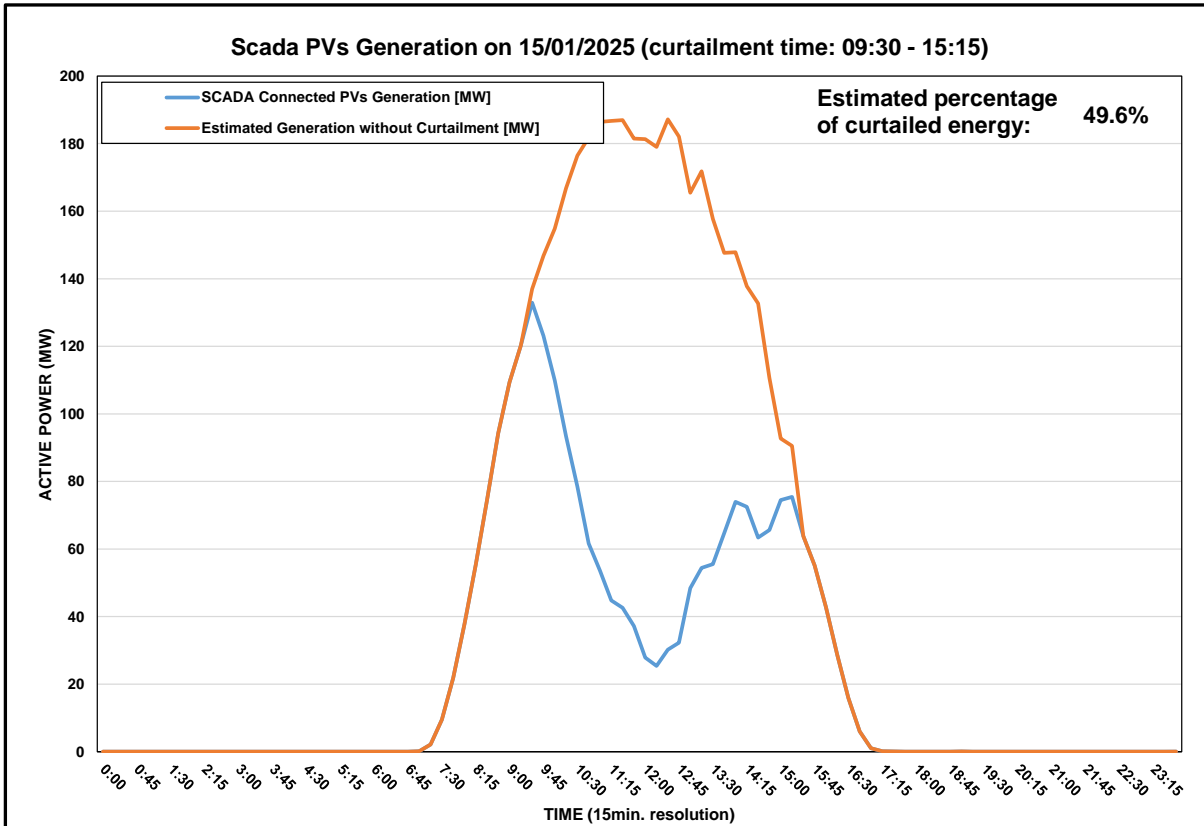


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/01/2025	Ripple PV System cut-off:	
Start of Curtailment	9:00	Start of cut-off:	12:15
End of Curtailment	15:30	End of cut-off:	13:15
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1235.9 MWh	Ripple cut-off Total Estimated energy	13 MWh
Total Estimated Curtailed Energy:	808 MWh		
Percentage of Curtailed Energy	65.4%		

Scada PVs Generation on 16/01/2025 (curtailment time: 09:00 - 15:30)

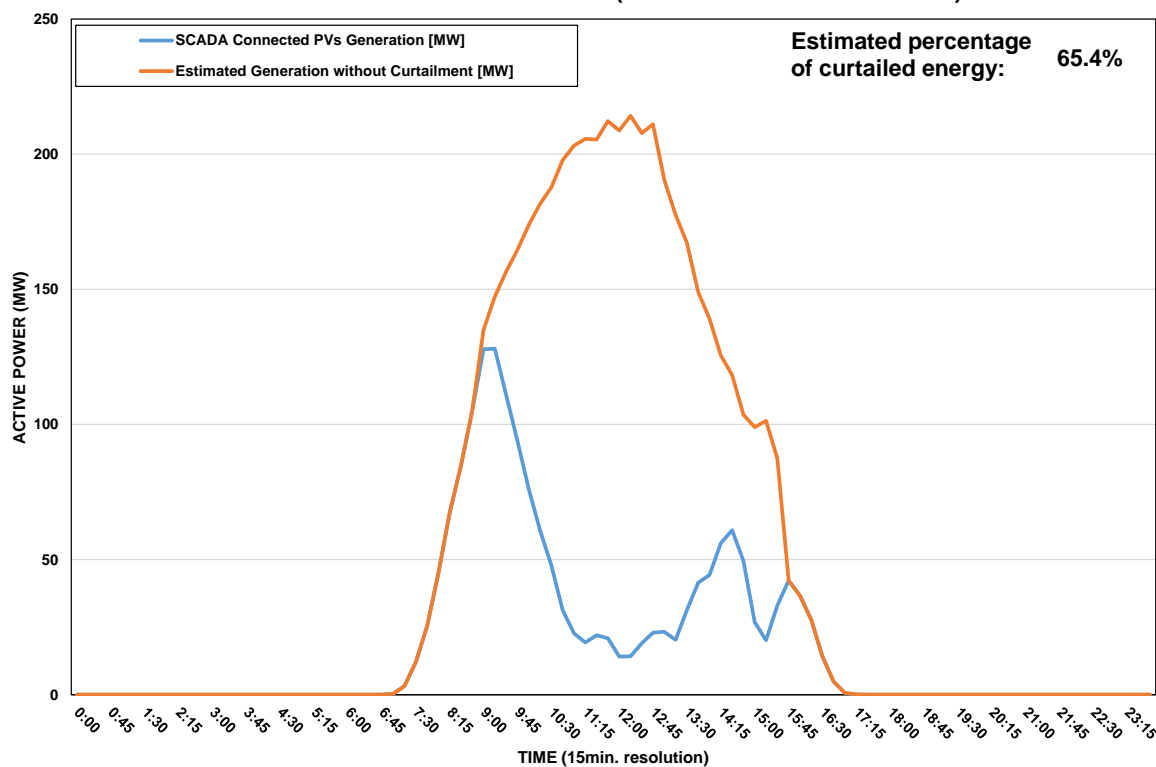


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	8:45	Start of cut-off:	11:30
End of Curtailment	15:45	End of cut-off:	15:45
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1371.8 MWh	Ripple cut-off Total Estimated energy	34.6 MWh
Total Estimated Curtailed Energy:	936.6 MWh	IoT cut-off Total Estimated energy	39.5 MWh
Percentage of Curtailed Energy	68.3%		

Scada PVs Generation on 17/01/2025 (curtailment time: 08:45 - 15:45)

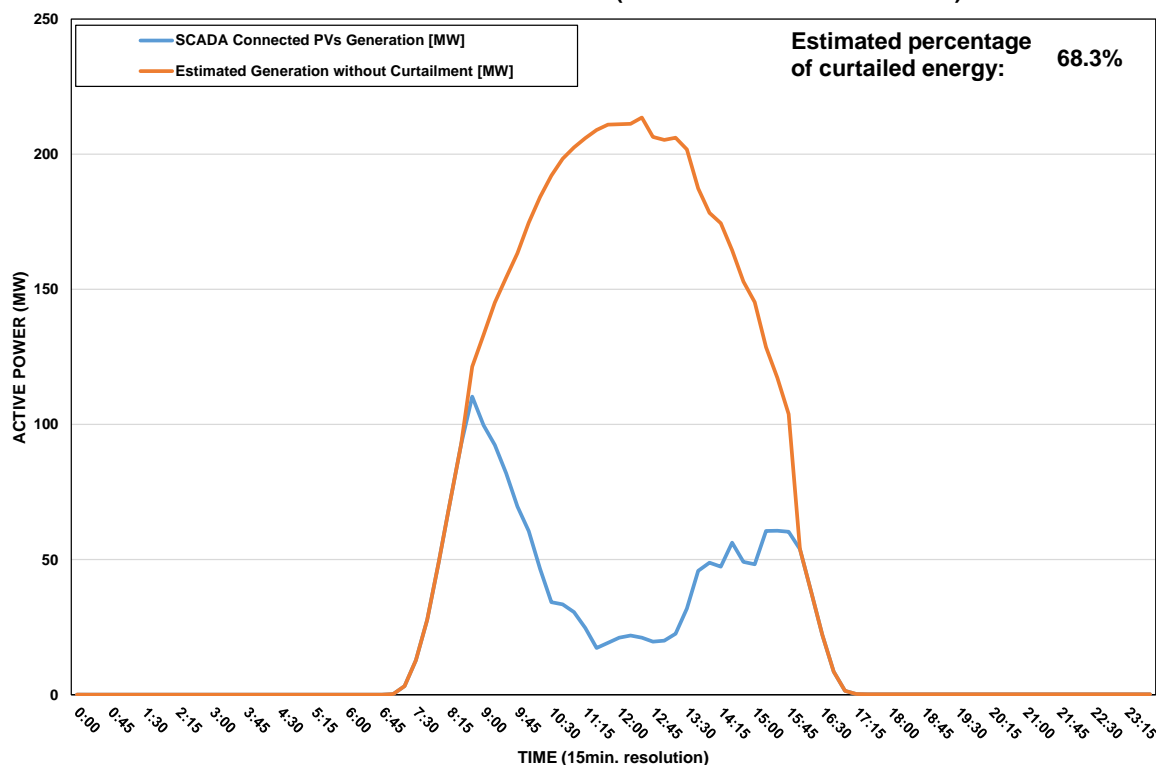


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	18/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	8:30	Start of cut-off:	10:30
End of Curtailment	16:00	End of cut-off:	15:15
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1457.2 MWh	Ripple cut-off Total Estimated energy	168.6 MWh
Total Estimated Curtailed Energy:	1174.4 MWh	IoT cut-off Total Estimated energy	28.2 MWh
Percentage of Curtailed Energy	80.6%		

Scada PVs Generation on 18/01/2025 (curtailment time: 08:30 - 16:00)

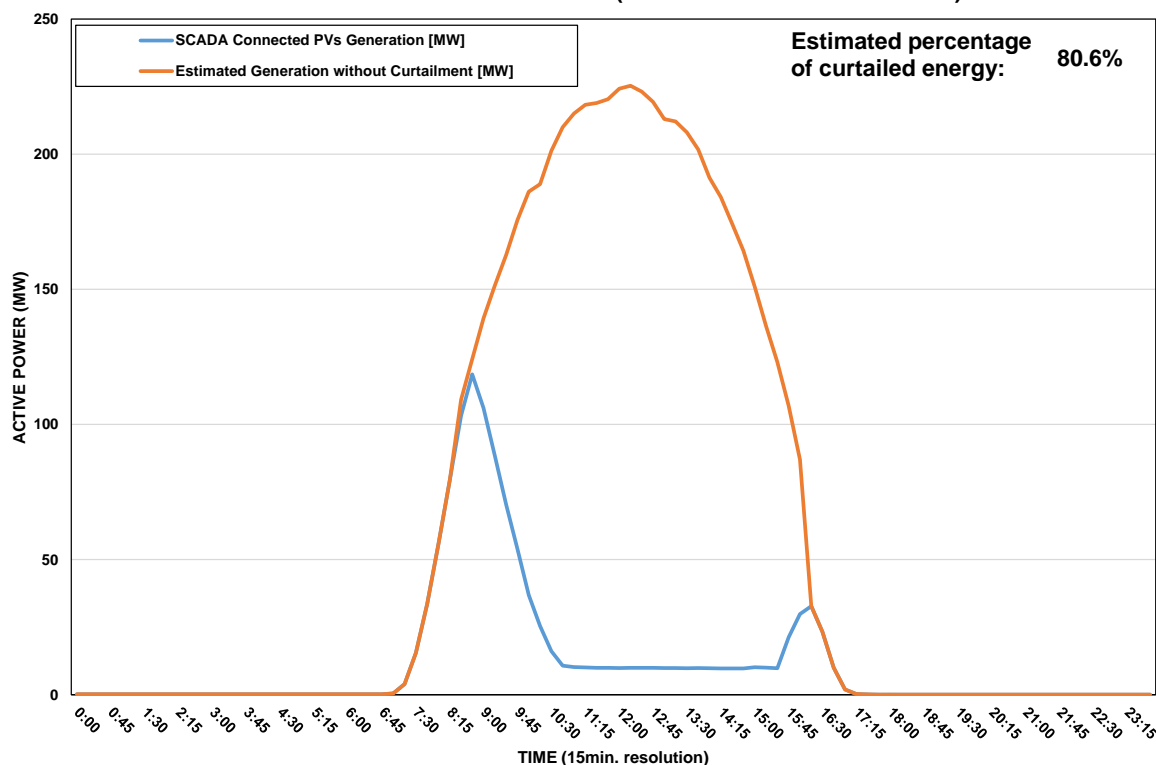


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	19/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	8:15	Start of cut-off:	9:30
End of Curtailment	16:00	End of cut-off:	16:00
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1439.5 MWh	Ripple cut-off Total Estimated energy	274.8 MWh
Total Estimated Curtailed Energy:	1248.4 MWh	IoT cut-off Total Estimated energy	61 MWh
Percentage of Curtailed Energy	86.7%		

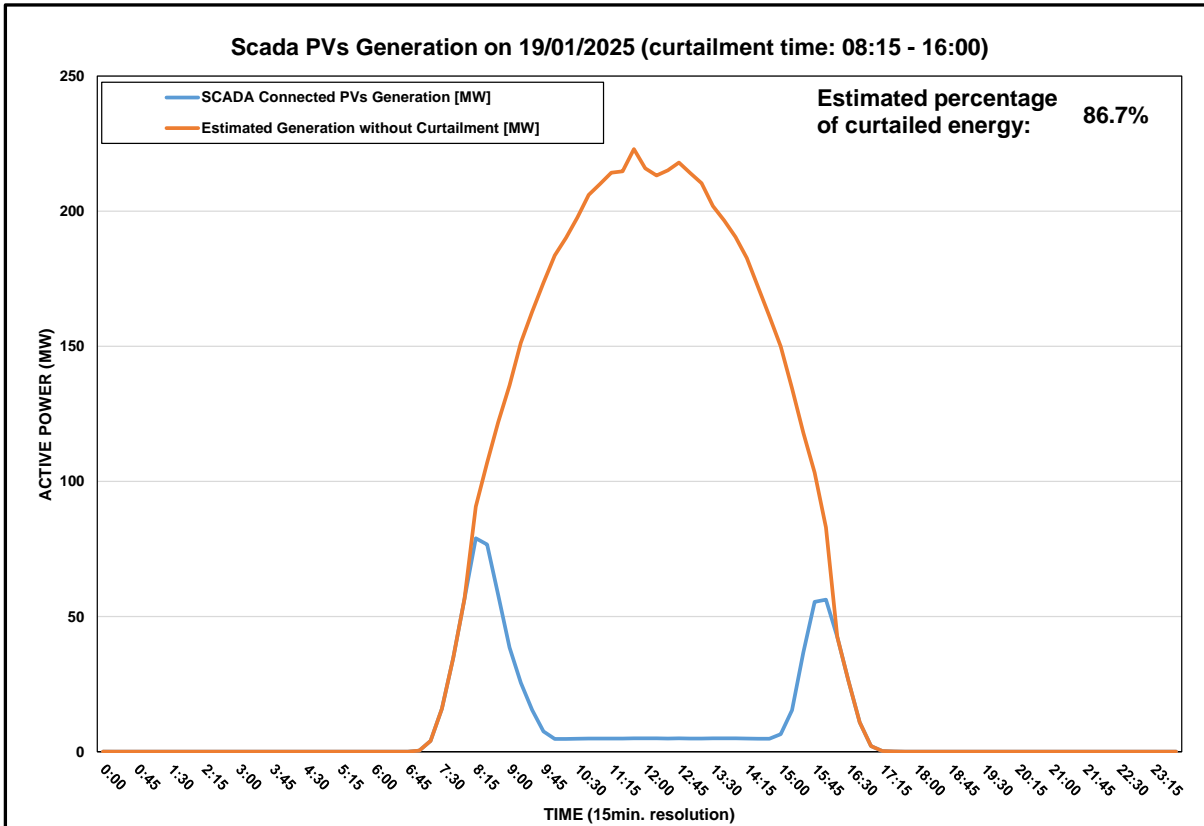


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	20/01/2025	Ripple PV System cut-off:	
Start of Curtailment	9:00	Start of cut-off:	12:00
End of Curtailment	15:45	End of cut-off:	16:00
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1421.4 MWh	Ripple cut-off Total Estimated energy	33.9 MWh
Total Estimated Curtailed Energy:	932 MWh		
Percentage of Curtailed Energy	65.6%		

Scada PVs Generation on 20/01/2025 (curtailment time: 09:00 - 15:45)

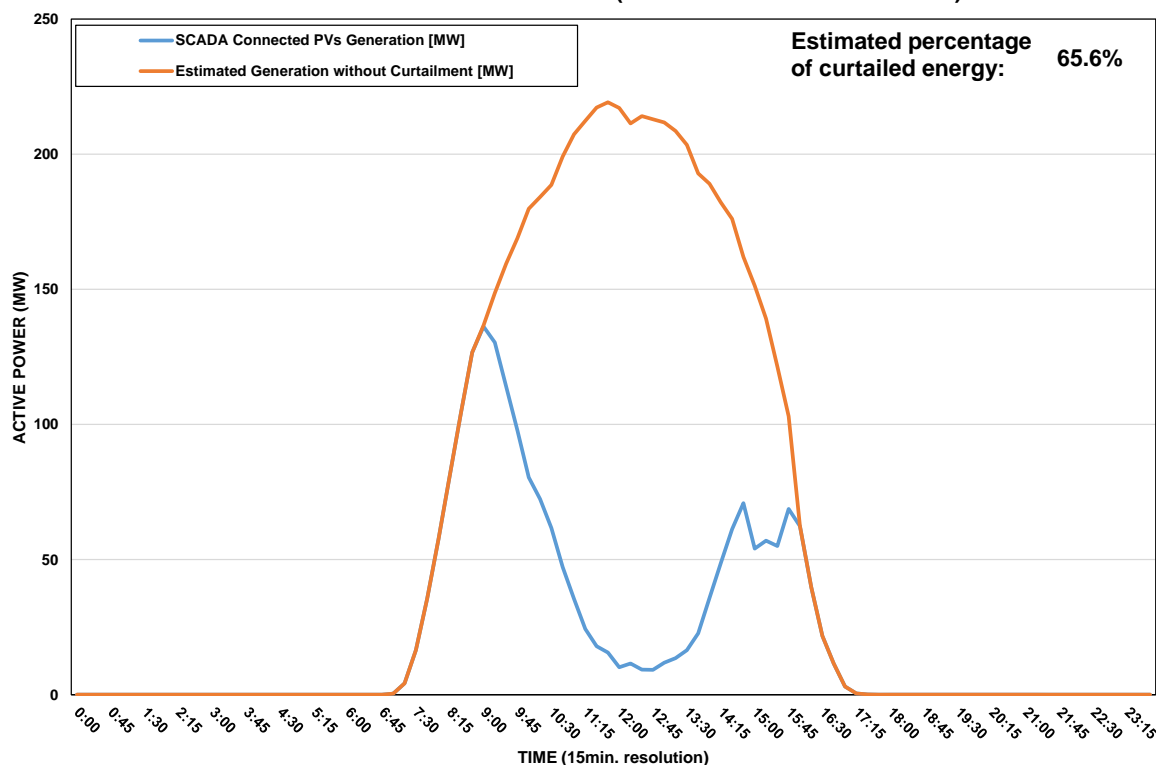


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	9:15	Start of cut-off:	12:15
End of Curtailment	15:45	End of cut-off:	16:00
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1281.8 MWh	Ripple cut-off Total Estimated energy	29.1 MWh
Total Estimated Curtailed Energy:	718.1 MWh	IoT cut-off Total Estimated energy	14.5 MWh
Percentage of Curtailed Energy	56.0%		

Scada PVs Generation on 21/01/2025 (curtailment time: 09:15 - 15:45)

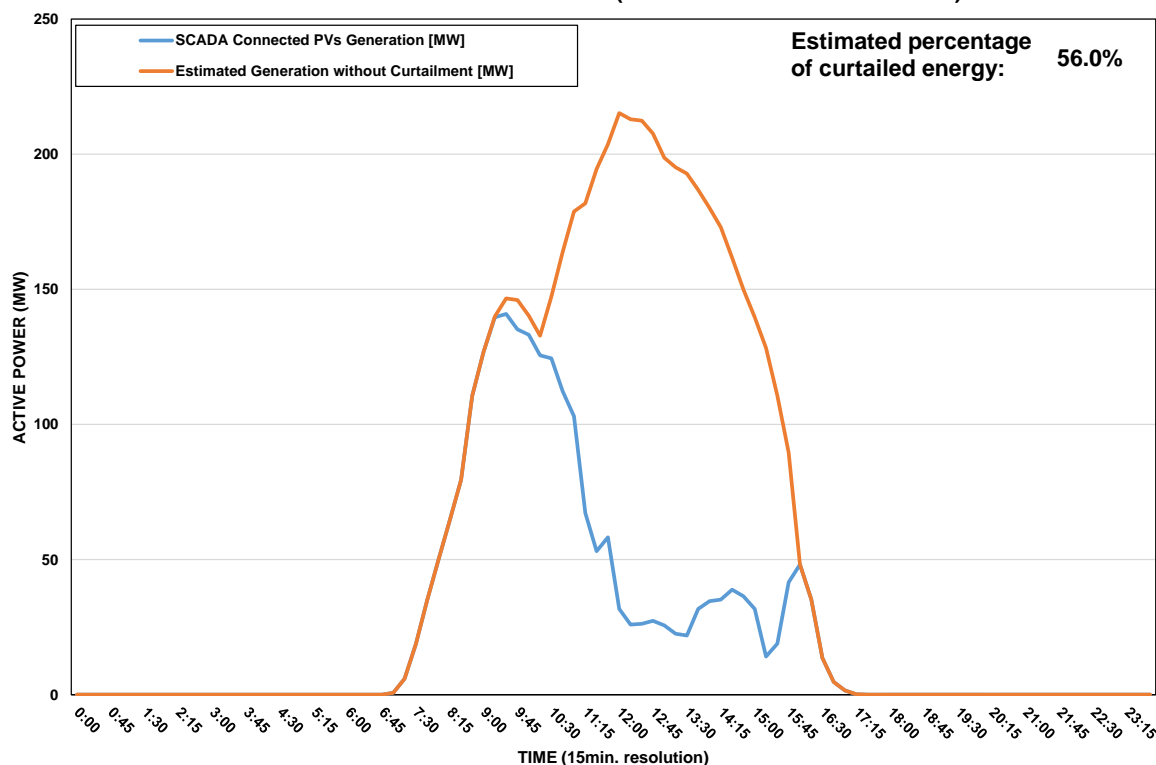


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/01/2025
Start of Curtailment	9:30
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	951.6 MWh
Total Estimated Curtailed Energy:	326.1 MWh
Percentage of Curtailed Energy	34.3%

Scada PVs Generation on 24/01/2025 (curtailment time: 09:30 - 13:45)

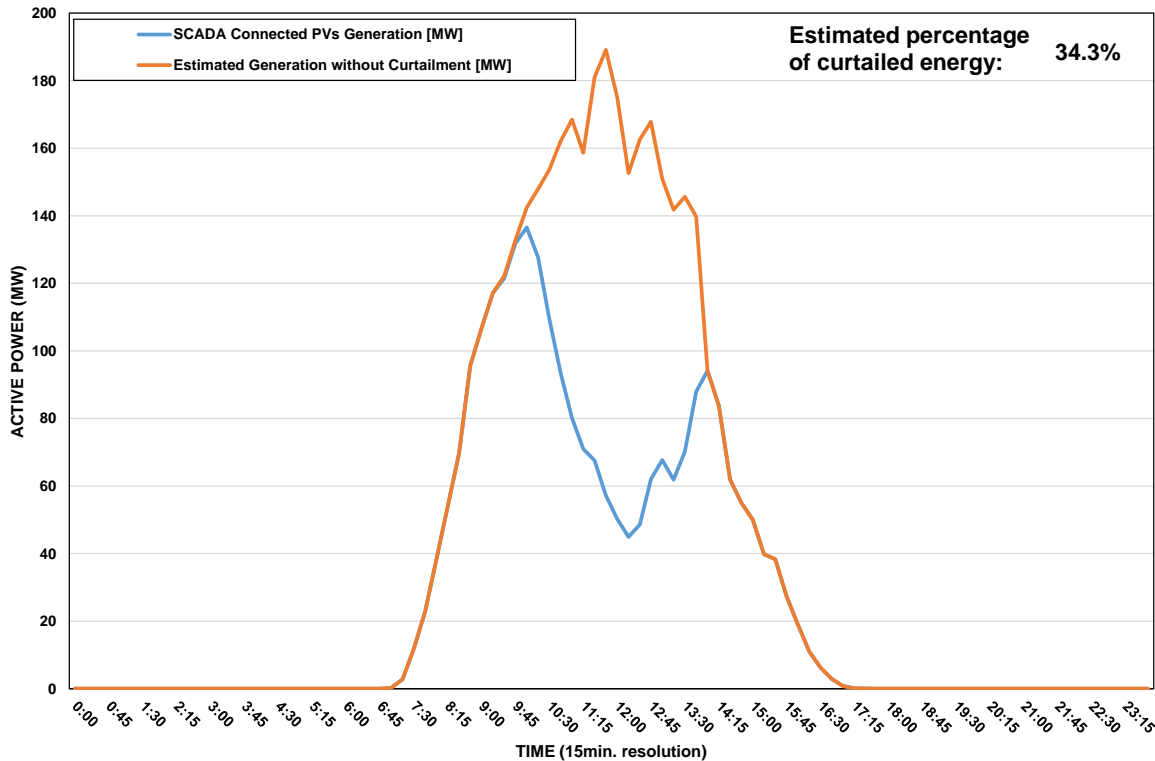


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	25/01/2025
Start of Curtailment	9:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1237.2 MWh
Total Estimated Curtailed Energy:	704.7 MWh
Percentage of Curtailed Energy	57.0%

Scada PVs Generation on 25/01/2025 (curtailment time: 09:30 - 15:30)

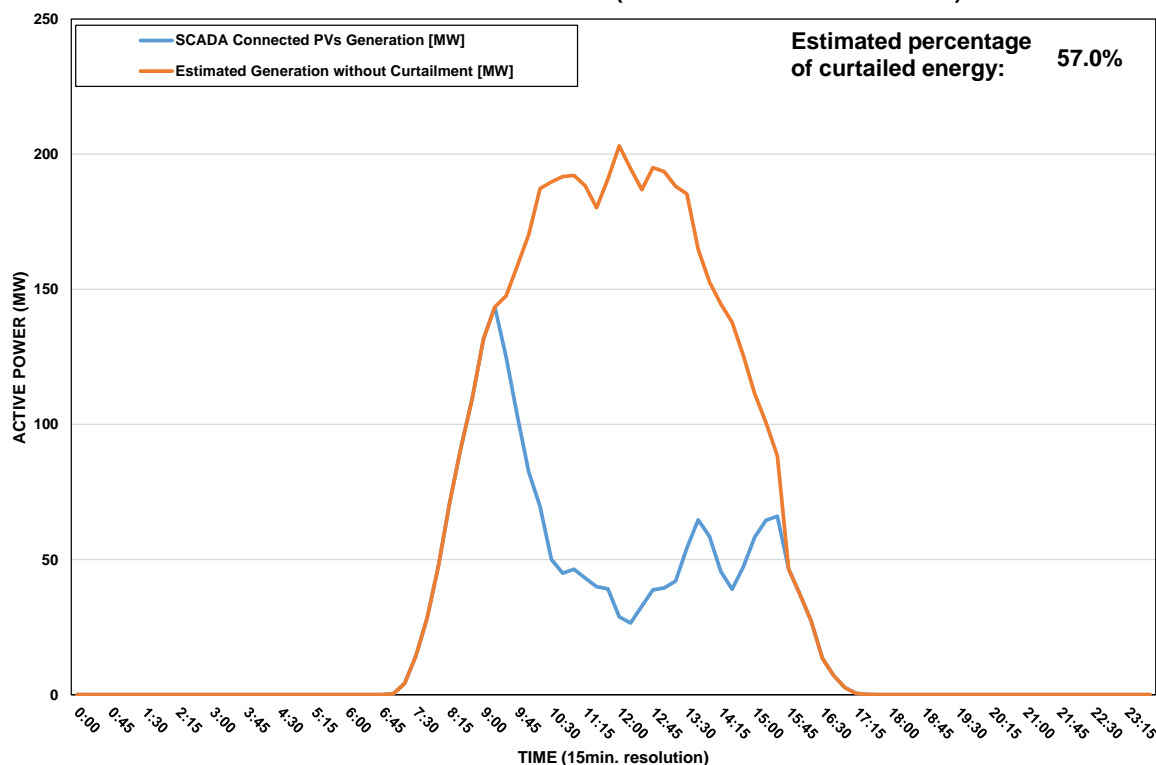


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	26/01/2025
Start of Curtailment	9:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	963.7 MWh
Total Estimated Curtailed Energy:	407.4 MWh
Percentage of Curtailed Energy	42.3%

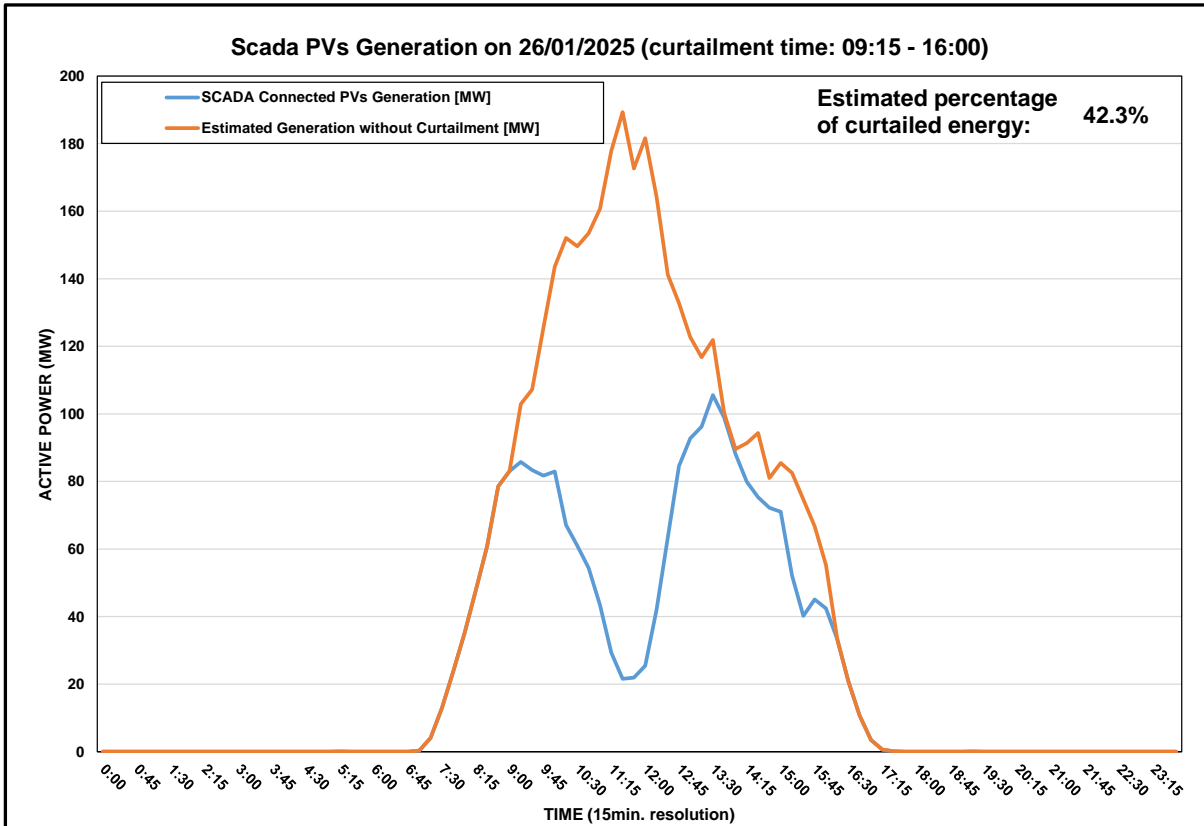


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	27/01/2025	IoT/Ripple PV System cut-off:	
Start of Curtailment	9:15	Start of cut-off:	12:15
End of Curtailment	16:15	End of cut-off:	14:30
Instruction from TSOC	YES		
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system		
Total Estimated Energy of the day:	1510.5 MWh	Ripple cut-off Total Estimated energy	20.2 MWh
Total Estimated Curtailed Energy:	903.3 MWh		
Percentage of Curtailed Energy	59.8%		

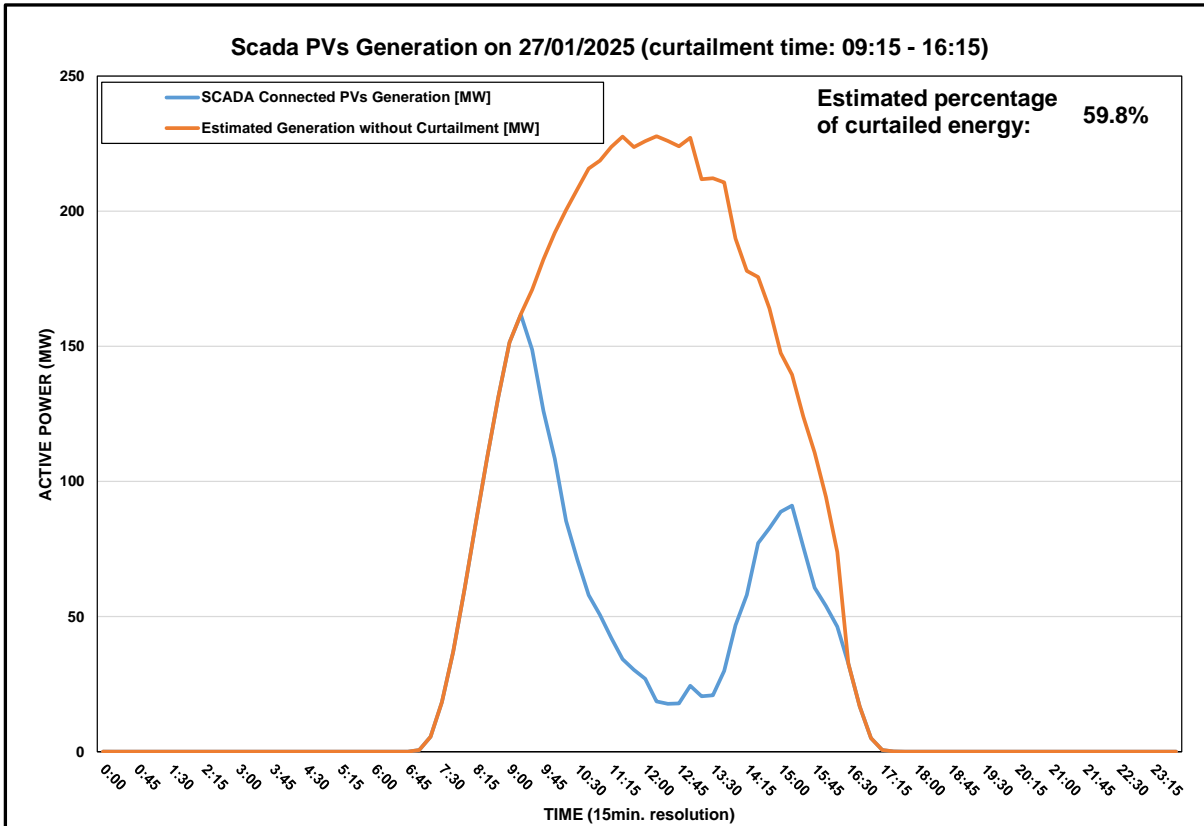


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	28/01/2025
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1274.1 MWh
Total Estimated Curtailed Energy:	459.4 MWh
Percentage of Curtailed Energy	36.1%

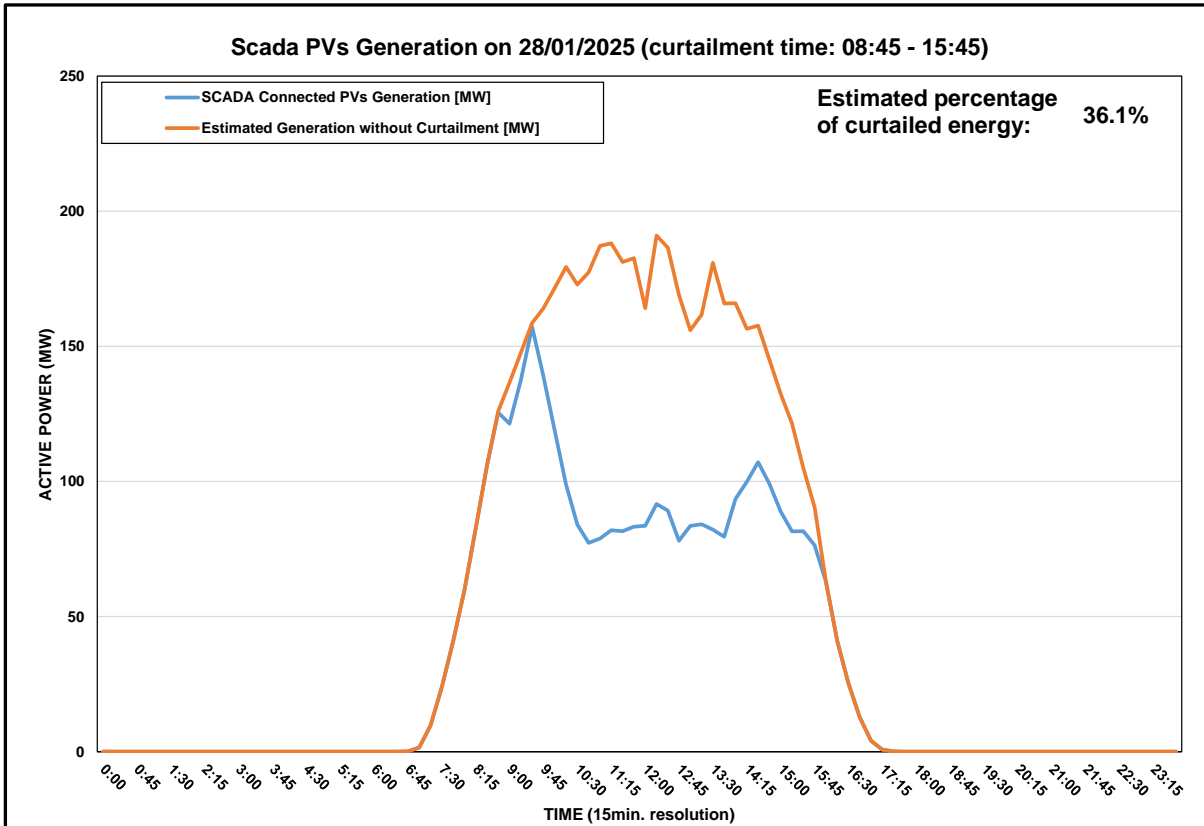


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	29/01/2025
Start of Curtailment	9:00
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1492.1 MWh
Total Estimated Curtailed Energy:	977.3 MWh
Percentage of Curtailed Energy	65.5%

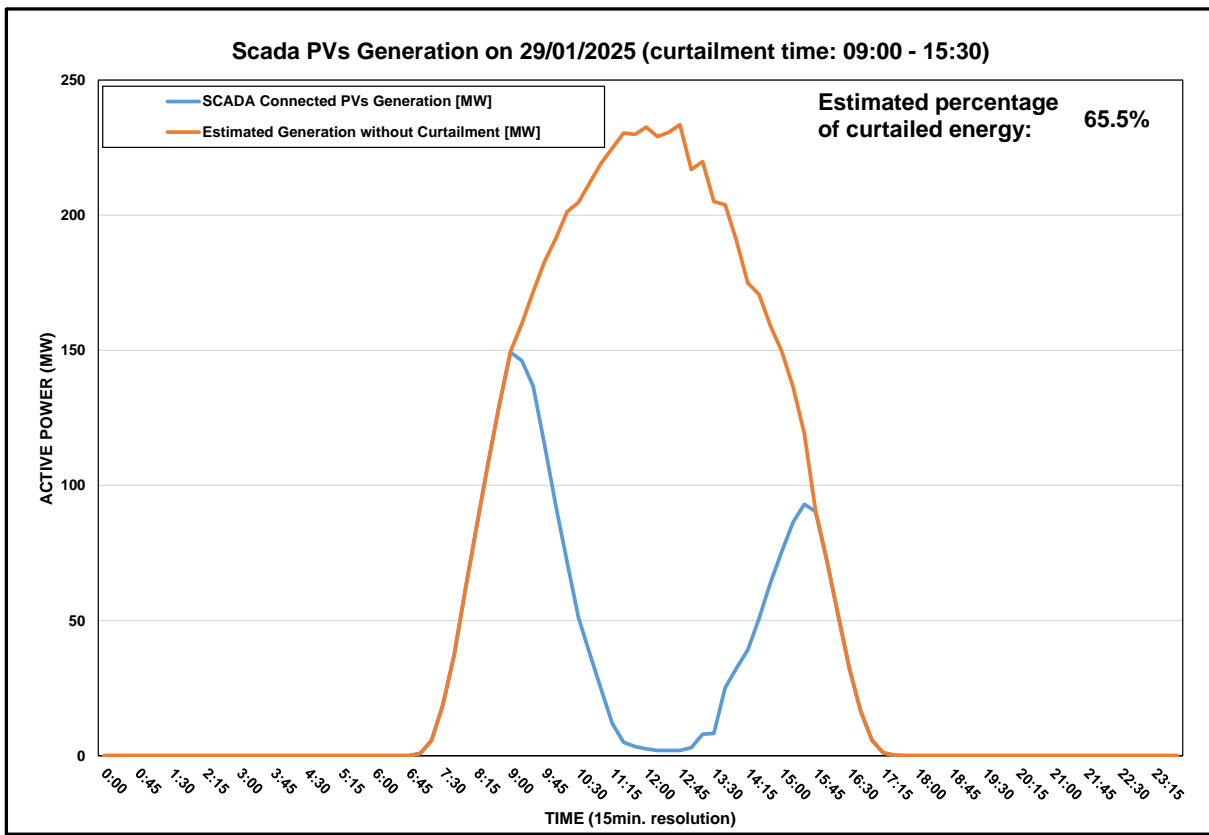


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	30/01/2025
Start of Curtailment	9:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1532.5 MWh
Total Estimated Curtailed Energy:	812 MWh
Percentage of Curtailed Energy	53.0%

Scada PVs Generation on 30/01/2025 (curtailment time: 09:30 - 15:30)

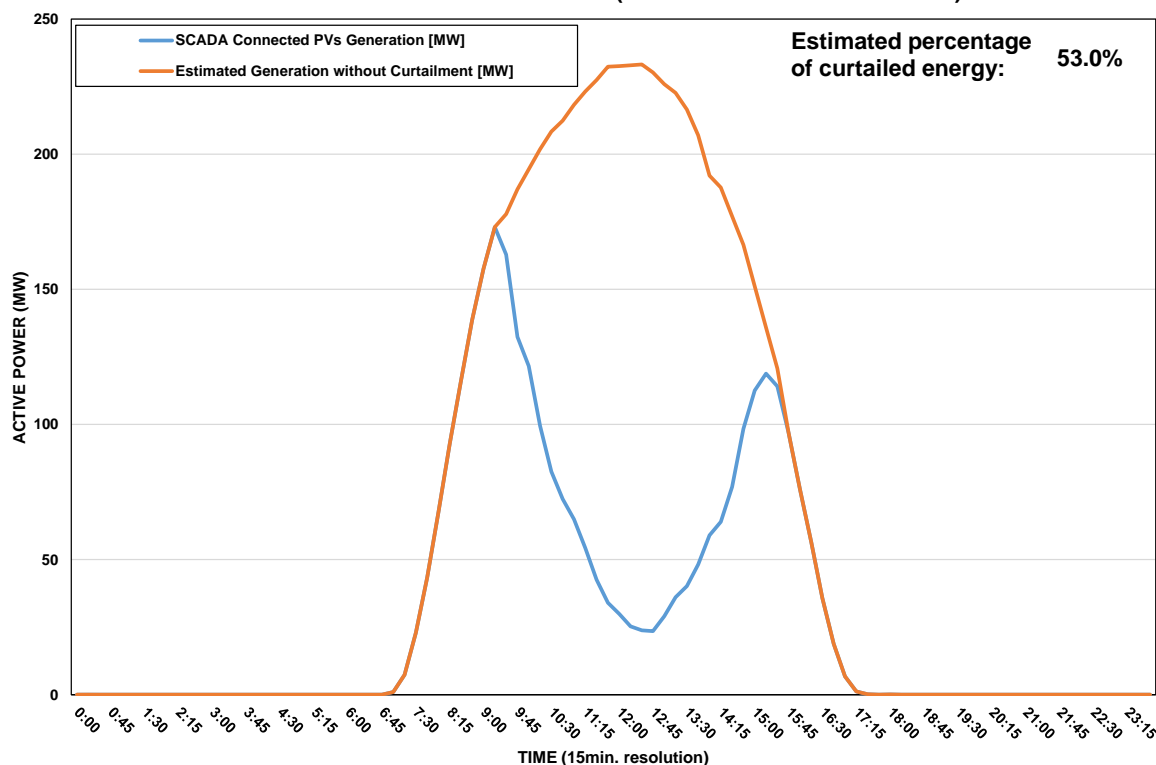

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	31/01/2025
Start of Curtailment	9:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1365.5 MWh
Total Estimated Curtailed Energy:	684.6 MWh
Percentage of Curtailed Energy	50.1%

Scada PVs Generation on 31/01/2025 (curtailment time: 09:15 - 16:00)

