


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	01/06/2024
Start of Curtailment	9:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2275.3 MWh
Total Estimated Curtailed Energy:	886.1 MWh
Percentage of Curtailed Energy	38.9%

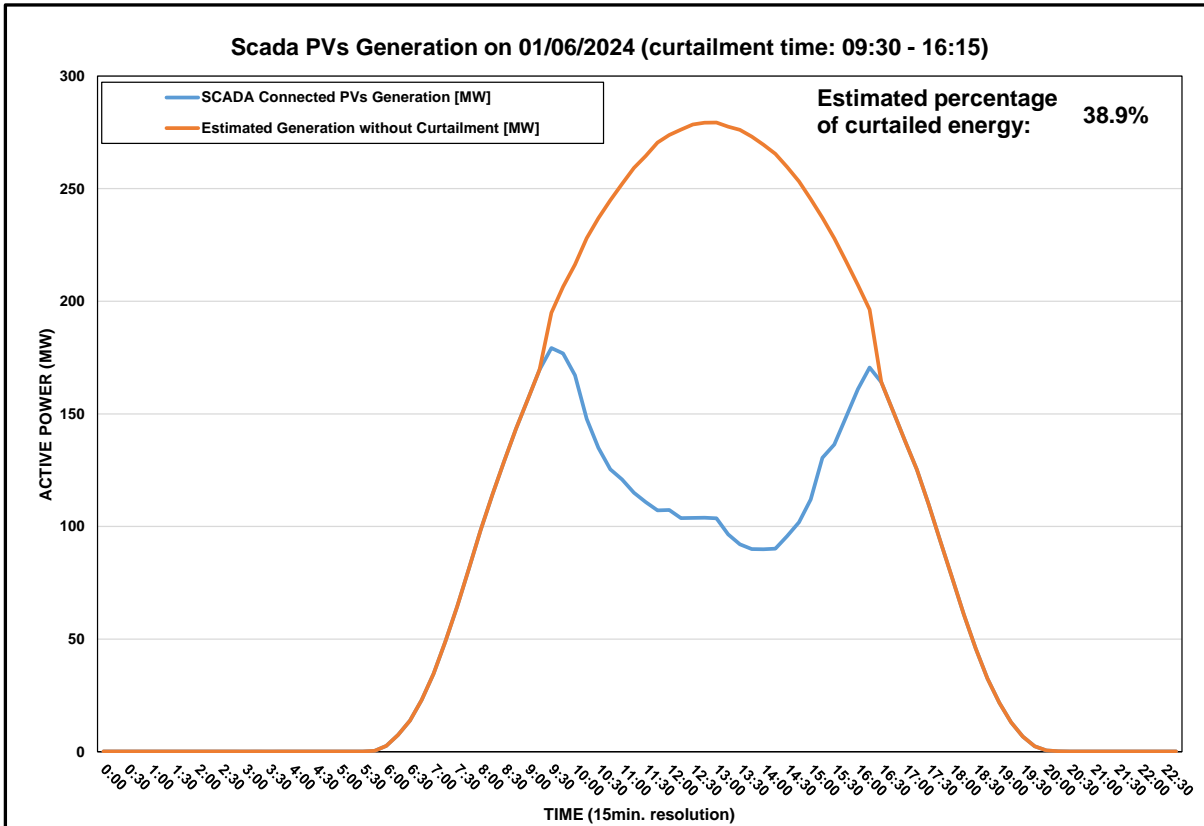


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	02/06/2024
Start of Curtailment	8:45
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2305.6 MWh
Total Estimated Curtailed Energy:	1102.9 MWh
Percentage of Curtailed Energy	47.8%

Scada PVs Generation on 02/06/2024 (curtailment time: 08:45 - 16:00)

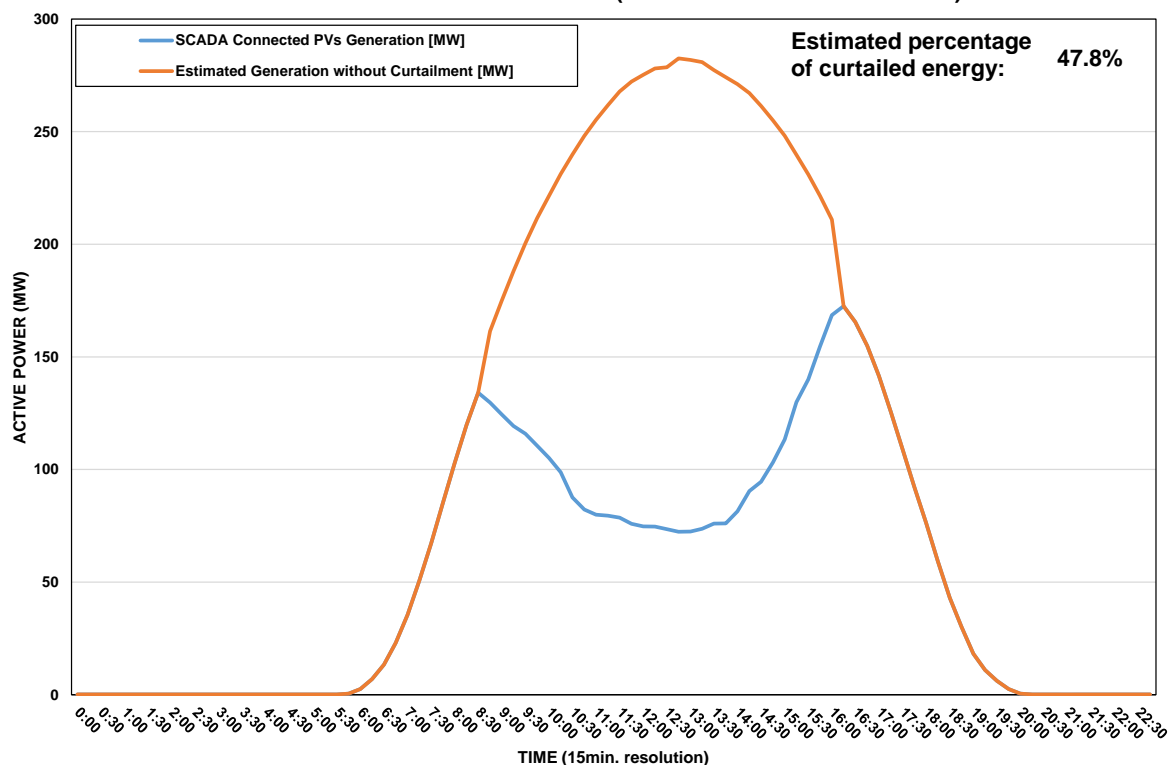


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	03/06/2024
Start of Curtailment	11:00
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2098.5 MWh
Total Estimated Curtailed Energy:	62.8 MWh
Percentage of Curtailed Energy	3.0%

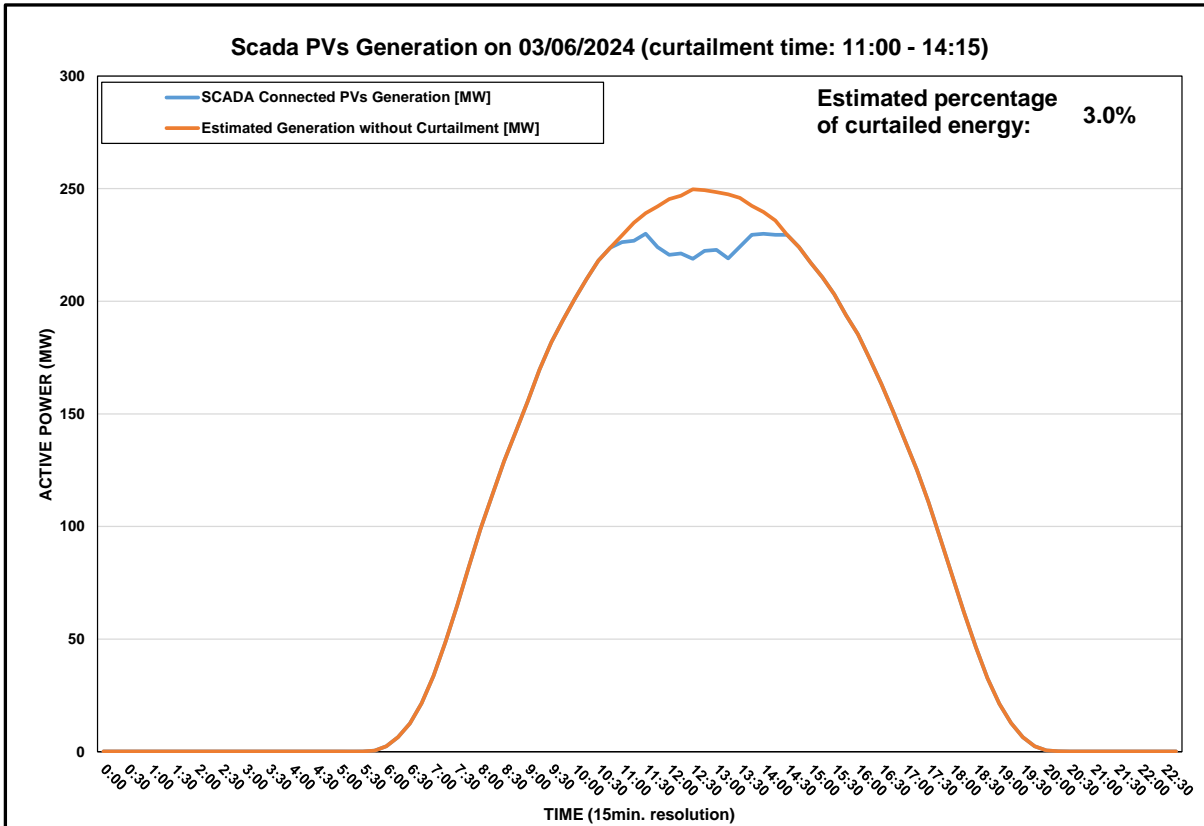


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	04/06/2024
Start of Curtailment	9:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction for protection of distribution lines in S/S NEW MARI
Total Estimated Energy of the day:	2064.4 MWh
Total Estimated Curtailed Energy:	4.8 MWh
Percentage of Curtailed Energy	0.2%

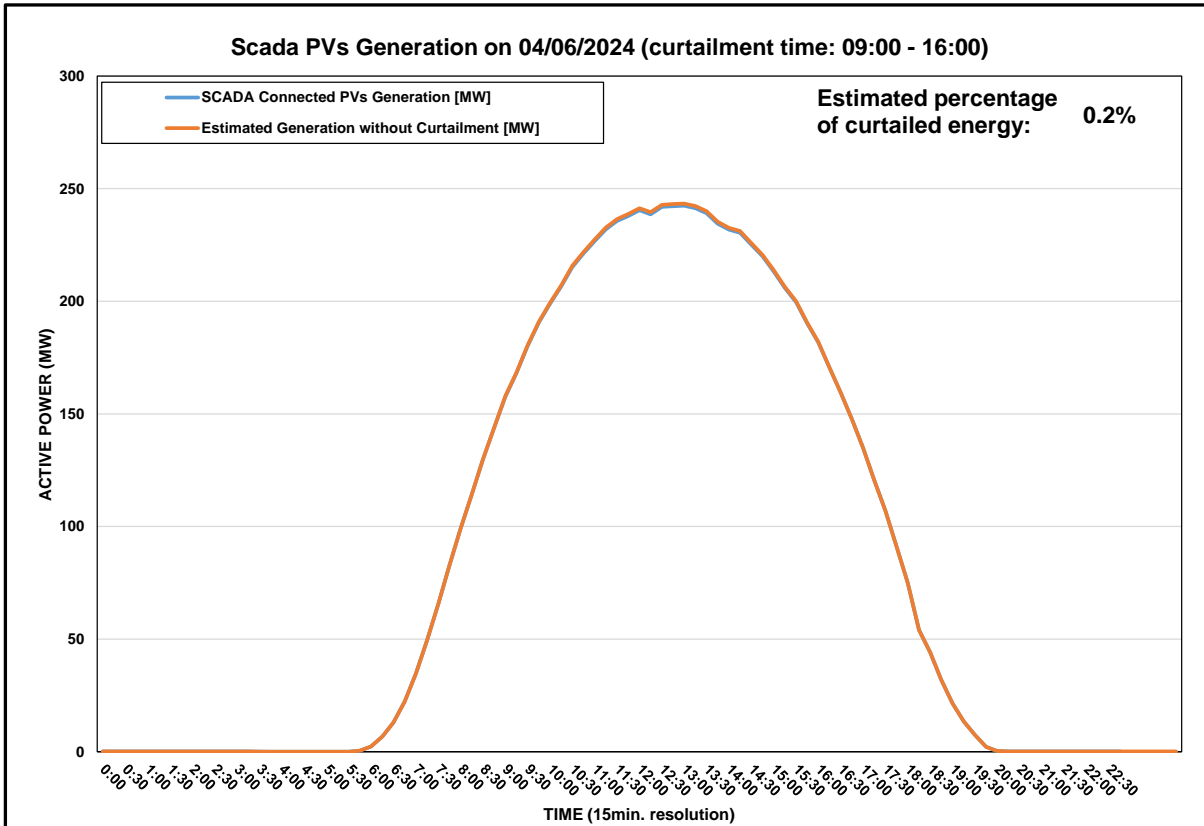


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	05/06/2024
Start of Curtailment	8:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction for protection of distribution lines in S/S NEW MARI and S/S AGIOS NICOLAOS
Total Estimated Energy of the day:	2054.7 MWh
Total Estimated Curtailed Energy:	70.2 MWh
Percentage of Curtailed Energy	3.4%

Scada PVs Generation on 05/06/2024 (curtailment time: 08:00 - 16:00)

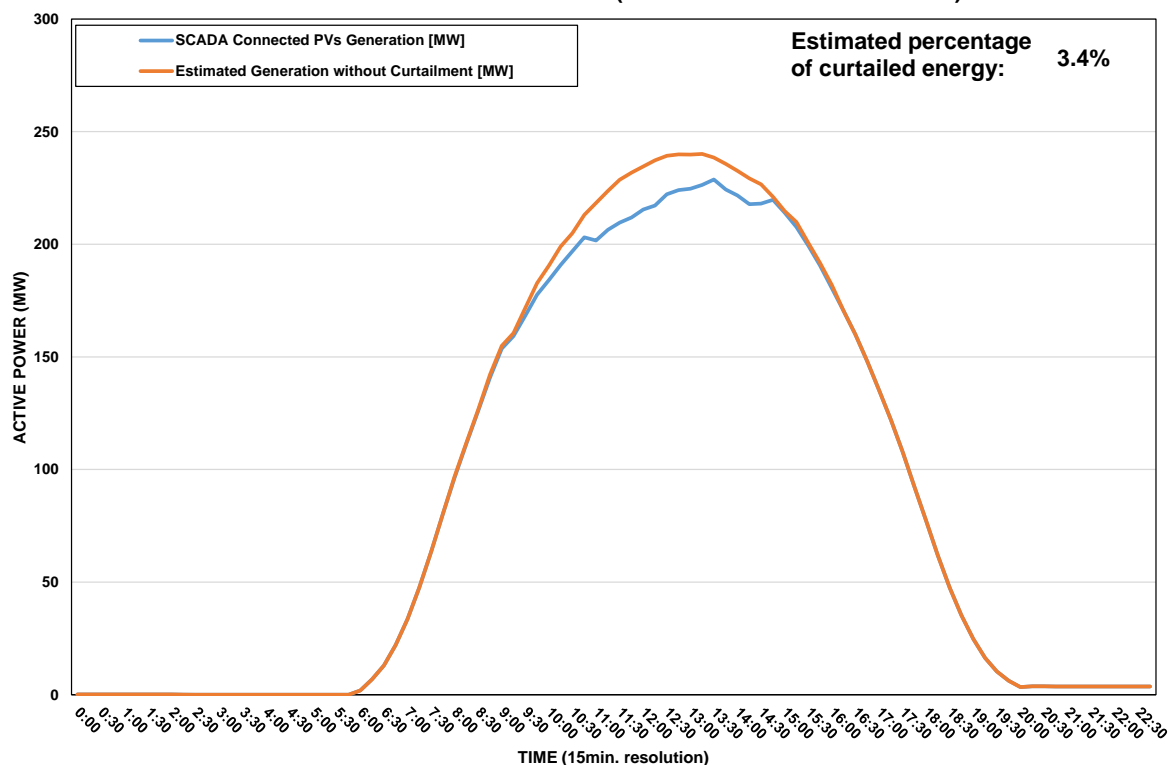


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	08/06/2024
Start of Curtailment	12:15
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1725.4 MWh
Total Estimated Curtailed Energy:	16.9 MWh
Percentage of Curtailed Energy	1.0%

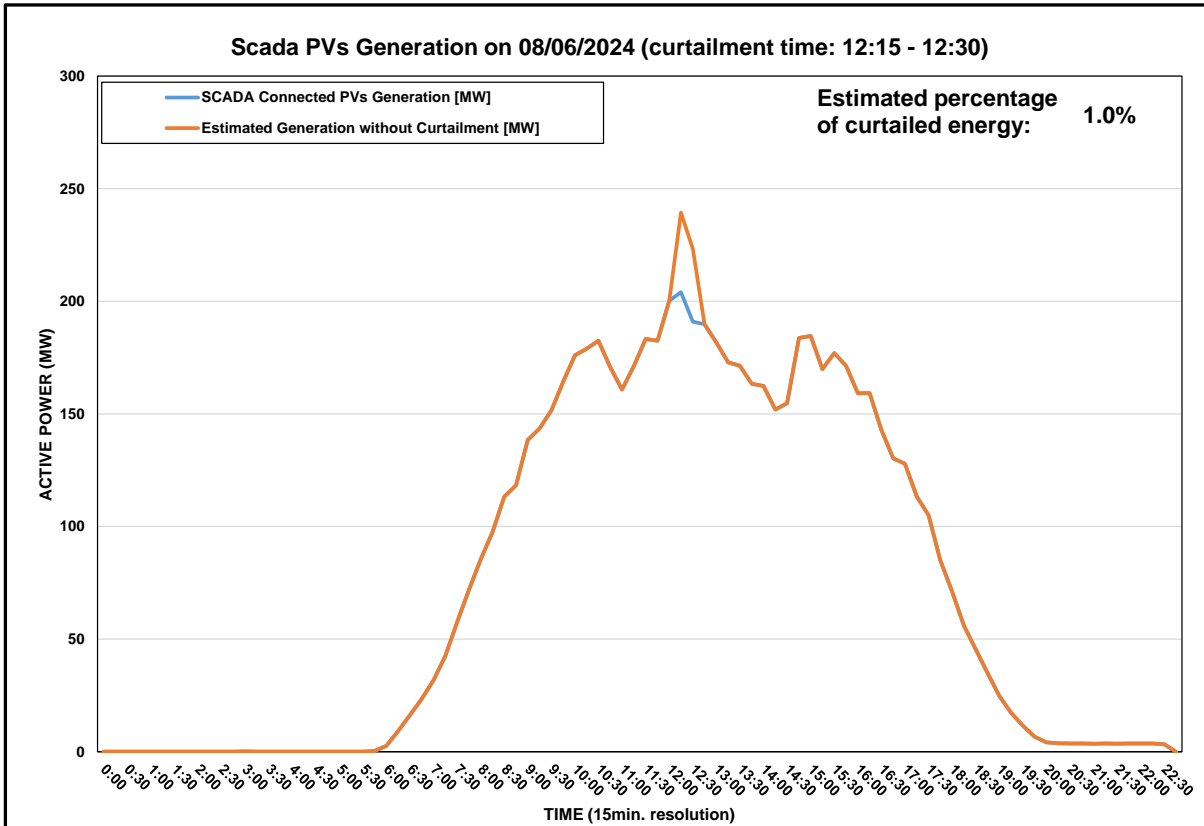


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	09/06/2024
Start of Curtailment	9:45
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1811.6 MWh
Total Estimated Curtailed Energy:	155 MWh
Percentage of Curtailed Energy	8.6%

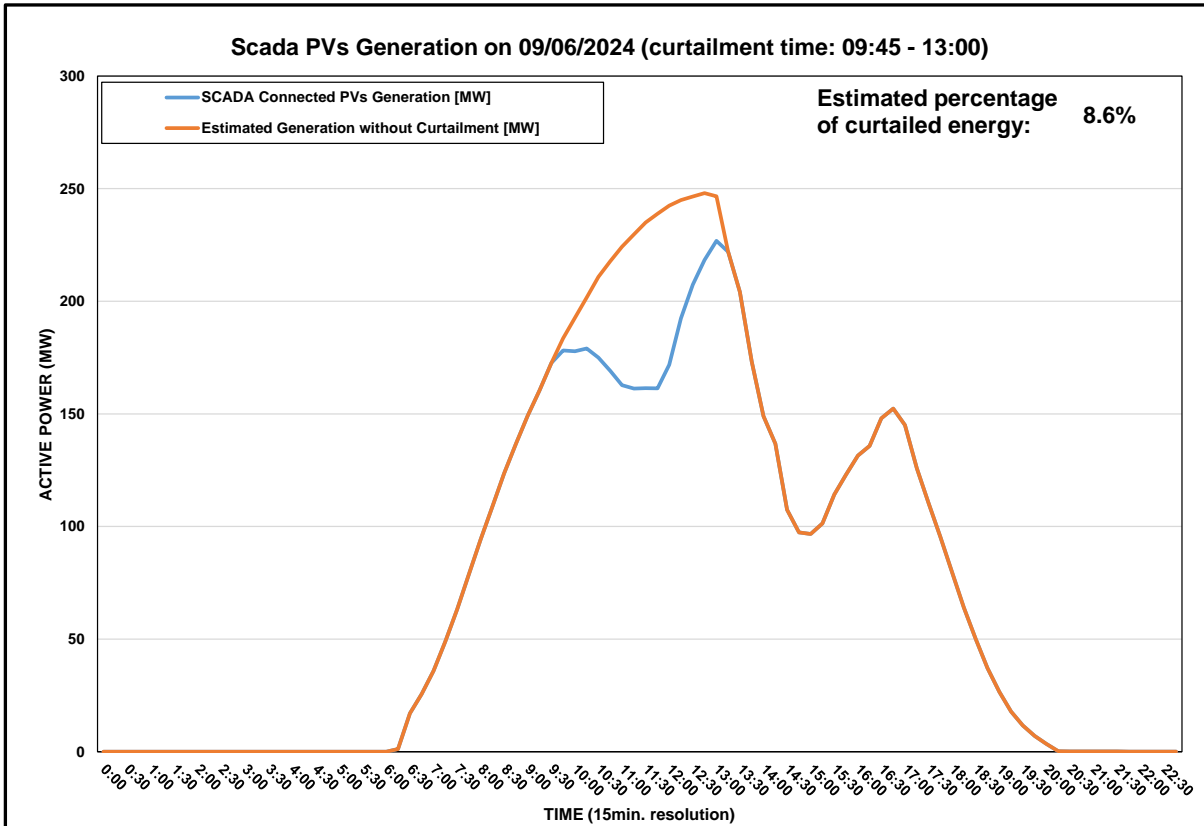


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	11/06/2024
Start of Curtailment	12:00
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2119.5 MWh
Total Estimated Curtailed Energy:	18.5 MWh
Percentage of Curtailed Energy	0.9%

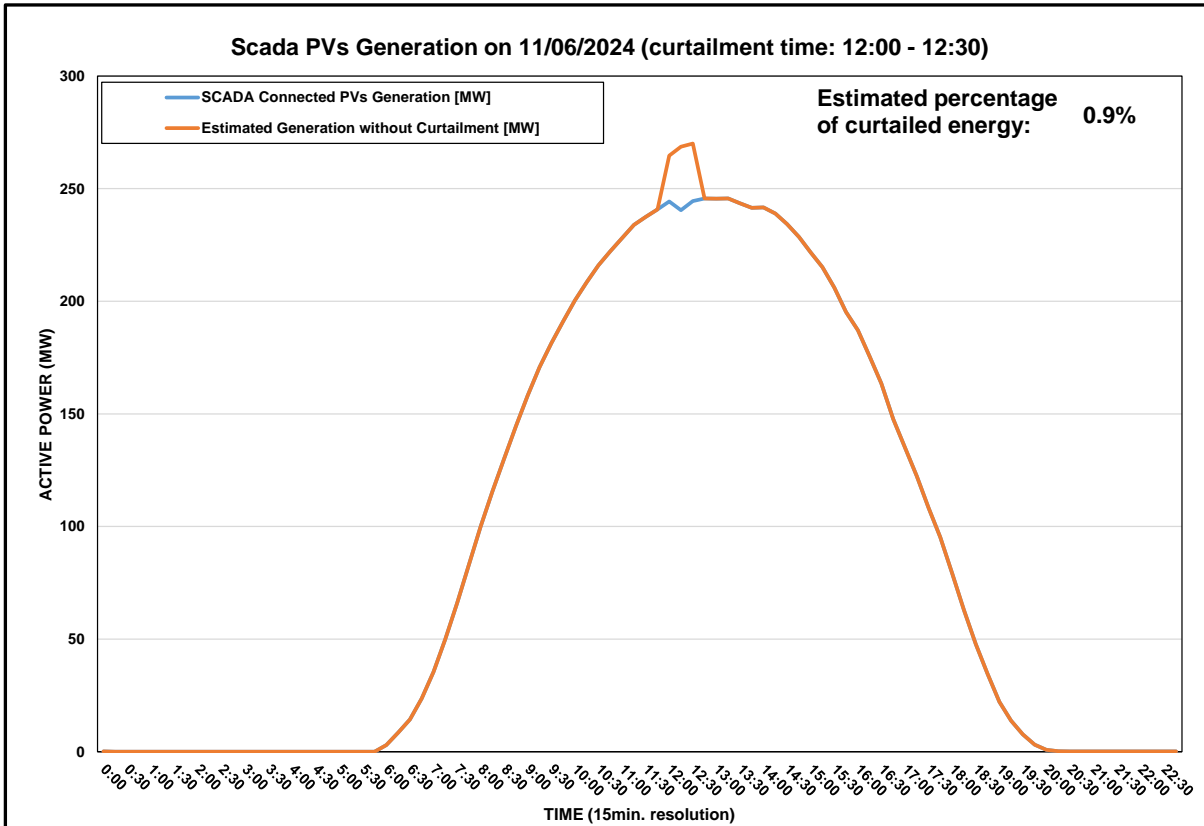


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	12/06/2024
Start of Curtailment	12:15
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction for protection of distribution line BERMS(J10) at S/S NEW MARI 132KV
Total Estimated Energy of the day:	2022.9 MWh
Total Estimated Curtailed Energy:	1.7 MWh
Percentage of Curtailed Energy	0.1%

Scada PVs Generation on 12/06/2024 (curtailment time: 12:15 - 13:45)

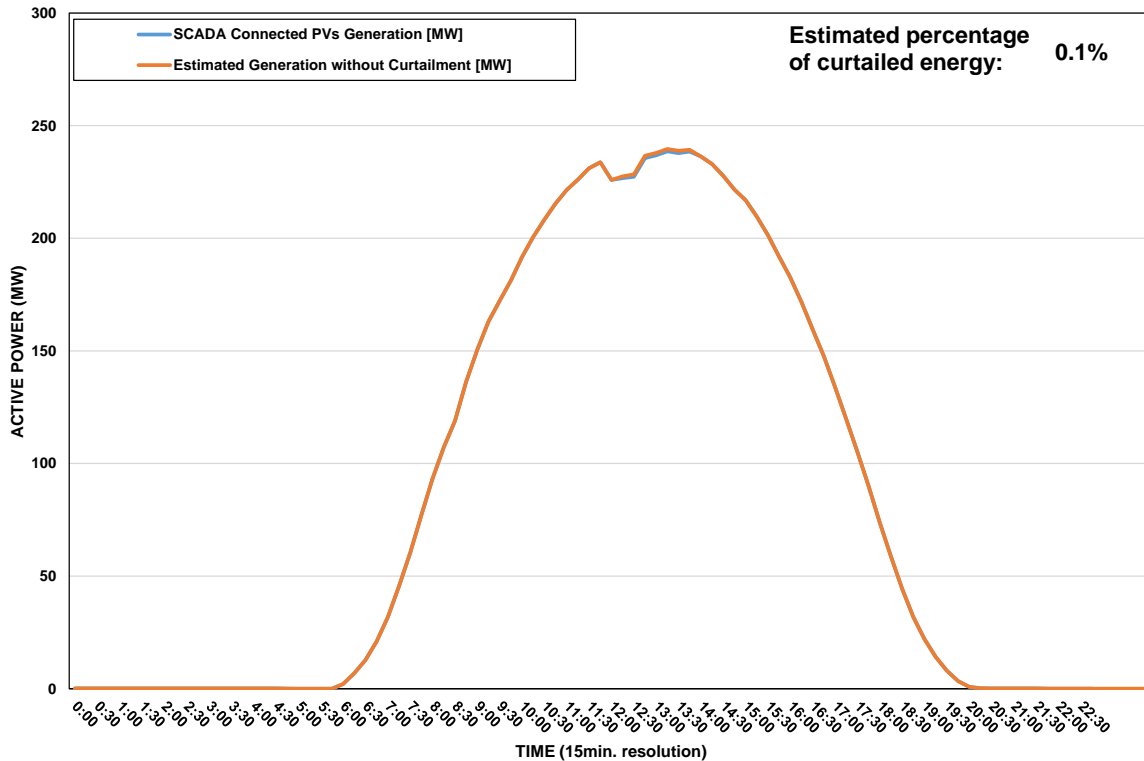


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	16/06/2024
Start of Curtailment	8:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2212.8 MWh
Total Estimated Curtailed Energy:	809.1 MWh
Percentage of Curtailed Energy	36.6%

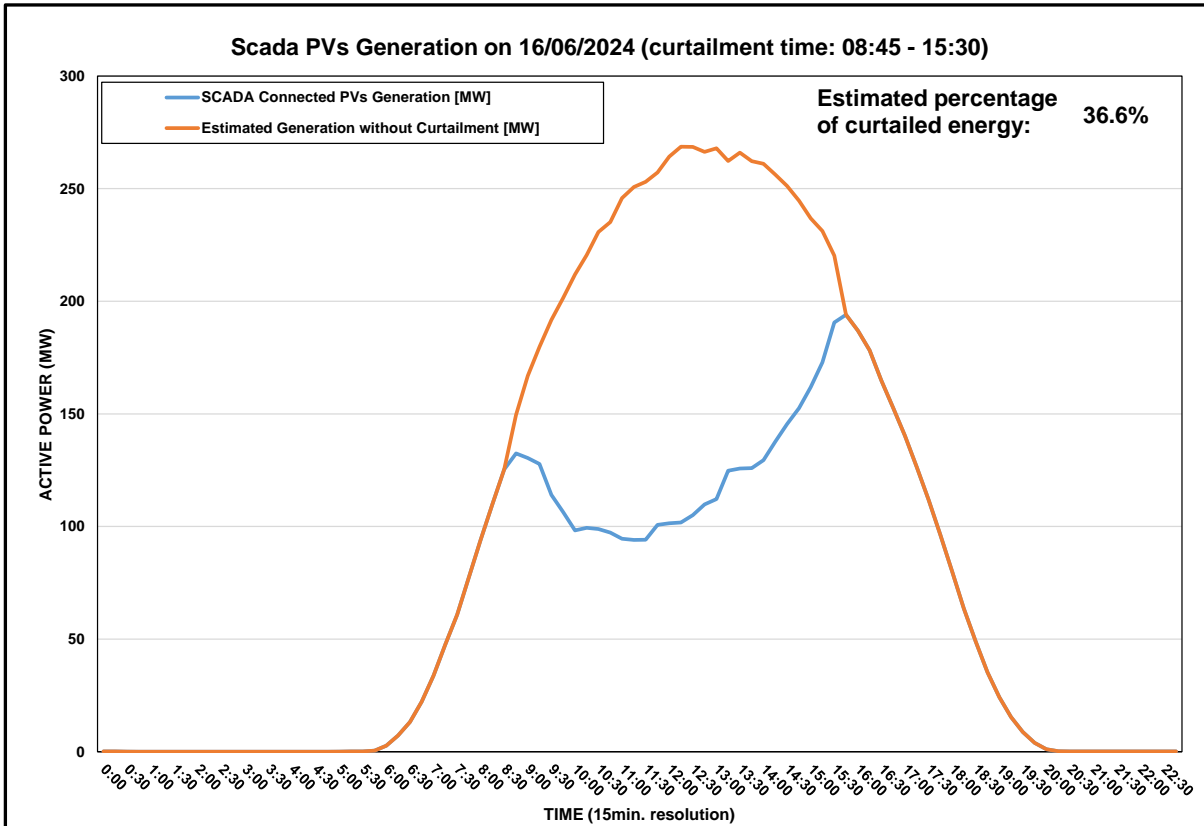


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	17/06/2024
Start of Curtailment	11:30
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2044.9 MWh
Total Estimated Curtailed Energy:	54.4 MWh
Percentage of Curtailed Energy	2.7%

Scada PVs Generation on 17/06/2024 (curtailment time: 11:30 - 13:30)

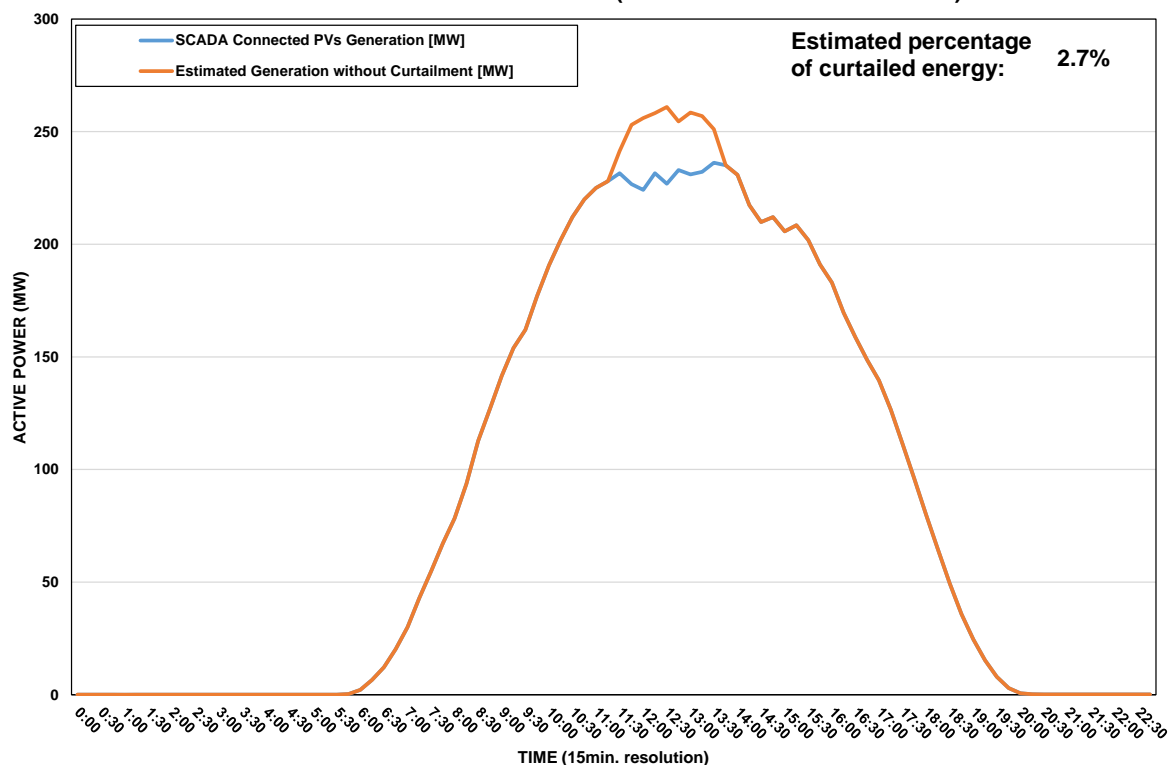


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	21/06/2024
Start of Curtailment	11:45
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2082.2 MWh
Total Estimated Curtailed Energy:	31.3 MWh
Percentage of Curtailed Energy	1.5%

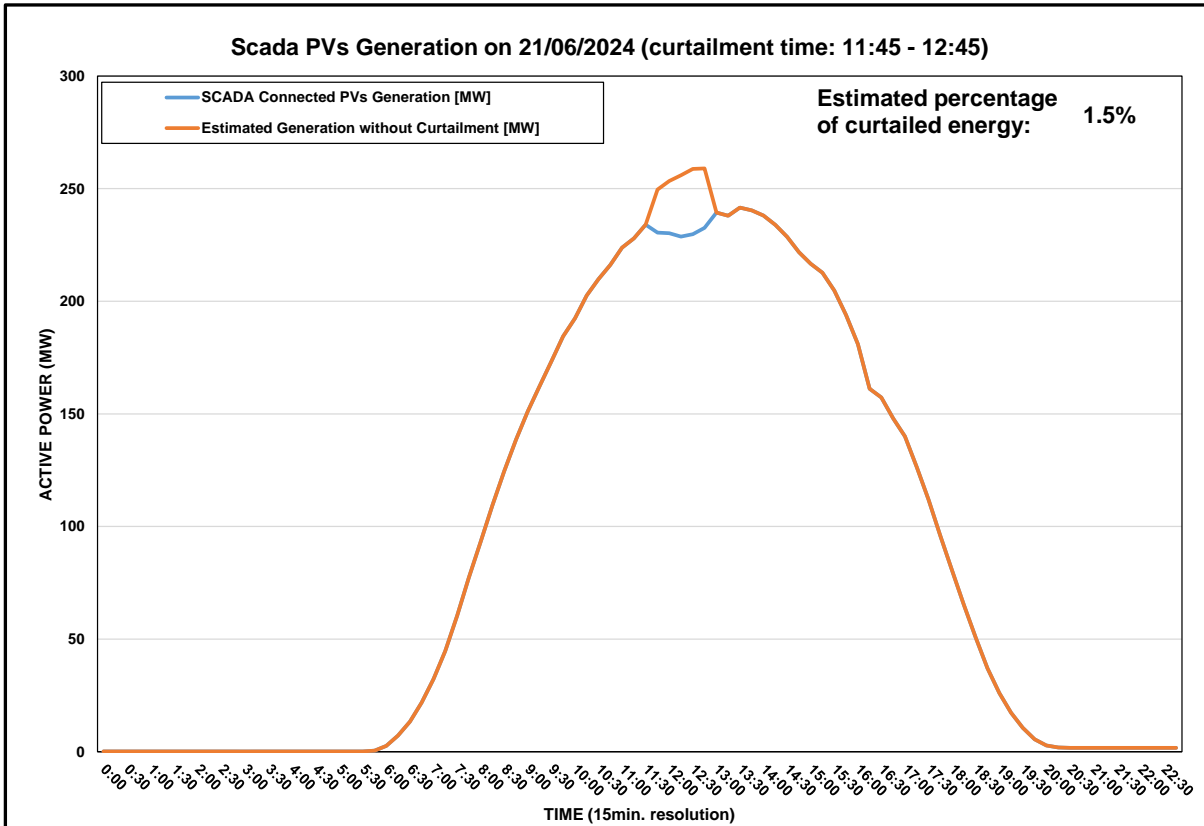


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	22/06/2024
Start of Curtailment	10:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2044.8 MWh
Total Estimated Curtailed Energy:	317.6 MWh
Percentage of Curtailed Energy	15.5%

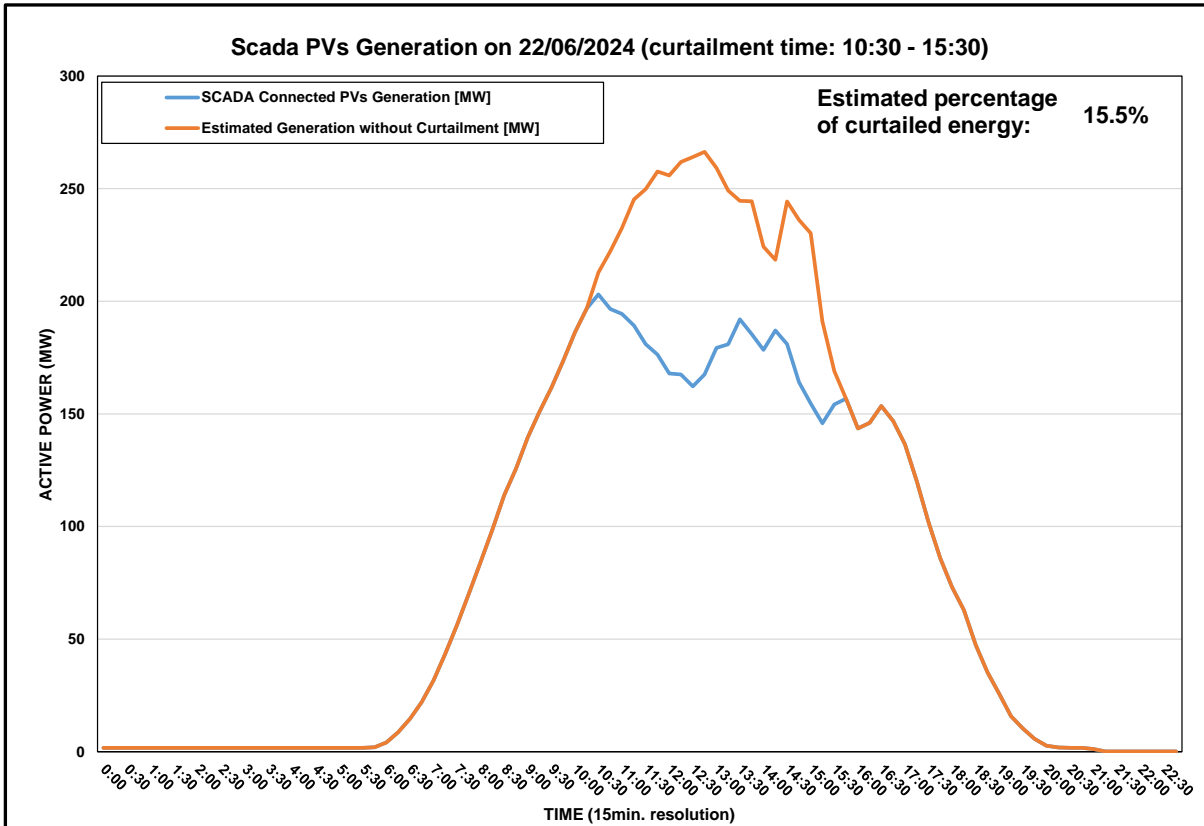


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	23/06/2024
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment	<i>RES-E Generation Restriction due to low loading of the electrical system</i>
Total Estimated Energy of the day:	2174.5 MWh
Total Estimated Curtailed Energy:	816.8 MWh
Percentage of Curtailed Energy	37.6%

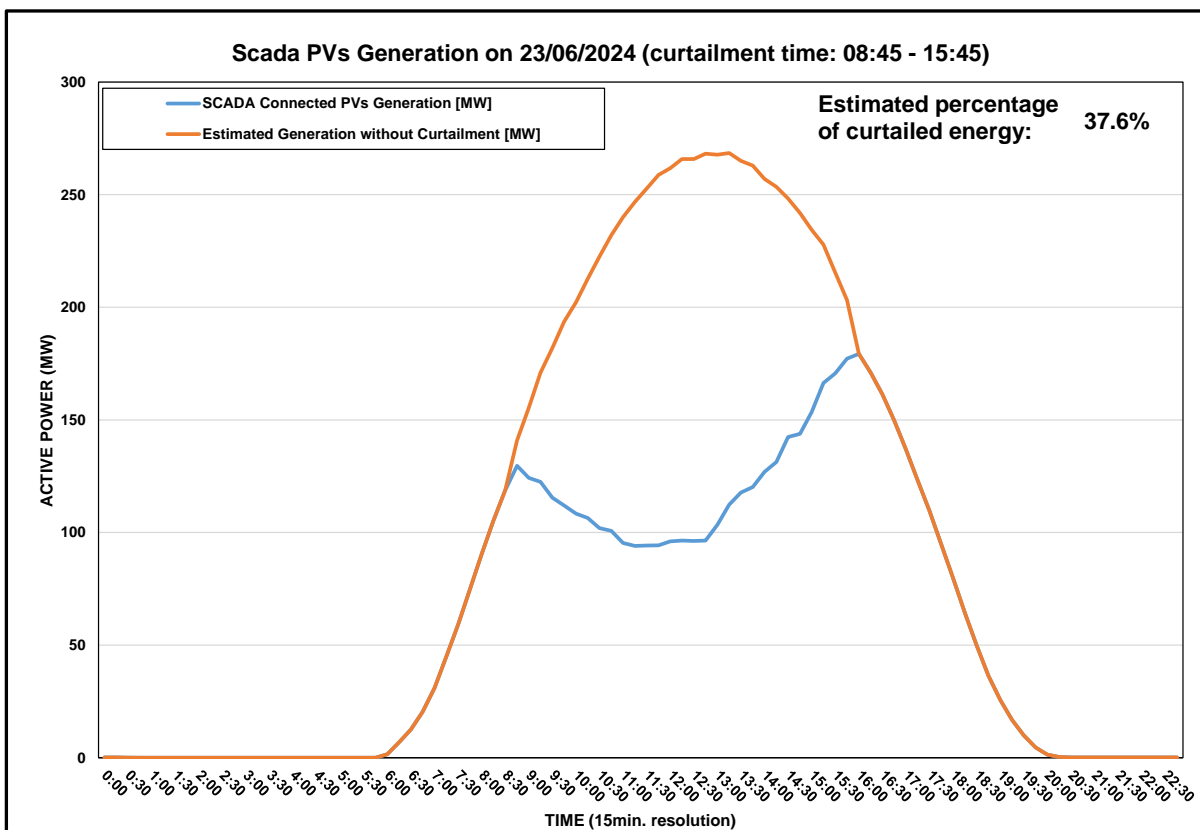


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	24/06/2024
Start of Curtailment	9:15
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2177.7 MWh
Total Estimated Curtailed Energy:	646.2 MWh
Percentage of Curtailed Energy	29.7%

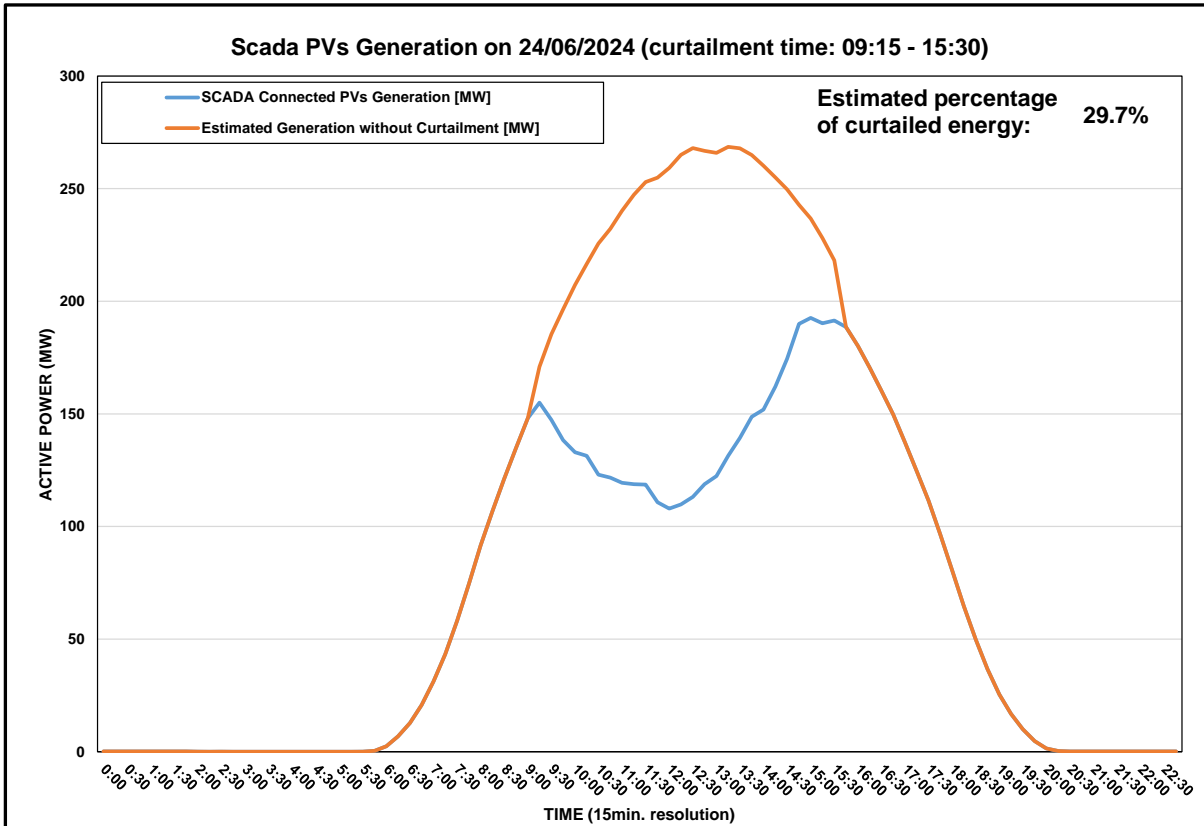


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	29/06/2024
Start of Curtailment	10:30
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1998.3 MWh
Total Estimated Curtailed Energy:	100 MWh
Percentage of Curtailed Energy	5.0%

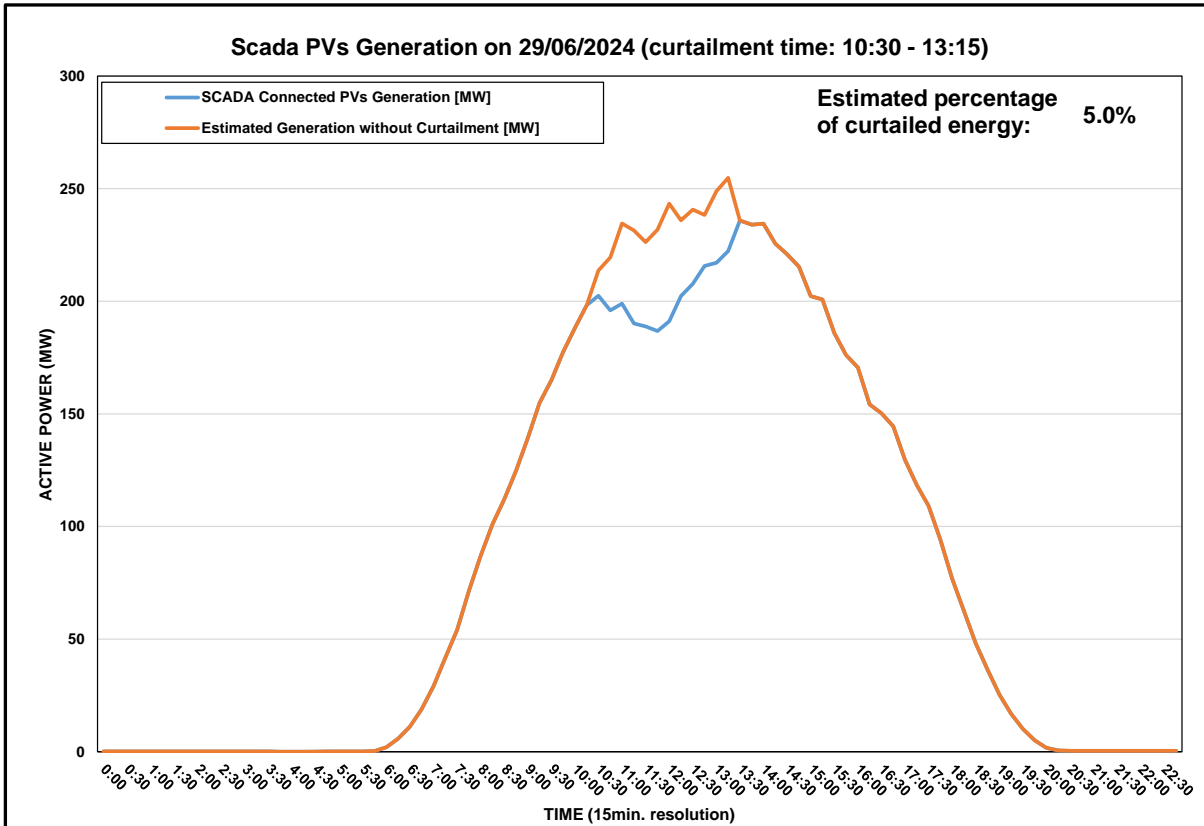

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Daily Curtailment Report of PV Generation

Date of Curtailment	30/06/2024
Start of Curtailment	9:45
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2118.9 MWh
Total Estimated Curtailed Energy:	278.7 MWh
Percentage of Curtailed Energy	13.2%

