


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	01/06/2025	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment	8:00	Cut-off areas using RIPPLE: NIC 2, LAR 2 Cut-off areas using IoT: PV-NIC2, PV-NIC4, PV-LCA/FAM1
End of Curtailment	17:15	
Instruction from TSOC	YES	Start of cut-off: 10:15 End of cut-off: 16:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2243.1 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 174MWh
Total Estimated Curtailed Energy:	1650.5 MWh	Total Est. Energy of the cut-off PV systems using IoT: 111.2MWh
Percentage of Curtailed Energy:	73.6%	

Scada PVs Generation on 01/06/2025 (curtailment time: 08:00 - 17:15)

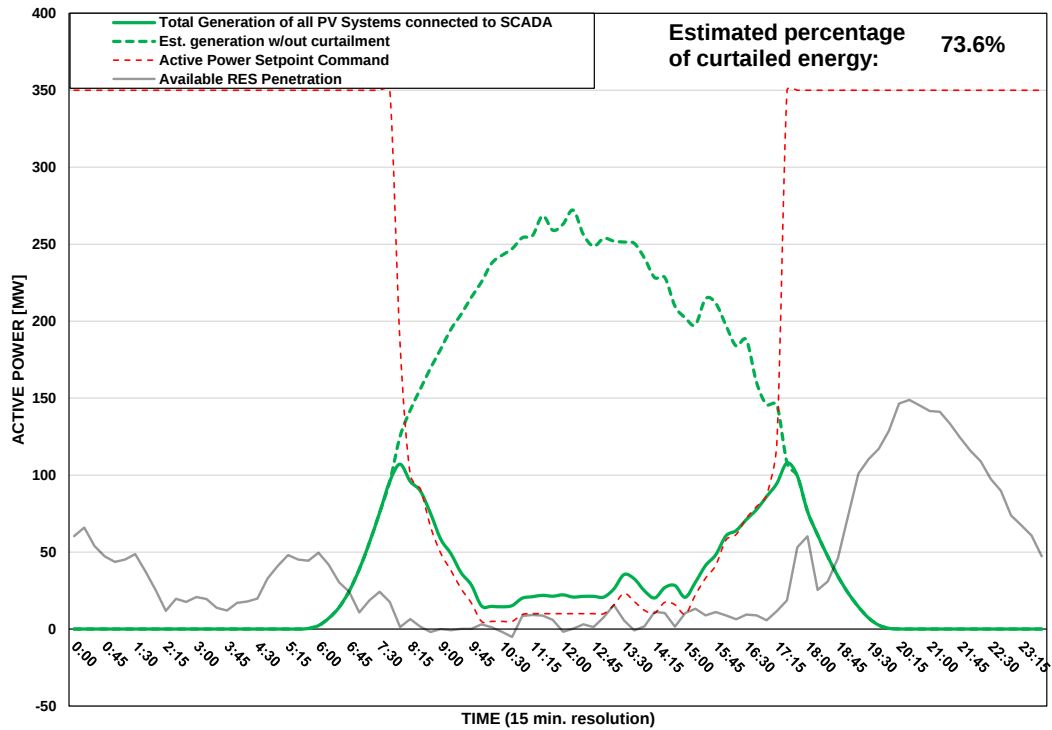

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	02/06/2025
Start of Curtailment	9:15
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2264 MWh
Total Estimated Curtailed Energy:	971.6 MWh
Percentage of Curtailed Energy:	42.9%

Scada PVs Generation on 02/06/2025 (curtailment time: 09:15 - 17:00)

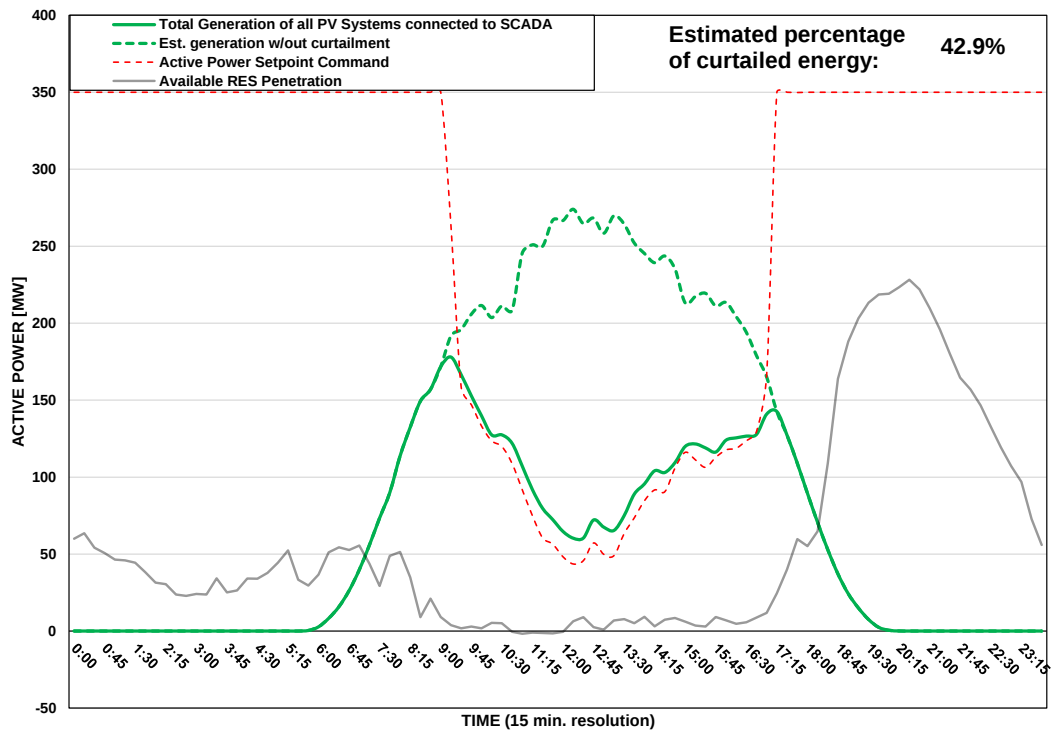


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	03/06/2025
Start of Curtailment	9:00
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2454.8 MWh
Total Estimated Curtailed Energy:	1099.3 MWh
Percentage of Curtailed Energy:	44.8%

Scada PVs Generation on 03/06/2025 (curtailment time: 09:00 - 16:30)

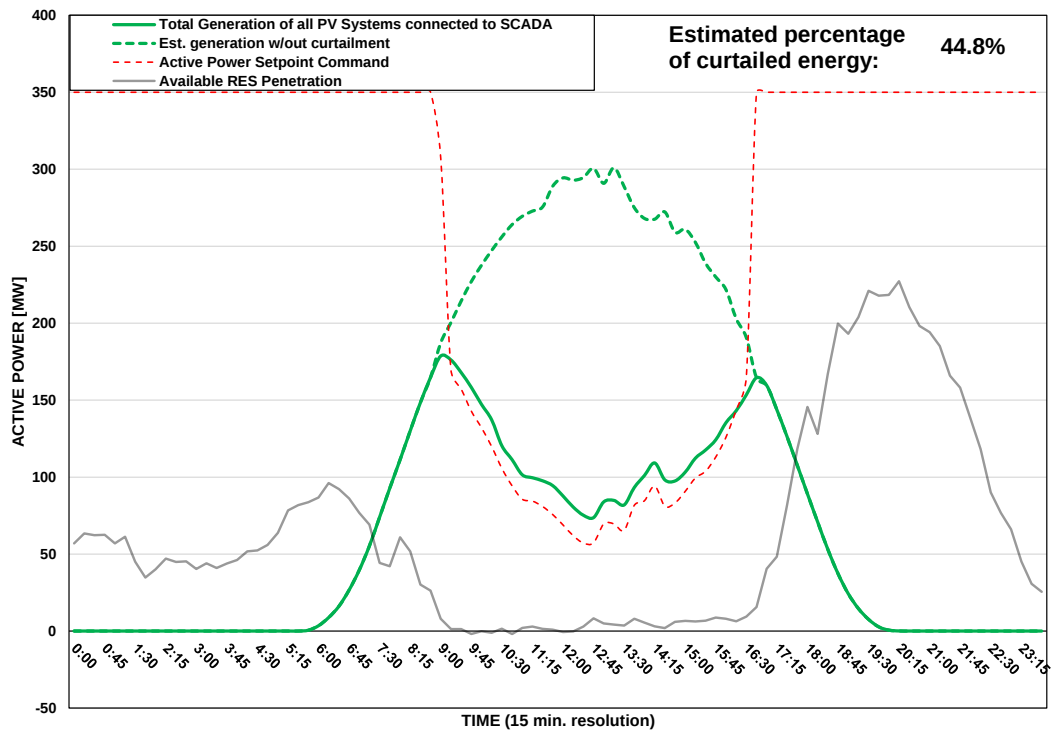


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	04/06/2025
Start of Curtailment	8:45
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2475 MWh
Total Estimated Curtailed Energy:	1090.6 MWh
Percentage of Curtailed Energy:	44.1%

Scada PVs Generation on 04/06/2025 (curtailment time: 08:45 - 16:30)

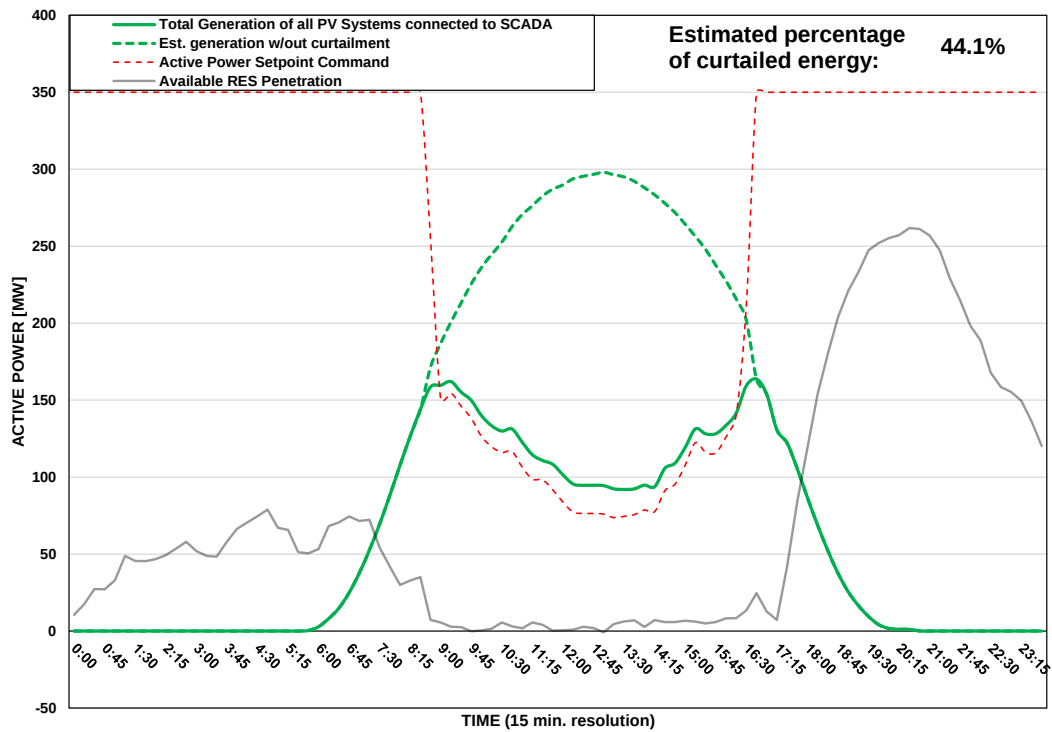

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	05/06/2025
Start of Curtailment	9:15
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2438.6 MWh
Total Estimated Curtailed Energy:	961.8 MWh
Percentage of Curtailed Energy:	39.4%

Scada PVs Generation on 05/06/2025 (curtailment time: 09:15 - 16:15)

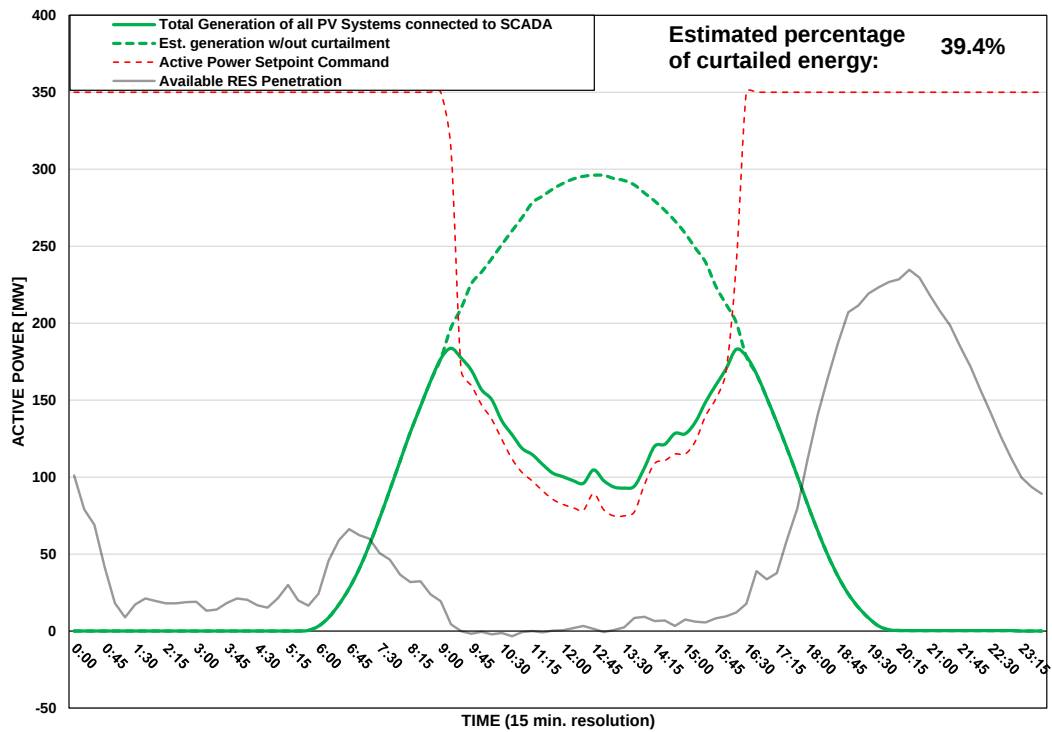


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	06/06/2025
Start of Curtailment	9:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2407.2 MWh
Total Estimated Curtailed Energy:	974 MWh
Percentage of Curtailed Energy:	40.5%

Scada PVs Generation on 06/06/2025 (curtailment time: 09:15 - 16:30)

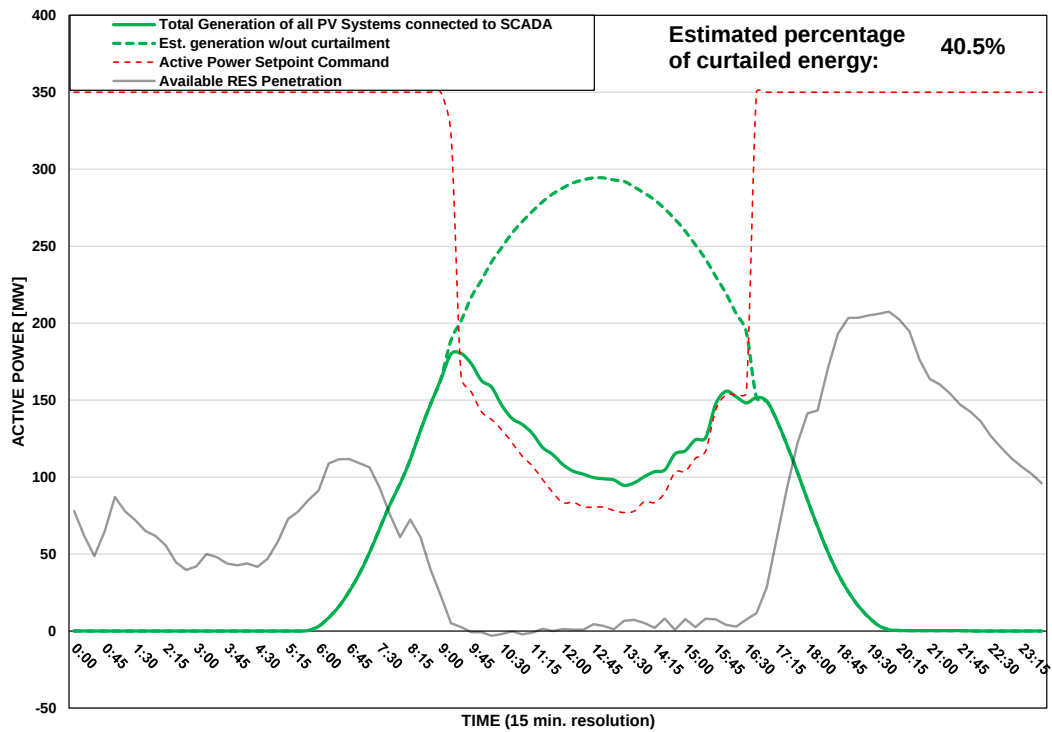


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	07/06/2025
Start of Curtailment	8:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2429.4 MWh
Total Estimated Curtailed Energy:	1390.1 MWh
Percentage of Curtailed Energy:	57.2%

Scada PVs Generation on 07/06/2025 (curtailment time: 08:30 - 16:15)

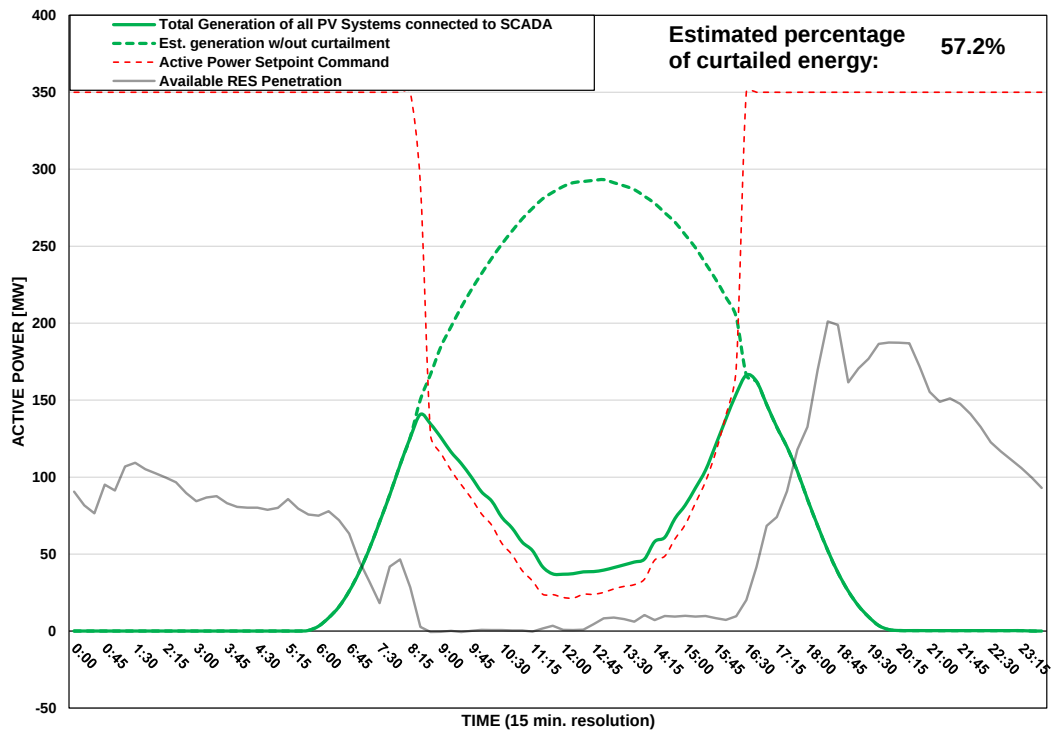

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	08/06/2025	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment	8:00	Cut-off areas using RIPPLE: LAR 1, LIM 1, PAF 1 Cut-off areas using IoT: PV-LCA/FAM1
End of Curtailment	17:00	
Instruction from TSOC	YES	Start of cut-off: 10:00 End of cut-off: 15:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2392.7 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 195.4MWh
Total Estimated Curtailed Energy:	1809.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 75.9MWh
Percentage of Curtailed Energy:	75.6%	

Scada PVs Generation on 08/06/2025 (curtailment time: 08:00 - 17:00)

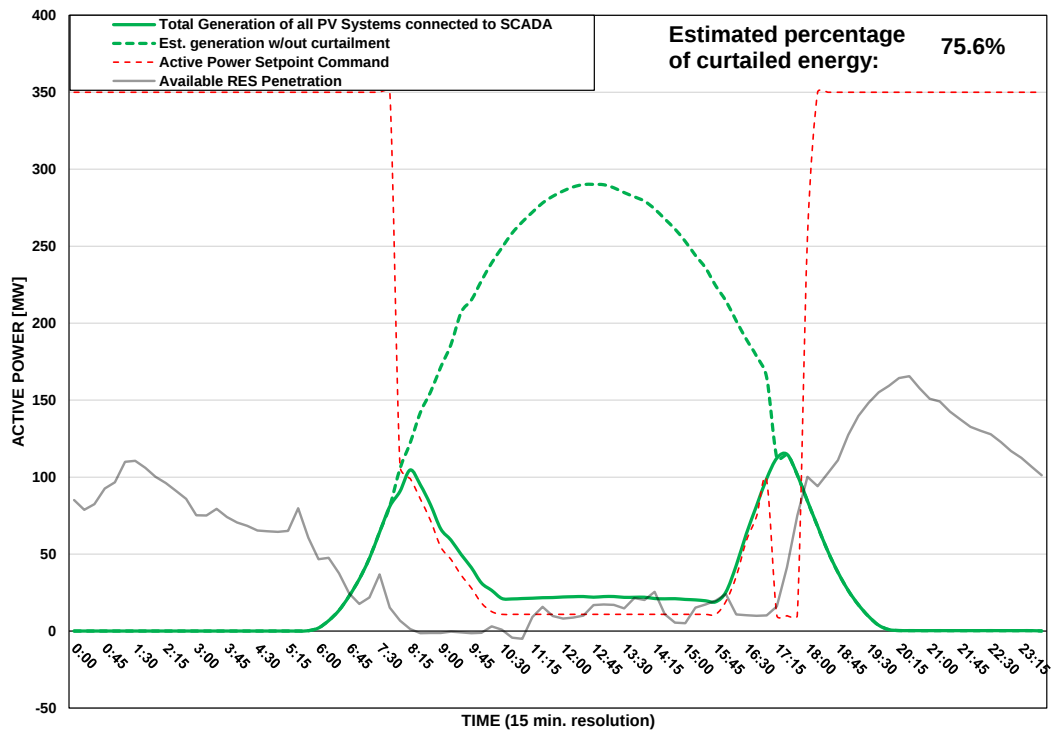


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	09/06/2025	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment	7:15	Cut-off areas using RIPPLE: LAR 1, LIM 1, PAF 1, PAF 2 Cut-off areas using IoT: PV-LCA/FAM3, PV-LIM3, PV-PAF1, PV-PAF3
End of Curtailment	16:30	
Instruction from TSOC	YES	Start of cut-off: 09:45 End of cut-off: 17:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2424.8 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 333.4MWh
Total Estimated Curtailed Energy:	1680.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 128.9MWh
Percentage of Curtailed Energy:	69.3%	

Scada PVs Generation on 09/06/2025 (curtailment time: 07:15 - 16:30)

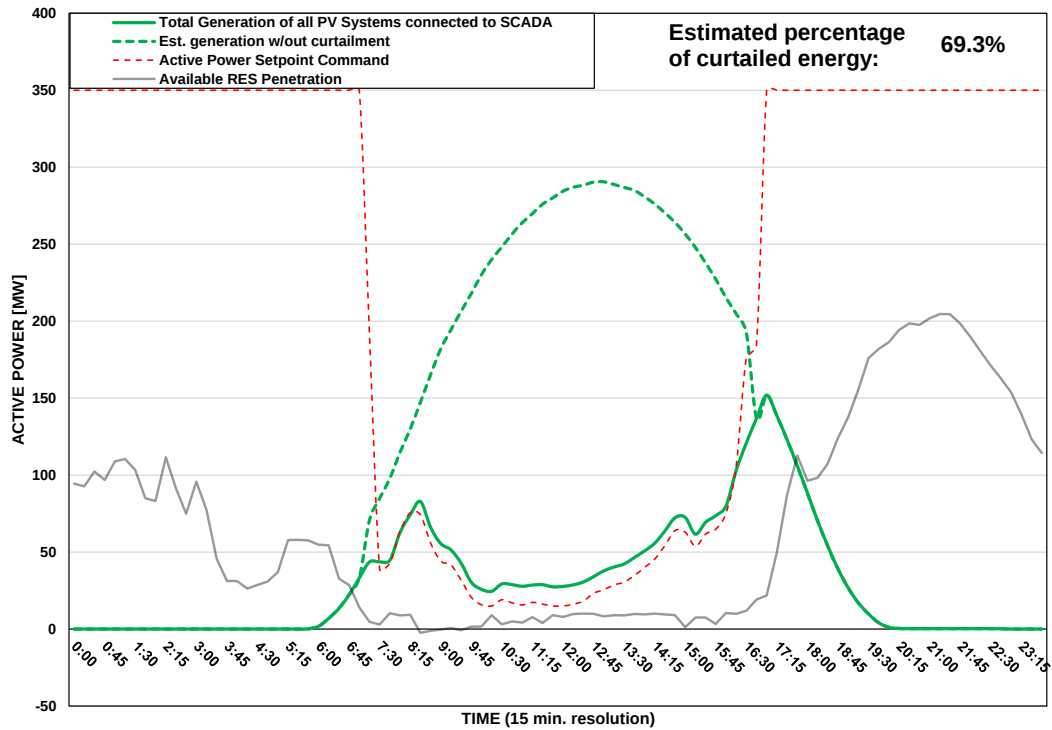

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	10/06/2025
Start of Curtailment	9:45
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2391.1 MWh
Total Estimated Curtailed Energy:	581.4 MWh
Percentage of Curtailed Energy:	24.3%

Scada PVs Generation on 10/06/2025 (curtailment time: 09:45 - 15:15)

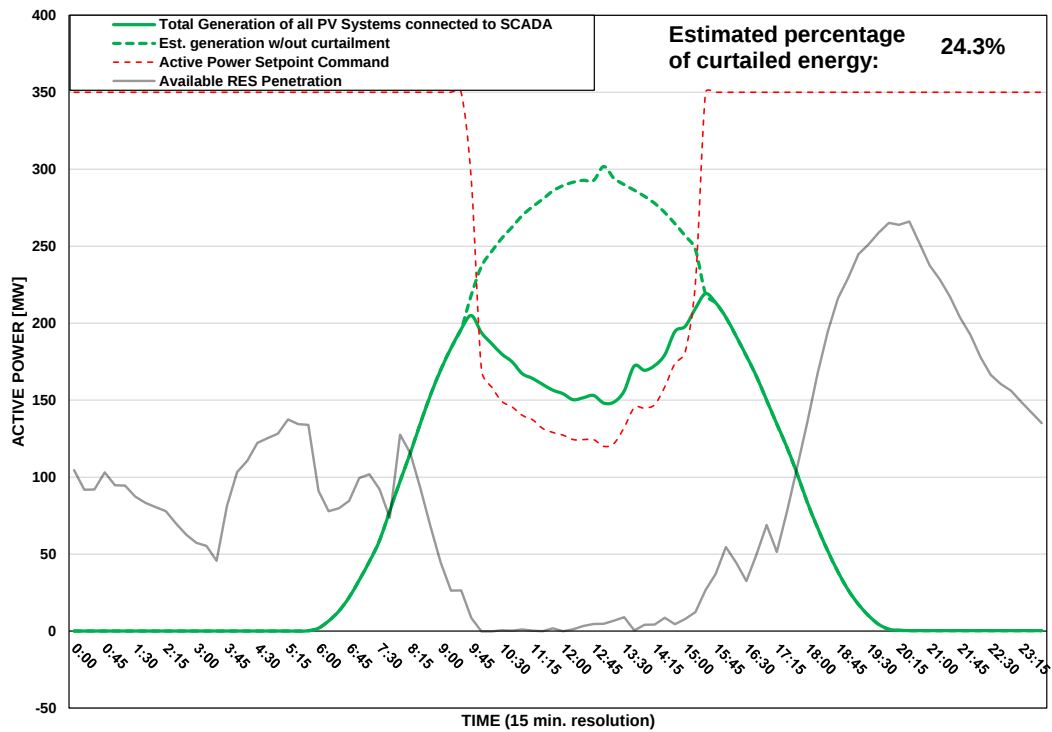

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	11/06/2025
Start of Curtailment	10:30
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2340.8 MWh
Total Estimated Curtailed Energy:	263.3 MWh
Percentage of Curtailed Energy:	11.2%

Scada PVs Generation on 11/06/2025 (curtailment time: 10:30 - 14:15)

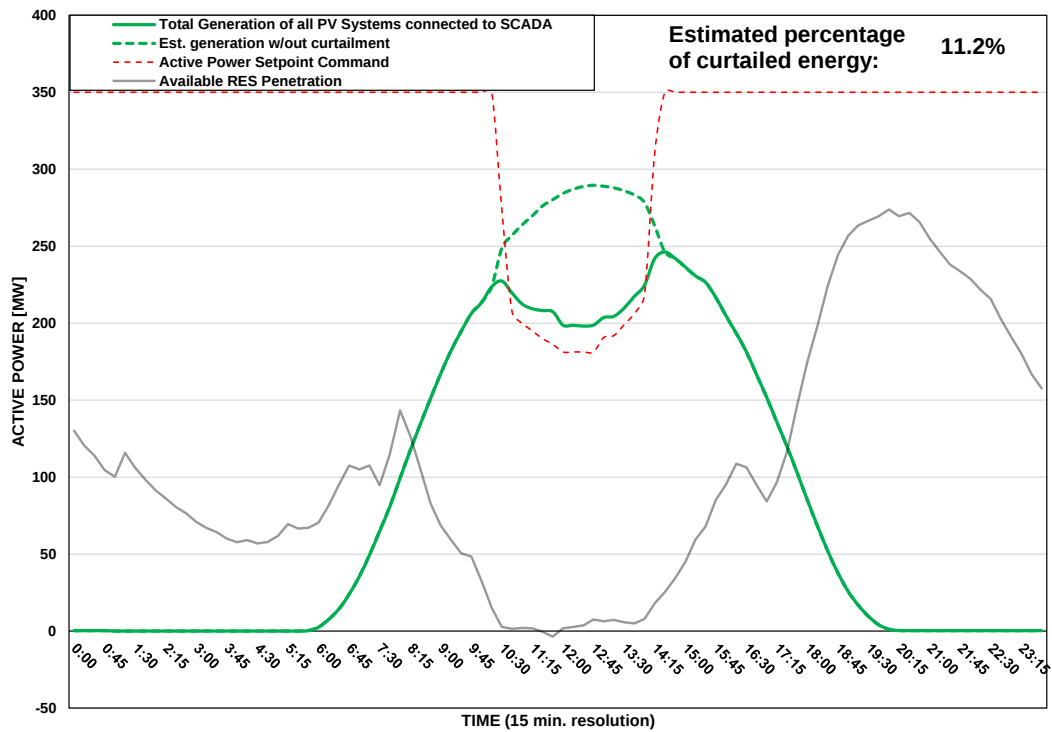

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	12/06/2025
Start of Curtailment	9:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2340.7 MWh
Total Estimated Curtailed Energy:	611.3 MWh
Percentage of Curtailed Energy:	26.1%

Scada PVs Generation on 12/06/2025 (curtailment time: 09:30 - 15:30)

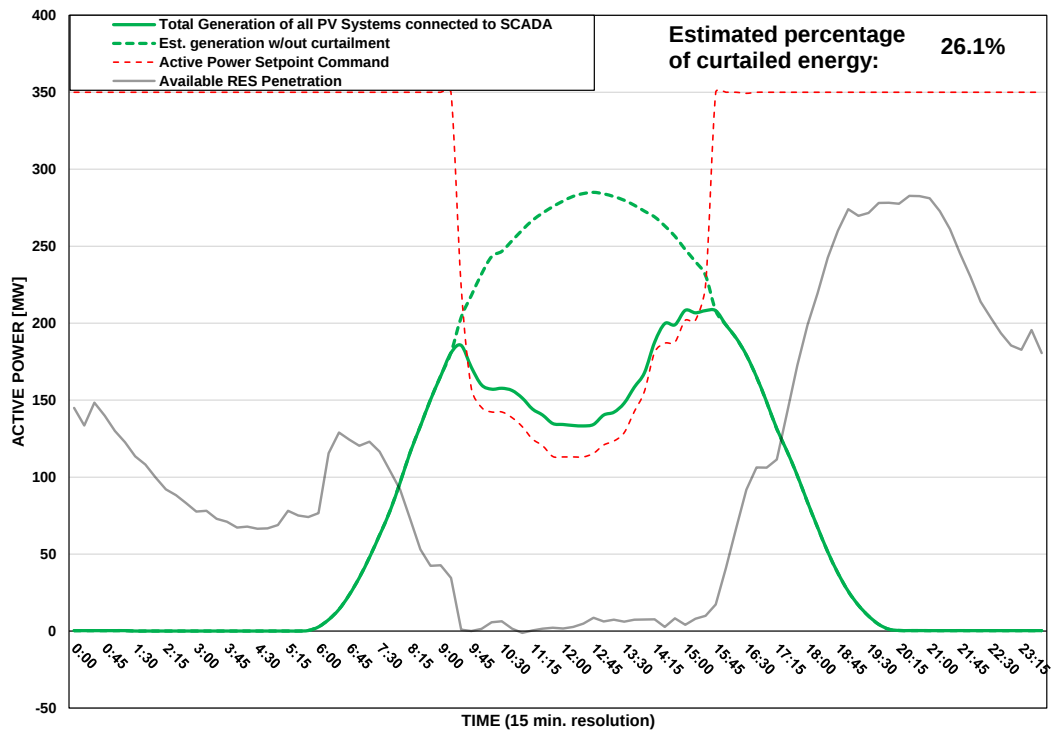


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	13/06/2025
Start of Curtailment	10:15
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2329.5 MWh
Total Estimated Curtailed Energy:	455 MWh
Percentage of Curtailed Energy:	19.5%

Scada PVs Generation on 13/06/2025 (curtailment time: 10:15 - 15:15)

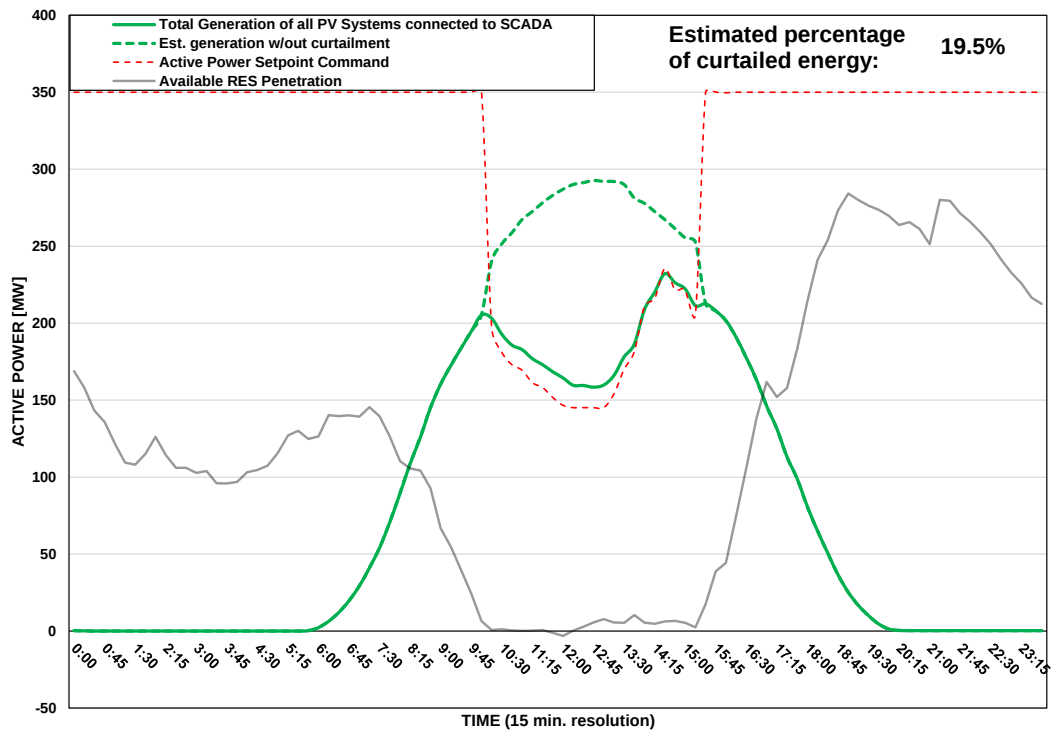

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	14/06/2025
Start of Curtailment	9:30
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2377.3 MWh
Total Estimated Curtailed Energy:	789.9 MWh
Percentage of Curtailed Energy:	33.2%

Scada PVs Generation on 14/06/2025 (curtailment time: 09:30 - 15:45)

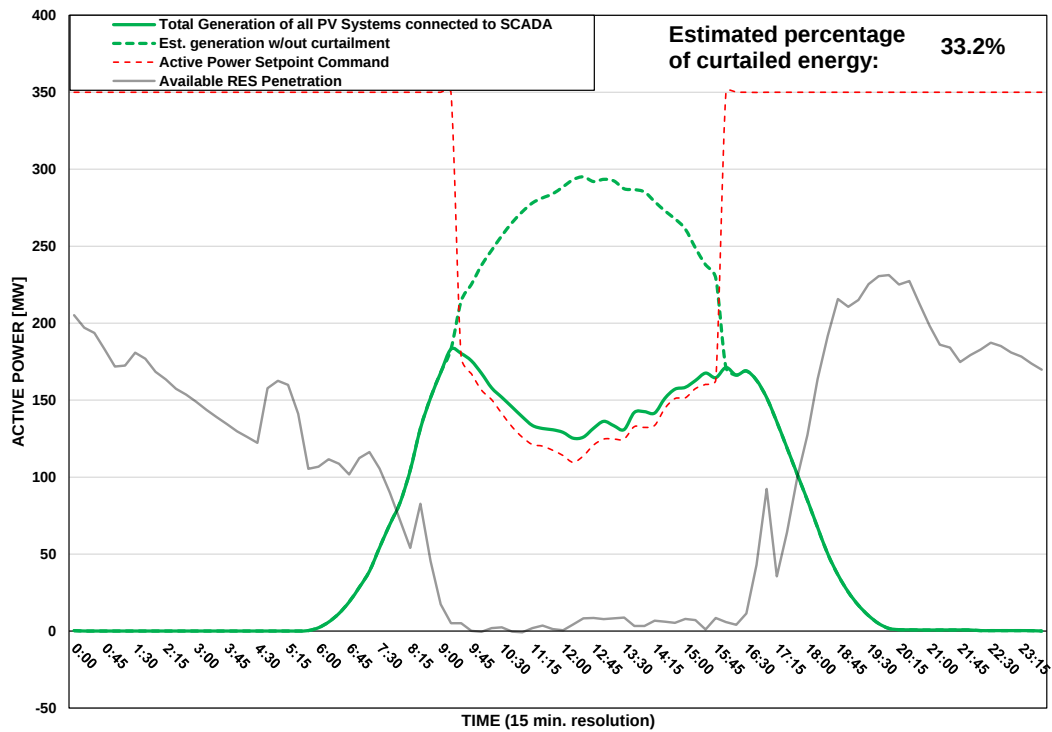

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	15/06/2025
Start of Curtailment	9:00
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2072.1 MWh
Total Estimated Curtailed Energy:	818.3 MWh
Percentage of Curtailed Energy:	39.5%

Scada PVs Generation on 15/06/2025 (curtailment time: 09:00 - 14:30)

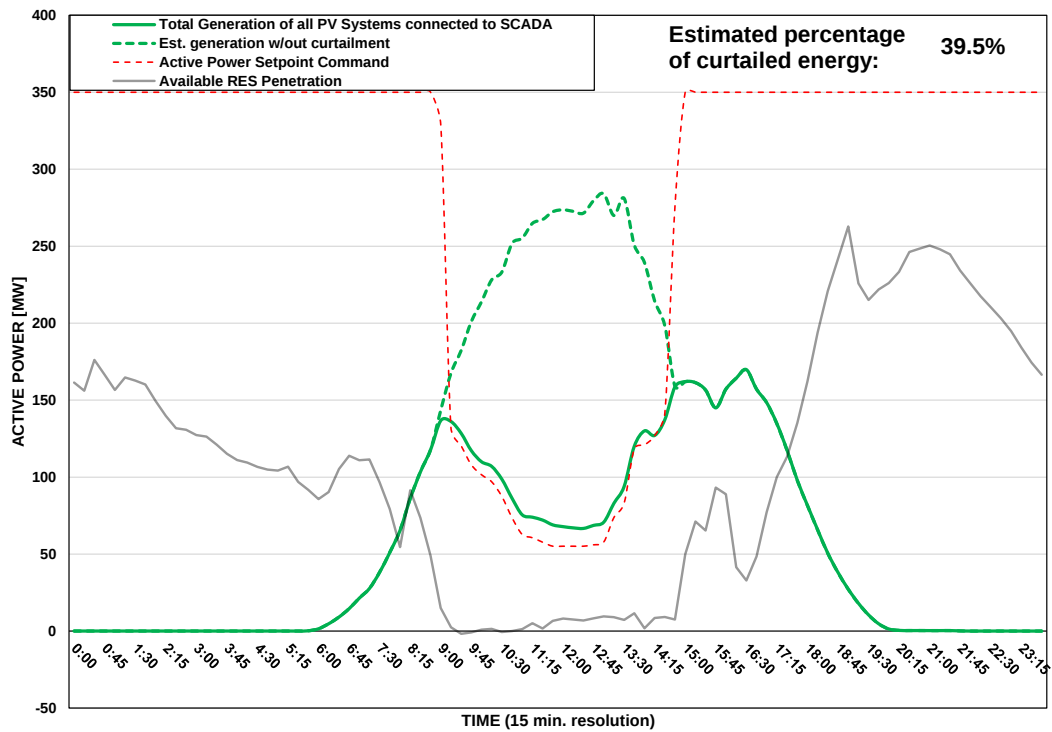


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	16/06/2025
Start of Curtailment	11:00
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2162.9 MWh
Total Estimated Curtailed Energy:	111 MWh
Percentage of Curtailed Energy:	5.1%

Scada PVs Generation on 16/06/2025 (curtailment time: 11:00 - 13:45)

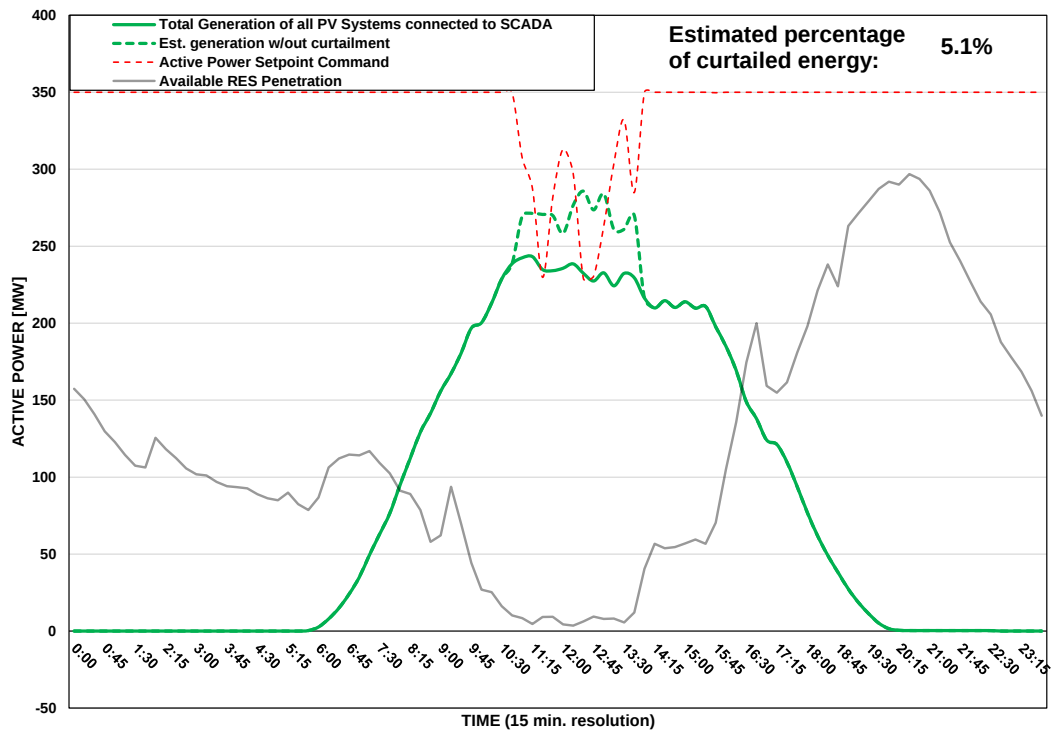

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	17/06/2025
Start of Curtailment	15:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1721.8 MWh
Total Estimated Curtailed Energy:	86.4 MWh
Percentage of Curtailed Energy:	5.0%

Scada PVs Generation on 17/06/2025 (curtailment time: 15:00 - 16:00)

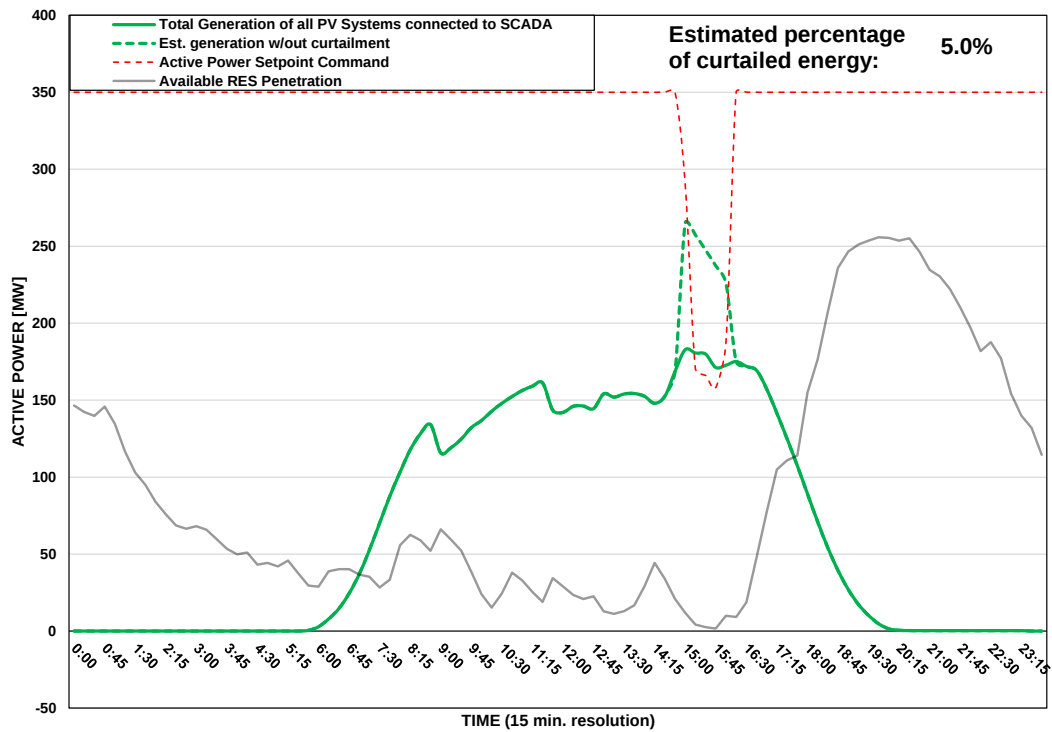


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	18/06/2025
Start of Curtailment	9:45
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2474.2 MWh
Total Estimated Curtailed Energy:	764.8 MWh
Percentage of Curtailed Energy:	30.9%

Scada PVs Generation on 18/06/2025 (curtailment time: 09:45 - 16:15)

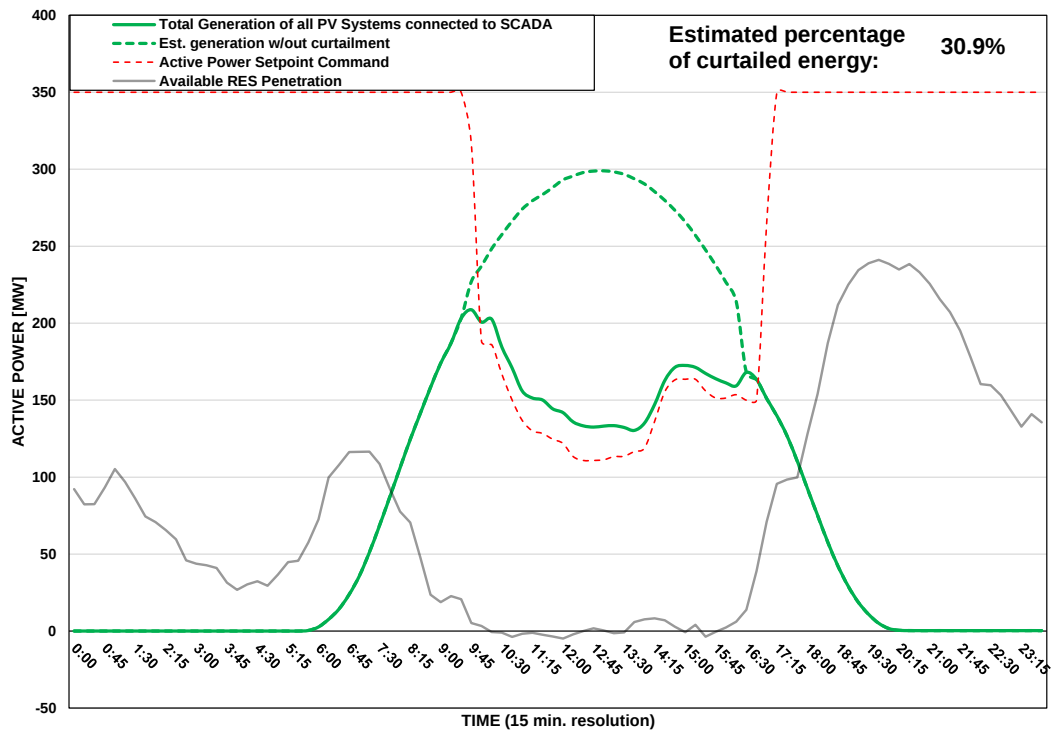


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/06/2025
Start of Curtailment	10:30
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2412 MWh
Total Estimated Curtailed Energy:	256.5 MWh
Percentage of Curtailed Energy:	10.6%

Scada PVs Generation on 19/06/2025 (curtailment time: 10:30 - 14:00)

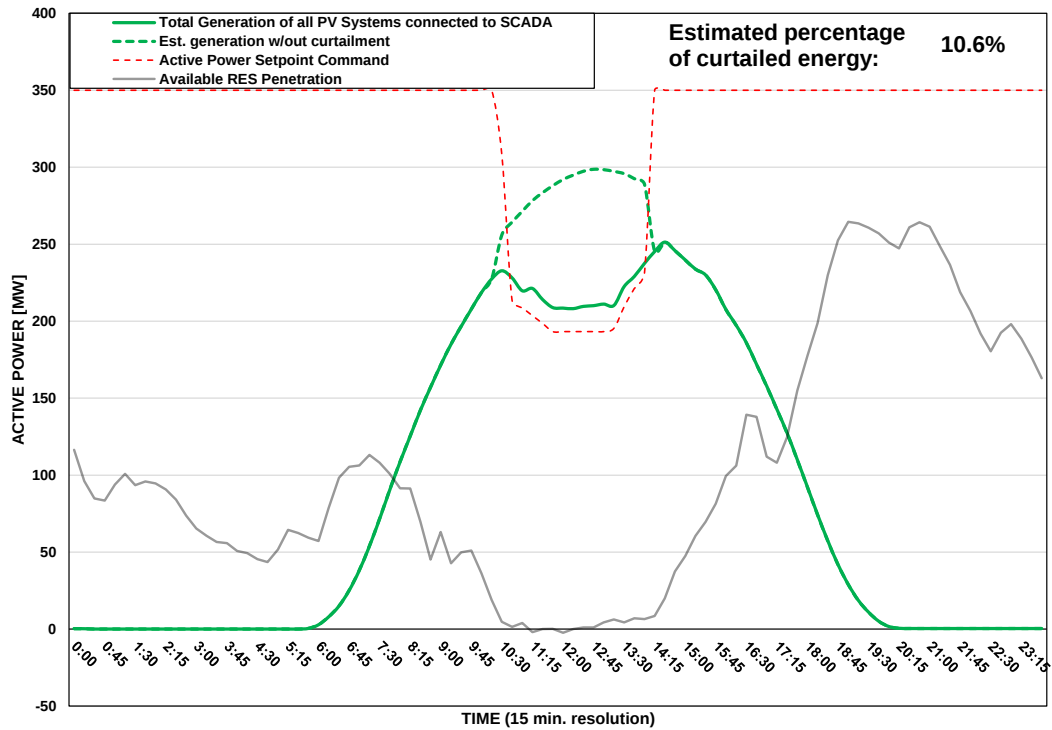


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	20/06/2025
Start of Curtailment	11:00
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2392 MWh
Total Estimated Curtailed Energy:	144.6 MWh
Percentage of Curtailed Energy:	6.0%

Scada PVs Generation on 20/06/2025 (curtailment time: 11:00 - 13:30)

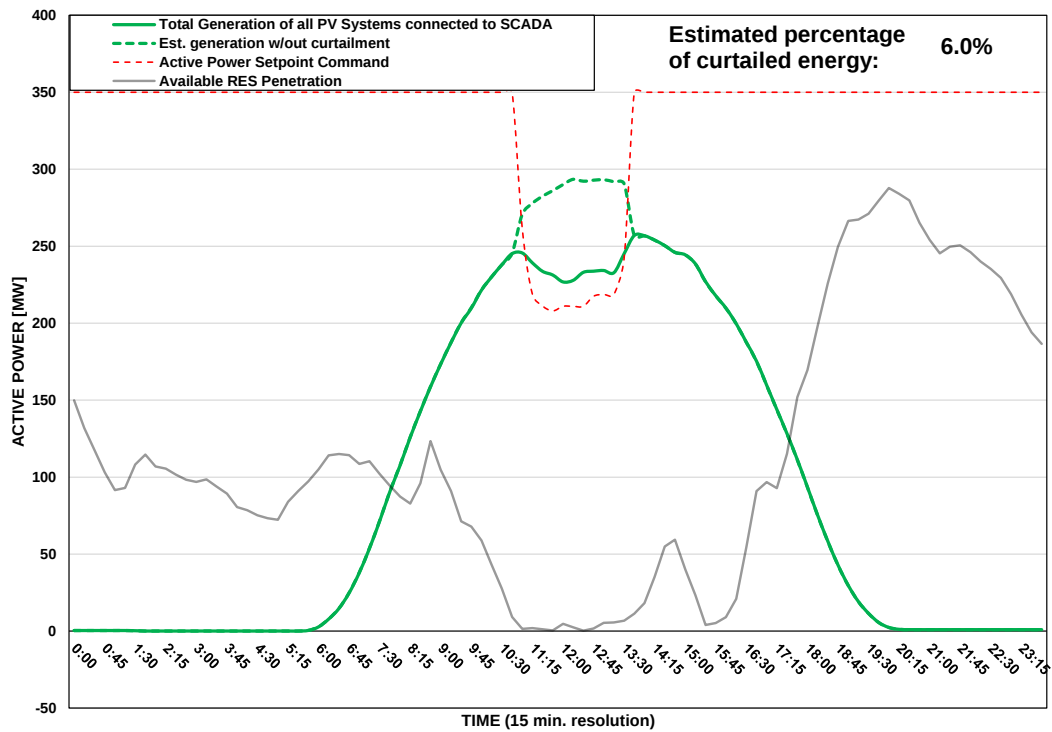


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	21/06/2025
Start of Curtailment	9:45
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2367.1 MWh
Total Estimated Curtailed Energy:	486.4 MWh
Percentage of Curtailed Energy:	20.5%

Scada PVs Generation on 21/06/2025 (curtailment time: 09:45 - 16:00)

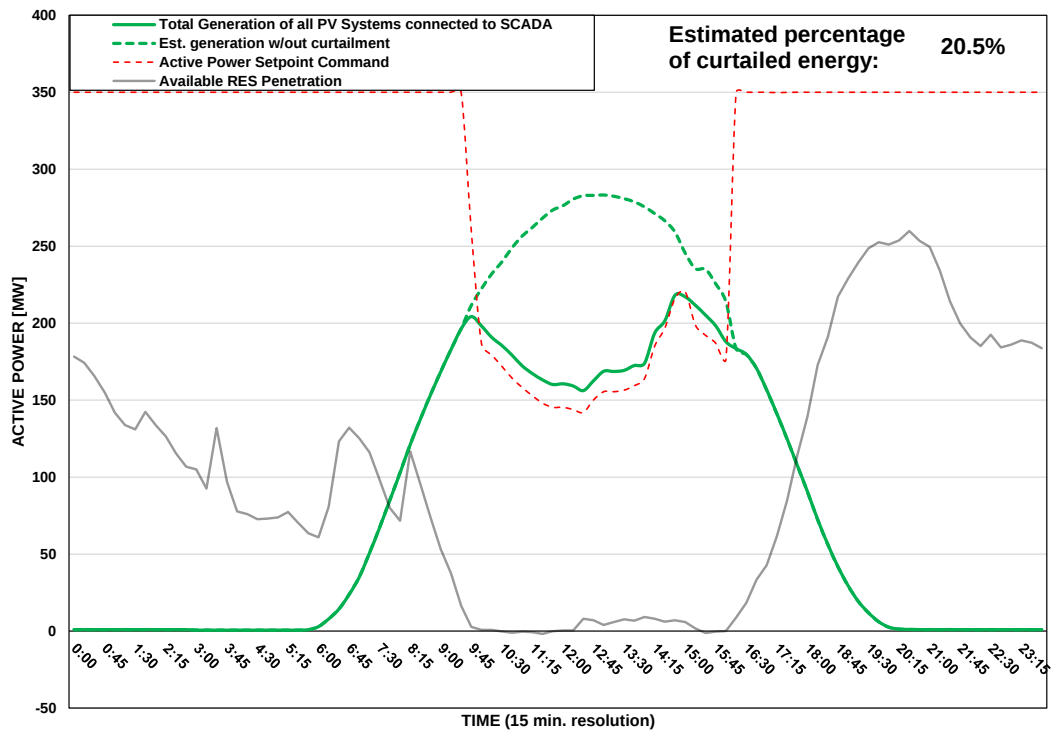


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	22/06/2025
Start of Curtailment	8:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2375.8 MWh
Total Estimated Curtailed Energy:	1113.7 MWh
Percentage of Curtailed Energy:	46.9%

Scada PVs Generation on 22/06/2025 (curtailment time: 08:30 - 16:00)

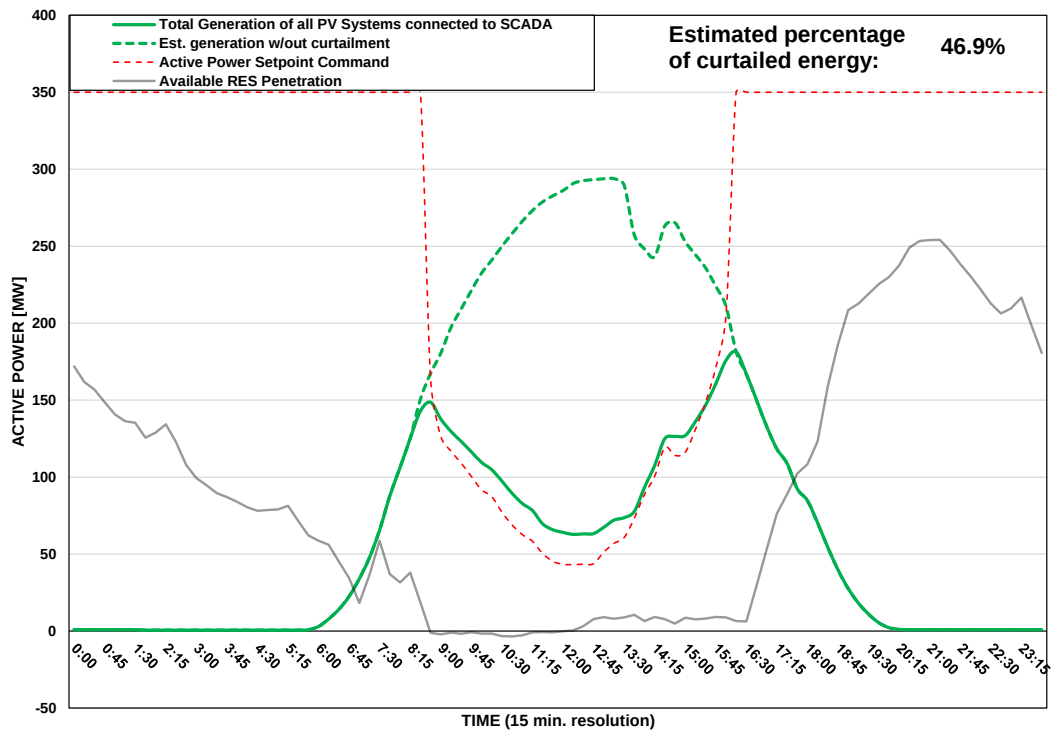


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	23/06/2025
Start of Curtailment	11:30
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2368.2 MWh
Total Estimated Curtailed Energy:	114.6 MWh
Percentage of Curtailed Energy:	4.8%

Scada PVs Generation on 23/06/2025 (curtailment time: 11:30 - 13:45)

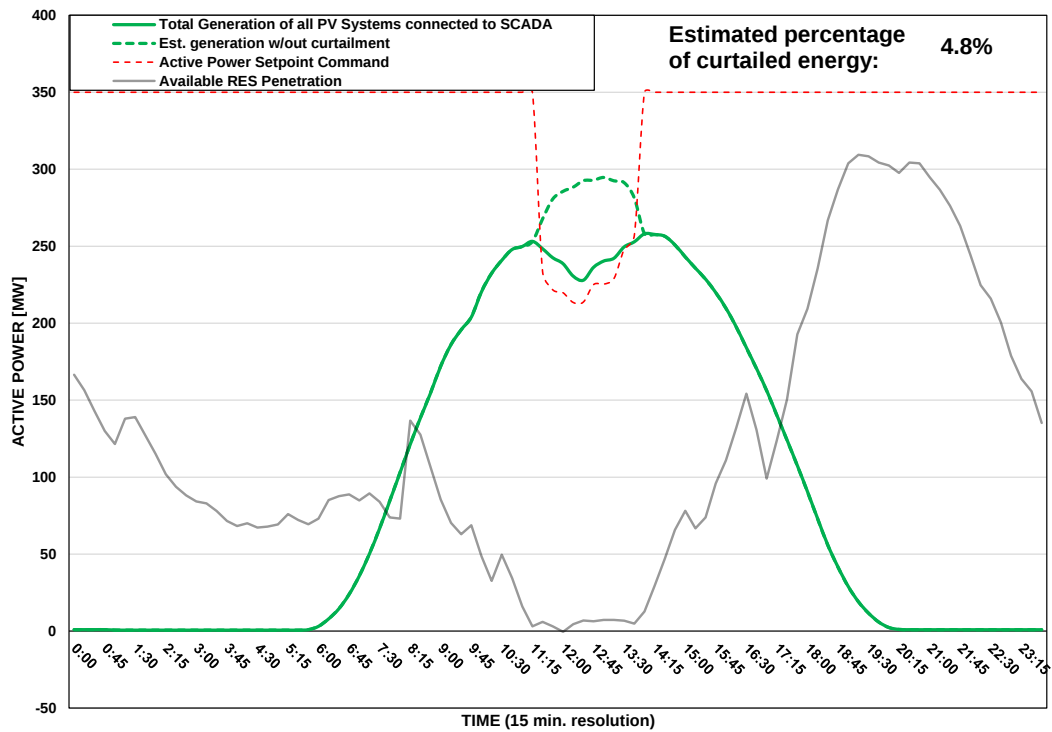


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	24/06/2025
Start of Curtailment	10:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2443.9 MWh
Total Estimated Curtailed Energy:	190.6 MWh
Percentage of Curtailed Energy:	7.8%

Scada PVs Generation on 24/06/2025 (curtailment time: 10:45 - 14:15)

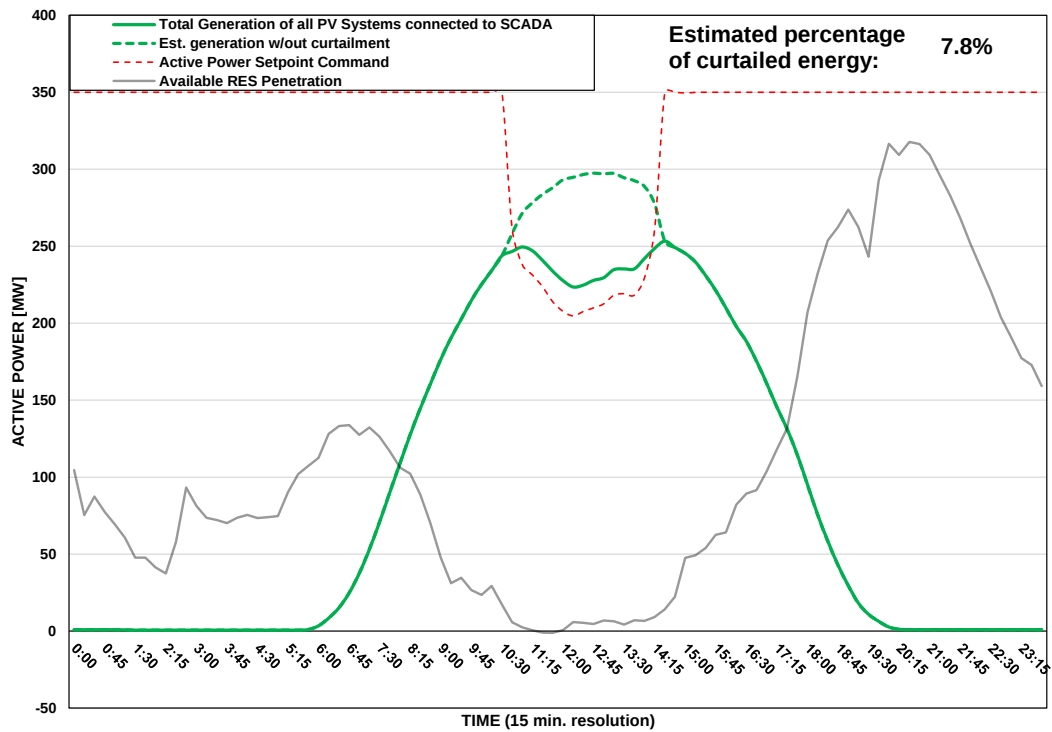

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	25/06/2025
Start of Curtailment	11:30
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2408.4 MWh
Total Estimated Curtailed Energy:	152.9 MWh
Percentage of Curtailed Energy:	6.3%

Scada PVs Generation on 25/06/2025 (curtailment time: 11:30 - 15:15)

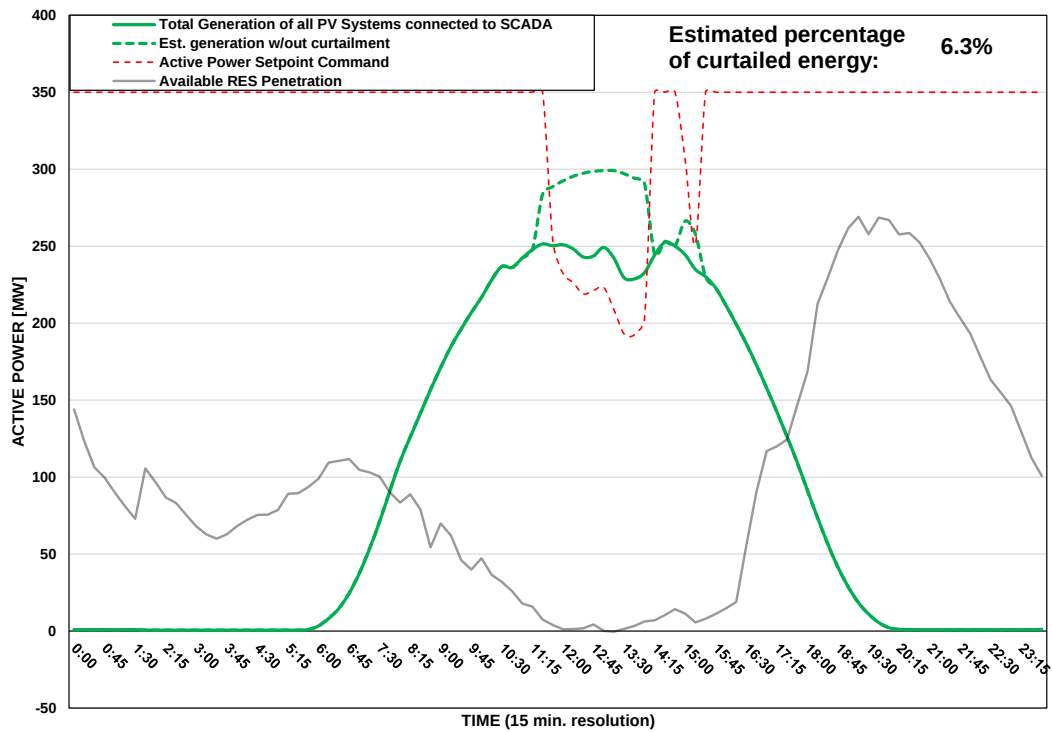

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	26/06/2025
Start of Curtailment	10:45
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2429.5 MWh
Total Estimated Curtailed Energy:	182.1 MWh
Percentage of Curtailed Energy:	7.5%

Scada PVs Generation on 26/06/2025 (curtailment time: 10:45 - 15:15)

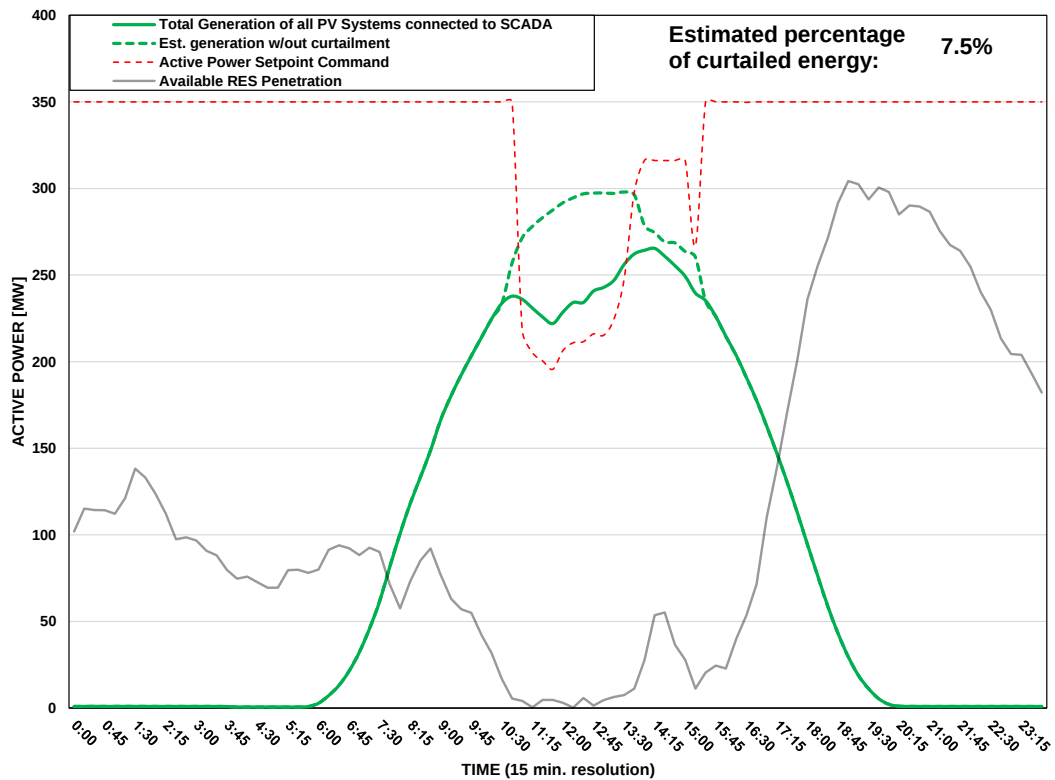


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	27/06/2025
Start of Curtailment	11:30
End of Curtailment	12:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2348 MWh
Total Estimated Curtailed Energy:	52 MWh
Percentage of Curtailed Energy:	2.2%

Scada PVs Generation on 27/06/2025 (curtailment time: 11:30 - 12:45)

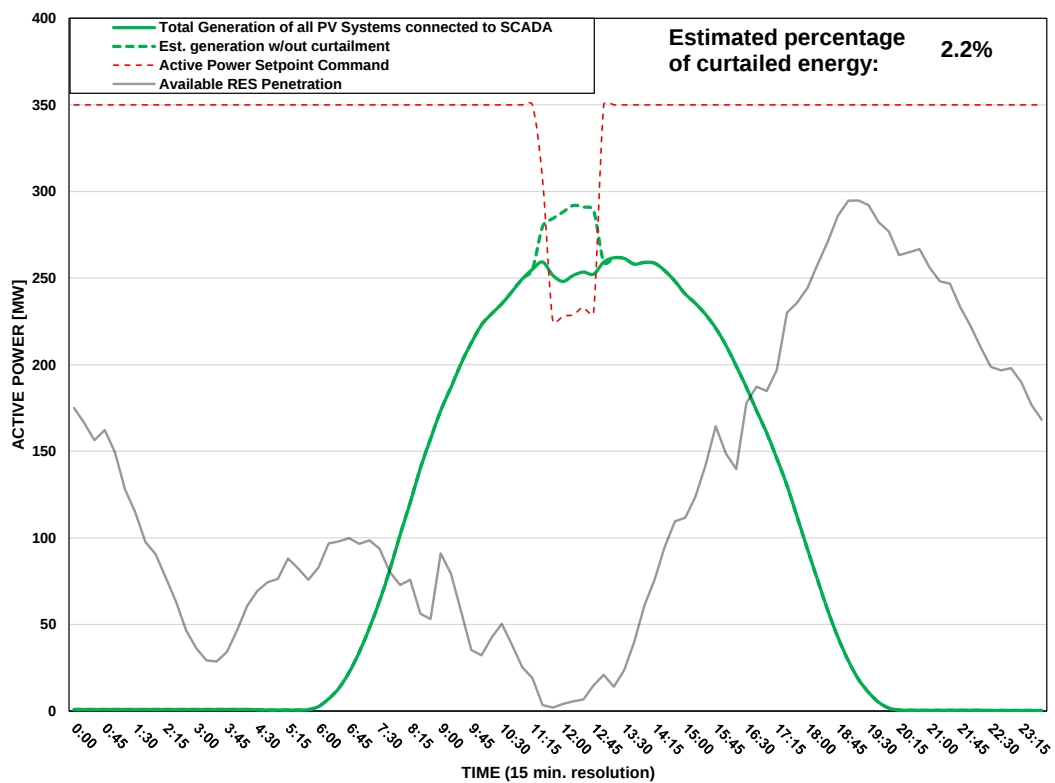


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	28/06/2025
Start of Curtailment	9:45
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2403.7 MWh
Total Estimated Curtailed Energy:	396.7 MWh
Percentage of Curtailed Energy:	16.5%

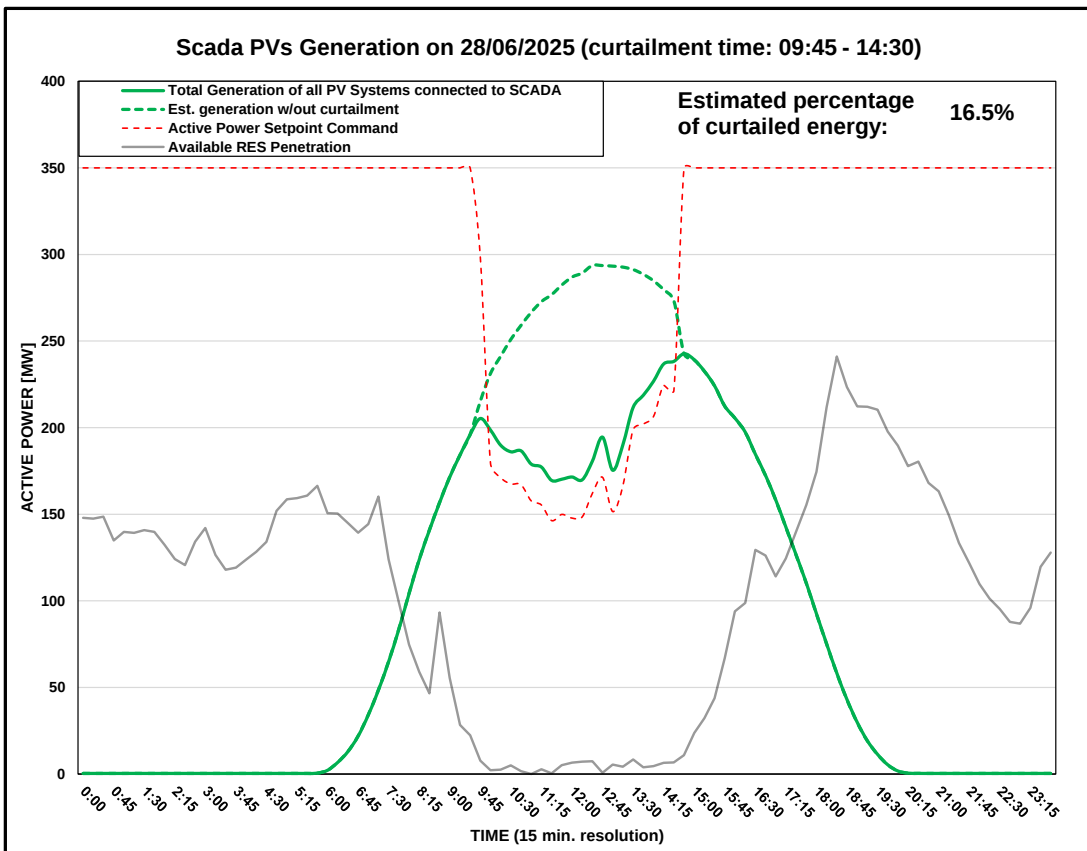

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	29/06/2025
Start of Curtailment	8:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2386.5 MWh
Total Estimated Curtailed Energy:	1062.3 MWh
Percentage of Curtailed Energy:	44.5%

Scada PVs Generation on 29/06/2025 (curtailment time: 08:30 - 15:30)

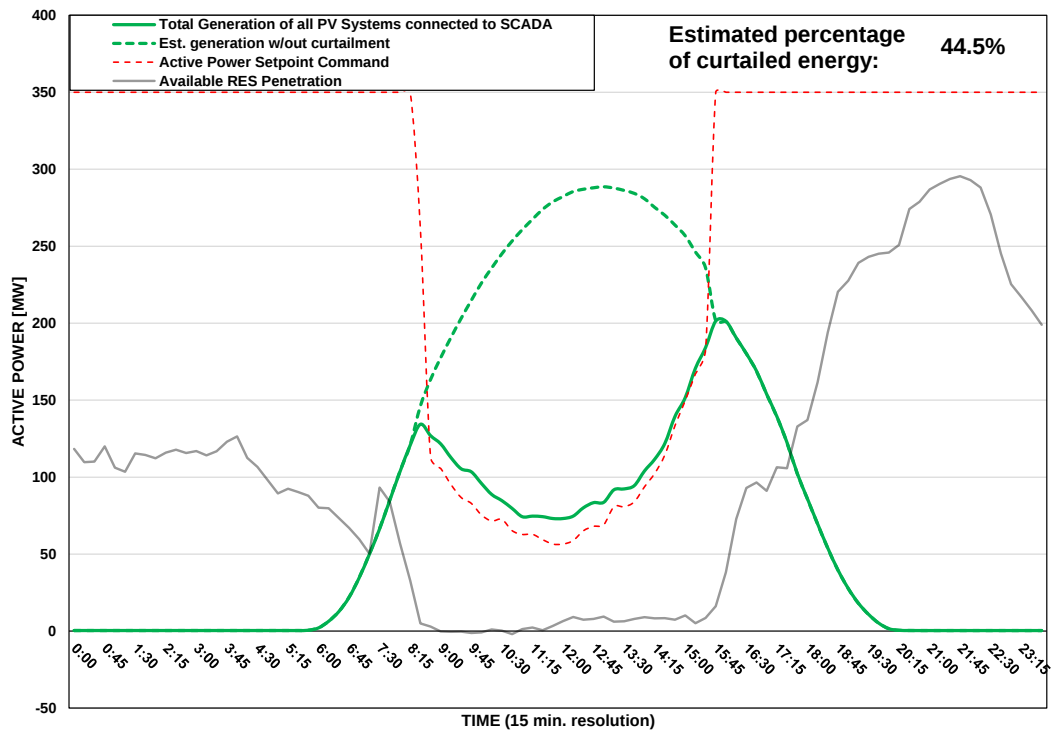

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	30/06/2025
Start of Curtailment	10:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2400.1 MWh
Total Estimated Curtailed Energy:	563.7 MWh
Percentage of Curtailed Energy:	23.5%

Scada PVs Generation on 30/06/2025 (curtailment time: 10:00 - 15:15)

