

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	01/07/2025
Start of Curtailment	9:00
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2472.5 MWh
Total Estimated Curtailed Energy:	1180.6 MWh
Percentage of Curtailed Energy:	47.8%

Scada PVs Generation on 01/07/2025 (curtailment time: 09:00 - 16:45)

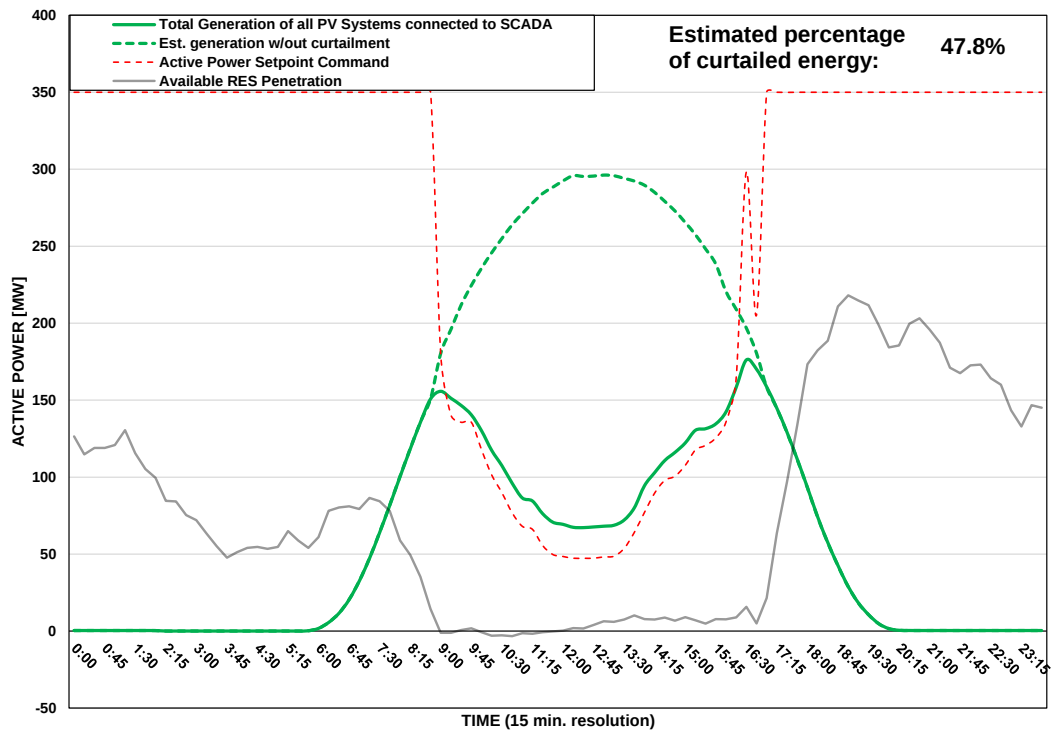


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	02/07/2025
Start of Curtailment	9:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2380.5 MWh
Total Estimated Curtailed Energy:	862 MWh
Percentage of Curtailed Energy:	36.2%

Scada PVs Generation on 02/07/2025 (curtailment time: 09:15 - 15:45)

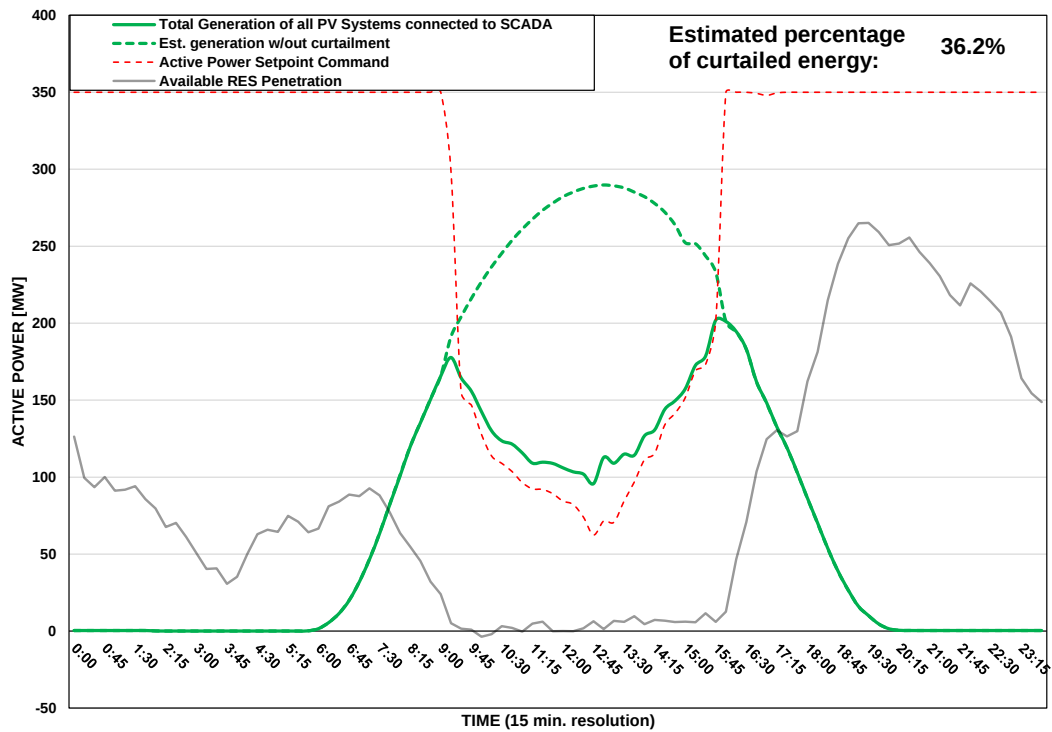

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	03/07/2025
Start of Curtailment	9:30
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2426.2 MWh
Total Estimated Curtailed Energy:	638.9 MWh
Percentage of Curtailed Energy:	26.3%

Scada PVs Generation on 03/07/2025 (curtailment time: 09:30 - 15:15)

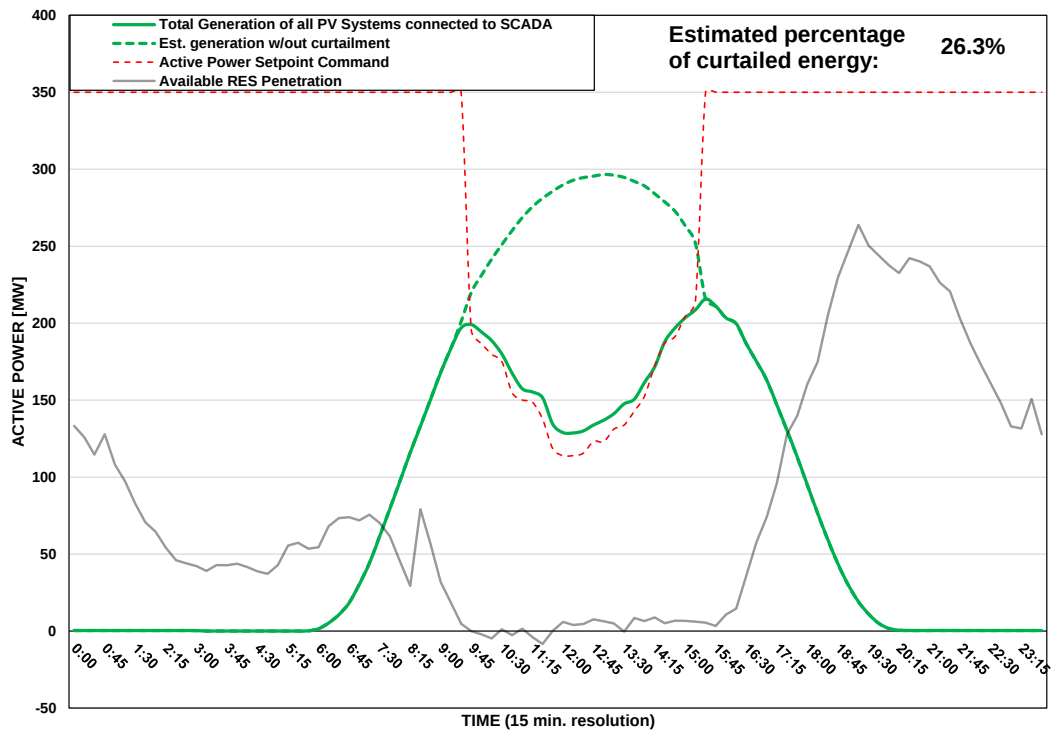


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	04/07/2025
Start of Curtailment	8:30
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2482.4 MWh
Total Estimated Curtailed Energy:	1120.8 MWh
Percentage of Curtailed Energy:	45.2%

Scada PVs Generation on 04/07/2025 (curtailment time: 08:30 - 17:00)

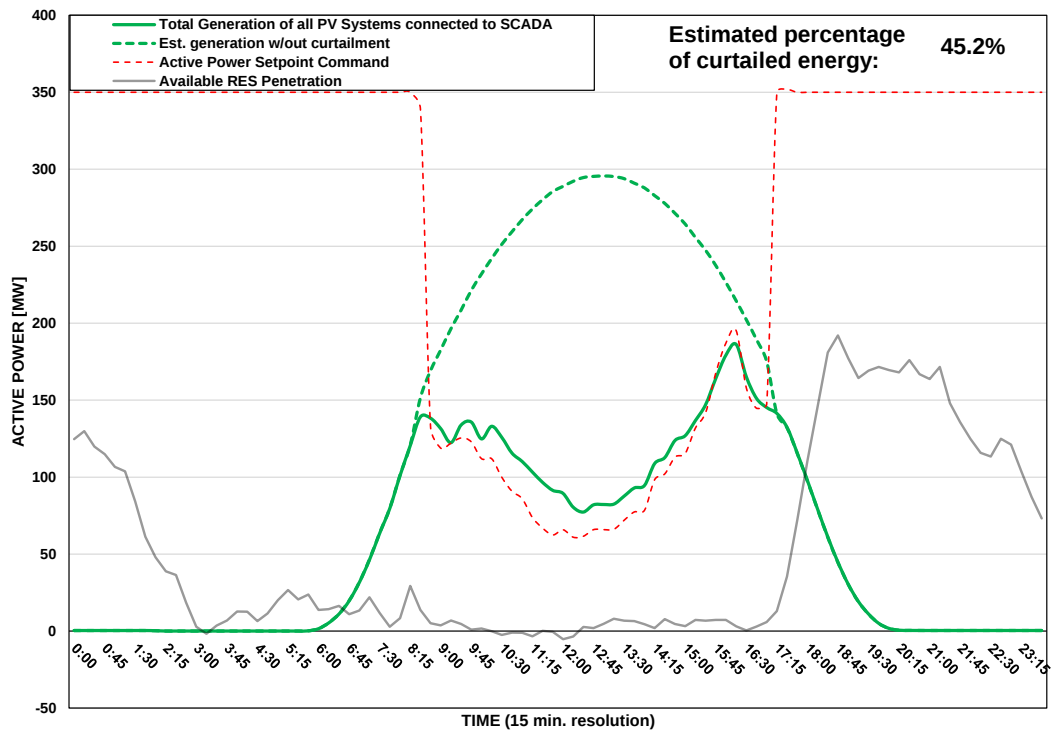


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	05/07/2025
Start of Curtailment	8:30
End of Curtailment	17:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2533.7 MWh
Total Estimated Curtailed Energy:	1447.4 MWh
Percentage of Curtailed Energy:	57.1%

Scada PVs Generation on 05/07/2025 (curtailment time: 08:30 - 17:15)

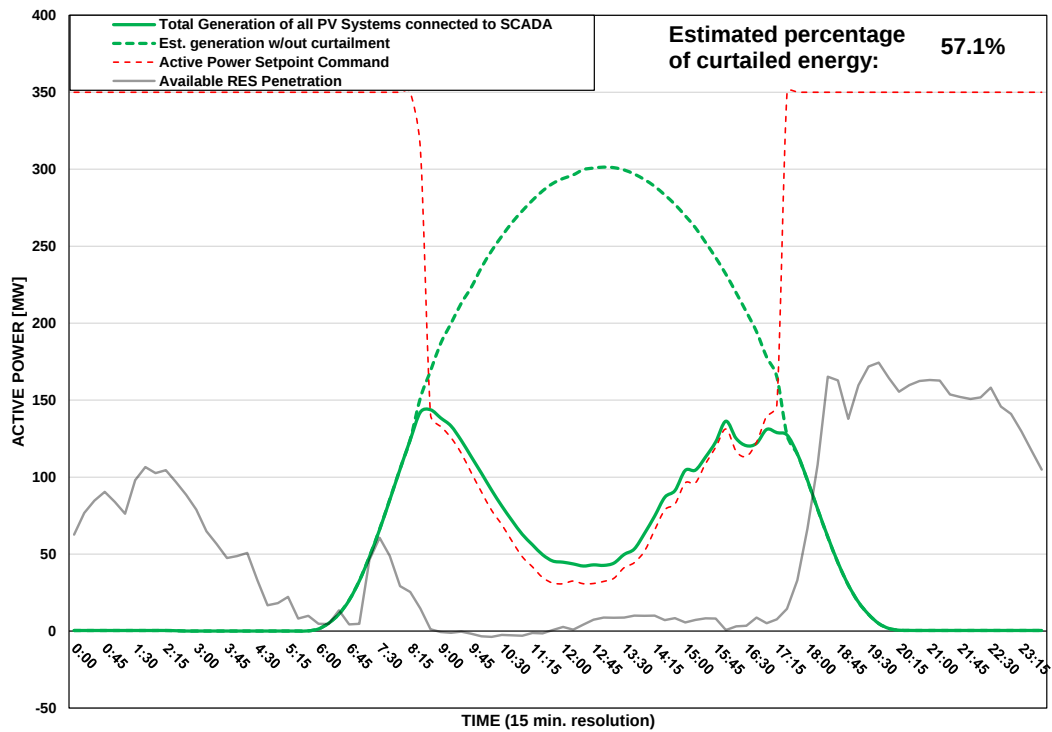


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	06/07/2025
Start of Curtailment	8:30
End of Curtailment	17:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2479.1 MWh
Total Estimated Curtailed Energy:	1448.5 MWh
Percentage of Curtailed Energy:	58.4%

Scada PVs Generation on 06/07/2025 (curtailment time: 08:30 - 17:00)

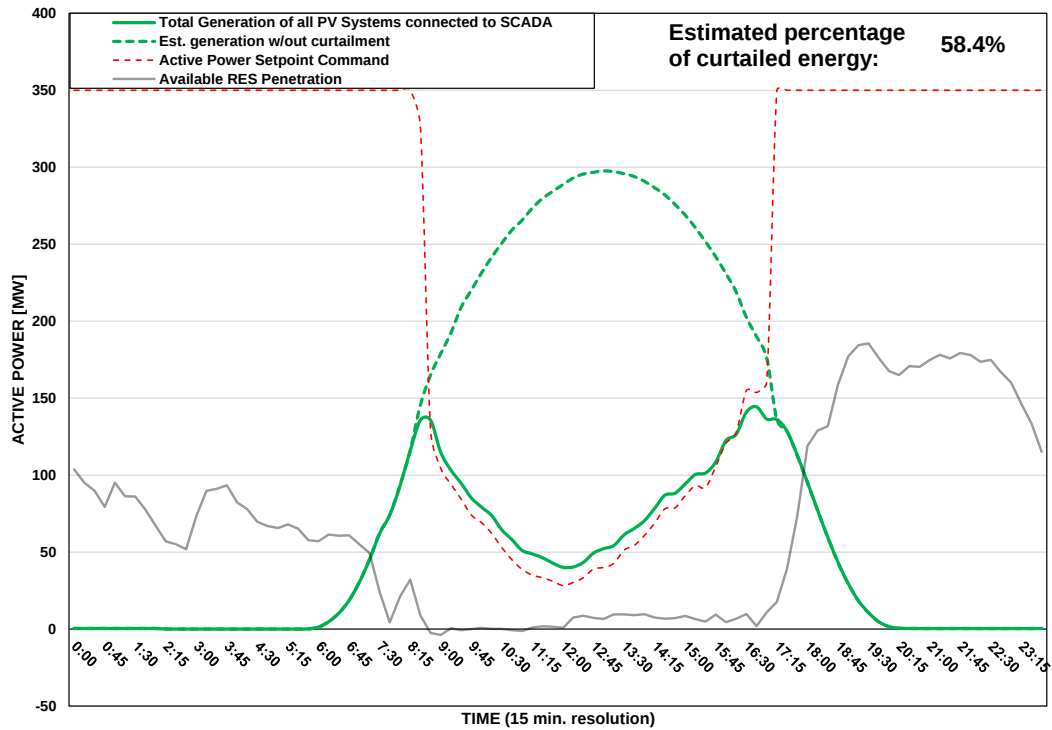

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	07/07/2025
Start of Curtailment	10:30
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2405.8 MWh
Total Estimated Curtailed Energy:	251.2 MWh
Percentage of Curtailed Energy:	10.4%

Scada PVs Generation on 07/07/2025 (curtailment time: 10:30 - 14:45)

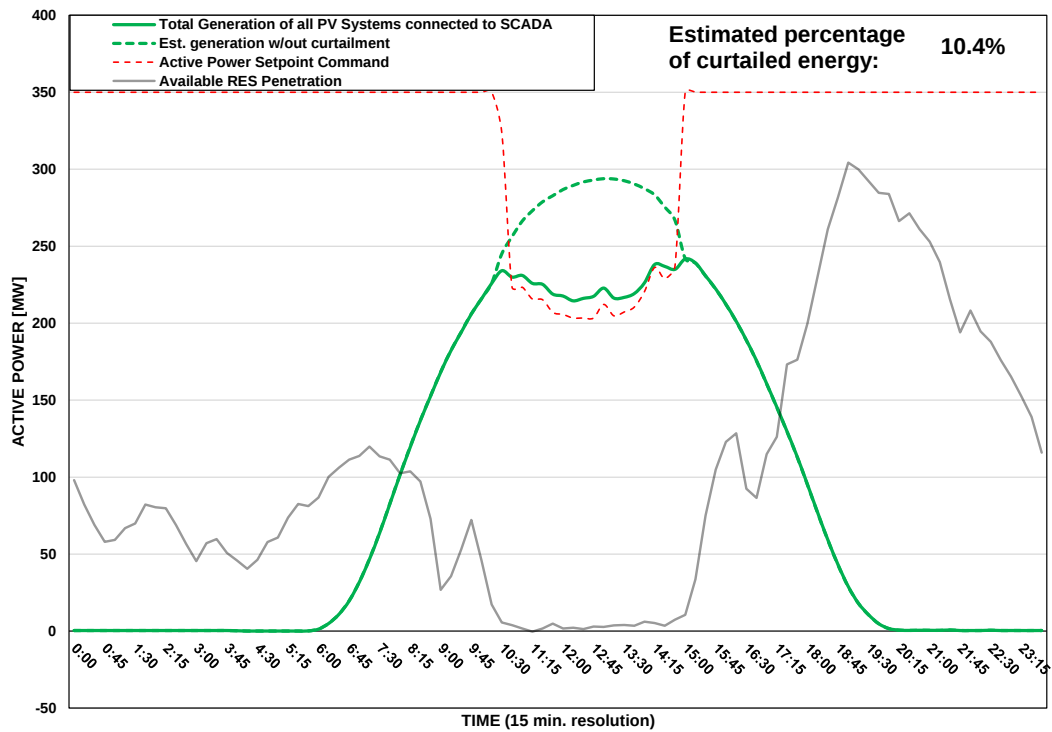


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	08/07/2025
Start of Curtailment	10:45
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2389.9 MWh
Total Estimated Curtailed Energy:	239.9 MWh
Percentage of Curtailed Energy:	10.0%

Scada PVs Generation on 08/07/2025 (curtailment time: 10:45 - 14:45)

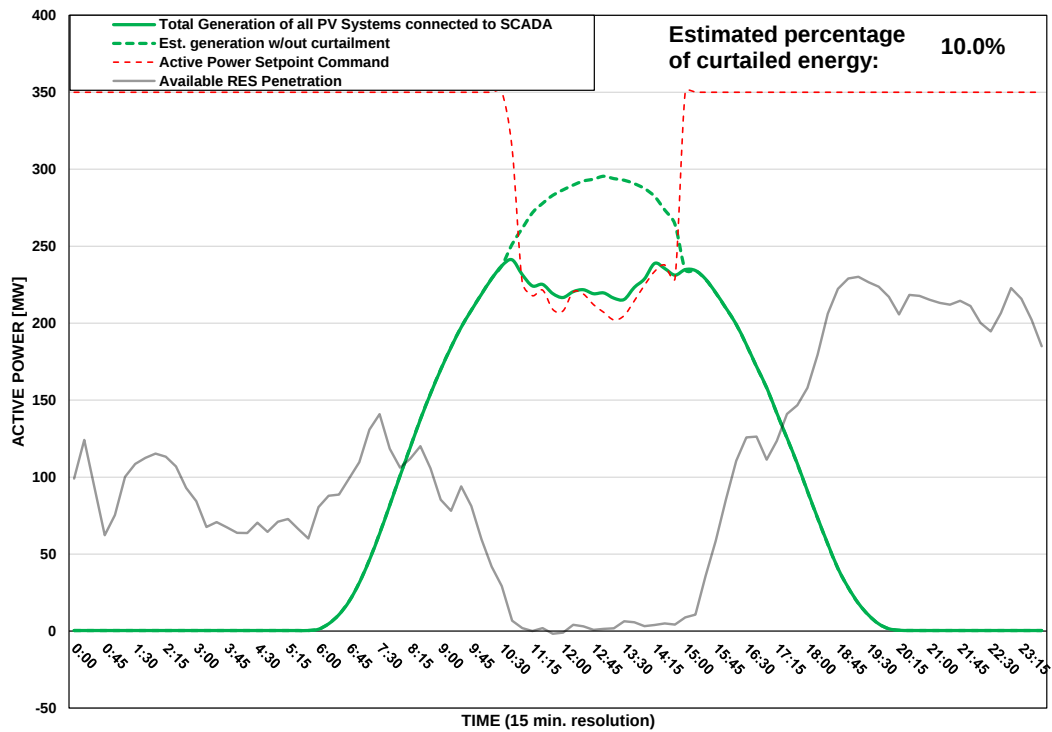

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	09/07/2025
Start of Curtailment	10:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2347 MWh
Total Estimated Curtailed Energy:	437.1 MWh
Percentage of Curtailed Energy:	18.6%

Scada PVs Generation on 09/07/2025 (curtailment time: 10:00 - 14:45)

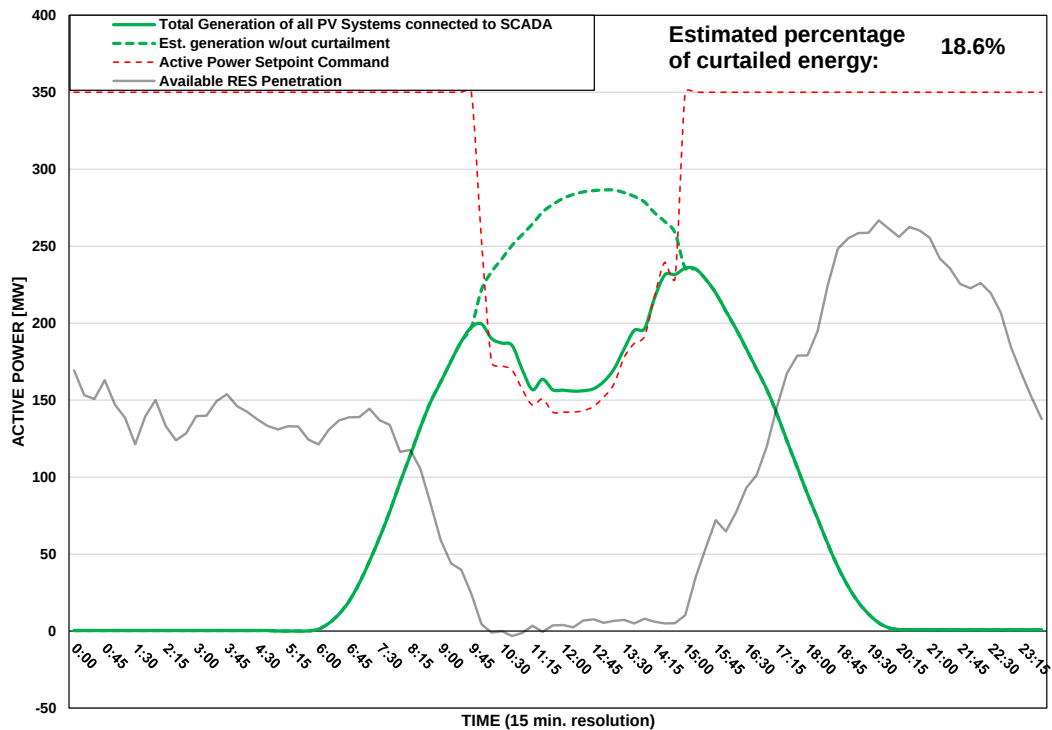


ΔΙΑΧΕΙΡΙΣΤΗΣ ΣΥΣΤΗΜΑΤΟΣ ΔΙΑΝΟΜΗΣ
ΛΕΙΤΟΥΡΓΙΑ ΣΥΣΤΗΜΑΤΟΣ



Έκθεση Περικοπής Φ/Β Παραγωγής

Ημερομηνία Περικοπής:	10/07/2025
Ωρα Έναρξης Περικοπής	11:15
Ωρα Λήξης Περικοπής	13:15
Οδηγία από ΔΣΜΚ:	ΝΑΙ
Λόγος Περικοπής:	Περιορισμός παραγωγής ΑΠΕ λόγω χαμηλής φόρτισης ηλεκτρικού συστήματος
Συνολική Εκτιμώμενη Ενέργεια της ημέρας:	2292.4 MWh
Συνολική Εκτιμώμενη Ενέργεια που περικόπηκε:	84.7 MWh
Ποσοστό Ενέργειας που περικόπηκε:	3.7%

ΦΒ Παραγωγή στο ΣΤΗΔ στις 10/07/2025 (ώρα περικοπής: 11:15 - 13:15)

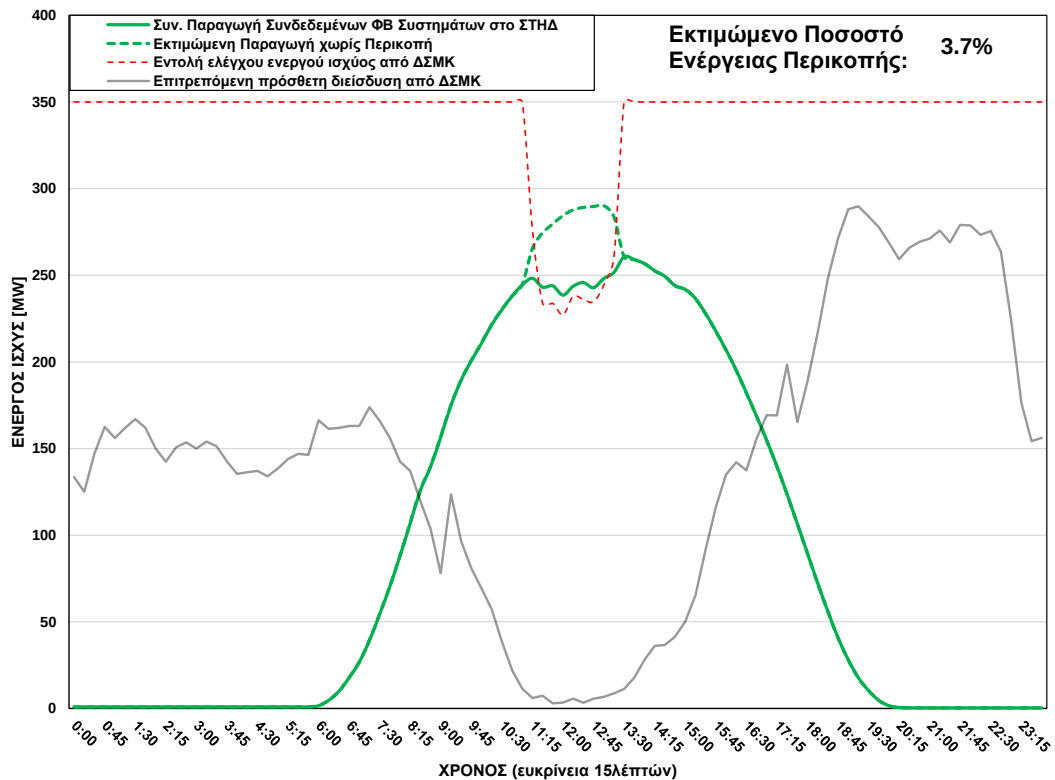


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	11/07/2025
Start of Curtailment	11:15
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2320.1 MWh
Total Estimated Curtailed Energy:	100.2 MWh
Percentage of Curtailed Energy:	4.3%

Scada PVs Generation on 11/07/2025 (curtailment time: 11:15 - 13:15)

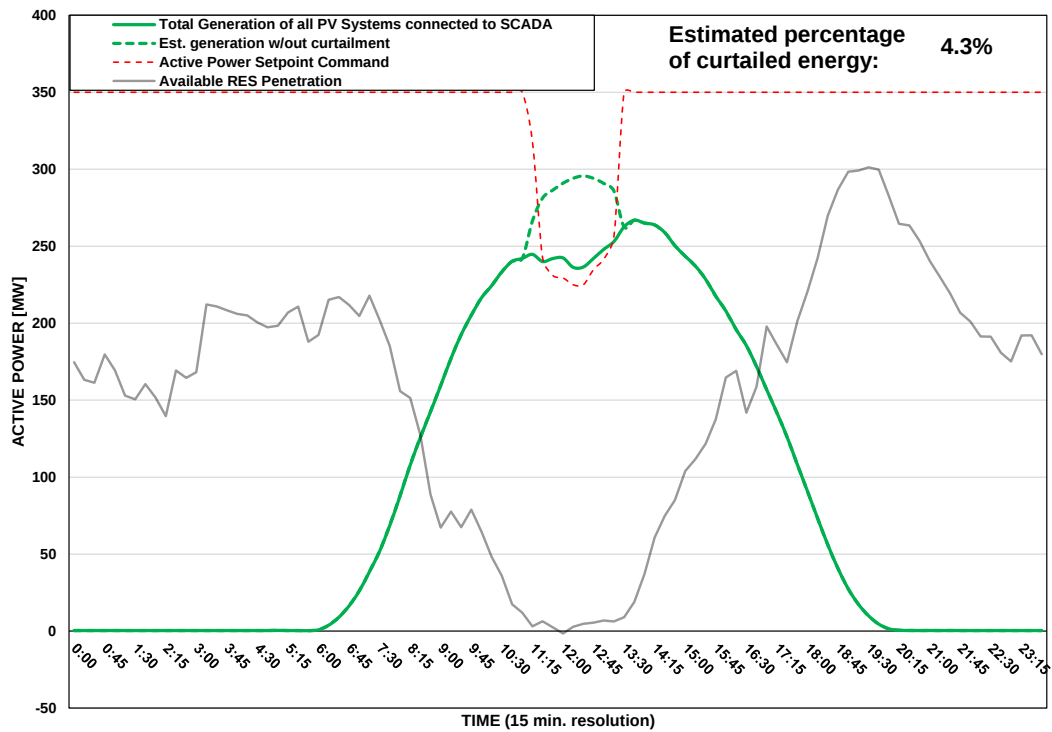


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	12/07/2025
Start of Curtailment	9:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2392.8 MWh
Total Estimated Curtailed Energy:	721.2 MWh
Percentage of Curtailed Energy:	30.1%

Scada PVs Generation on 12/07/2025 (curtailment time: 09:30 - 15:30)

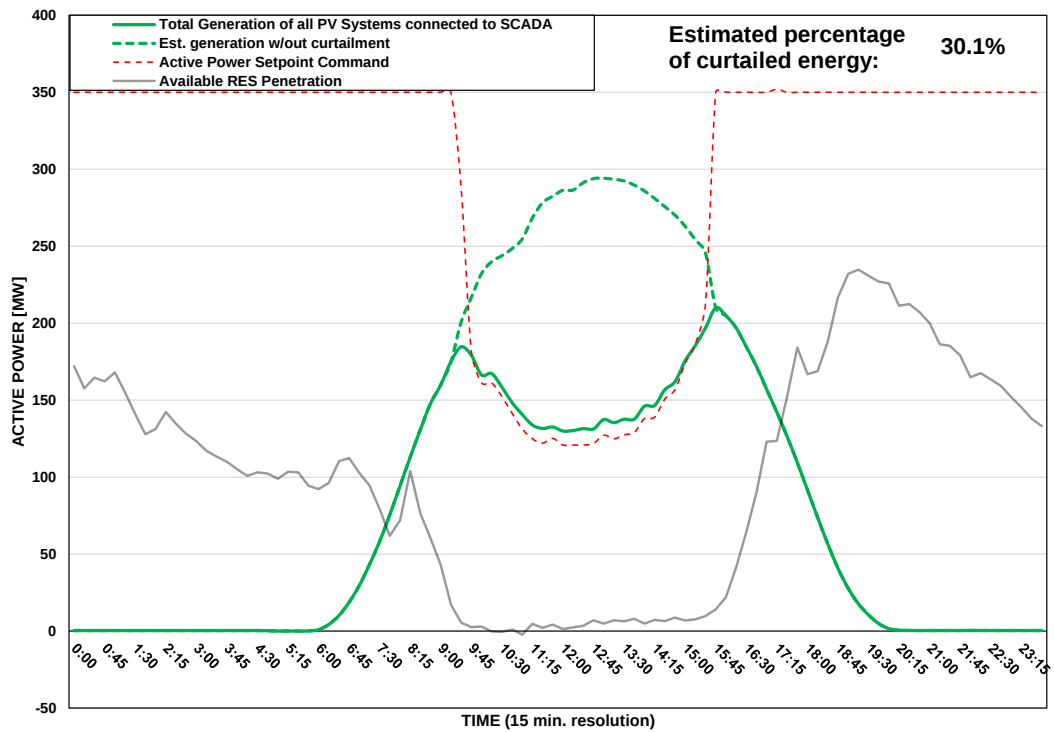


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	13/07/2025
Start of Curtailment	8:30
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2415.1 MWh
Total Estimated Curtailed Energy:	1467.8 MWh
Percentage of Curtailed Energy:	60.8%

Scada PVs Generation on 13/07/2025 (curtailment time: 08:30 - 16:30)

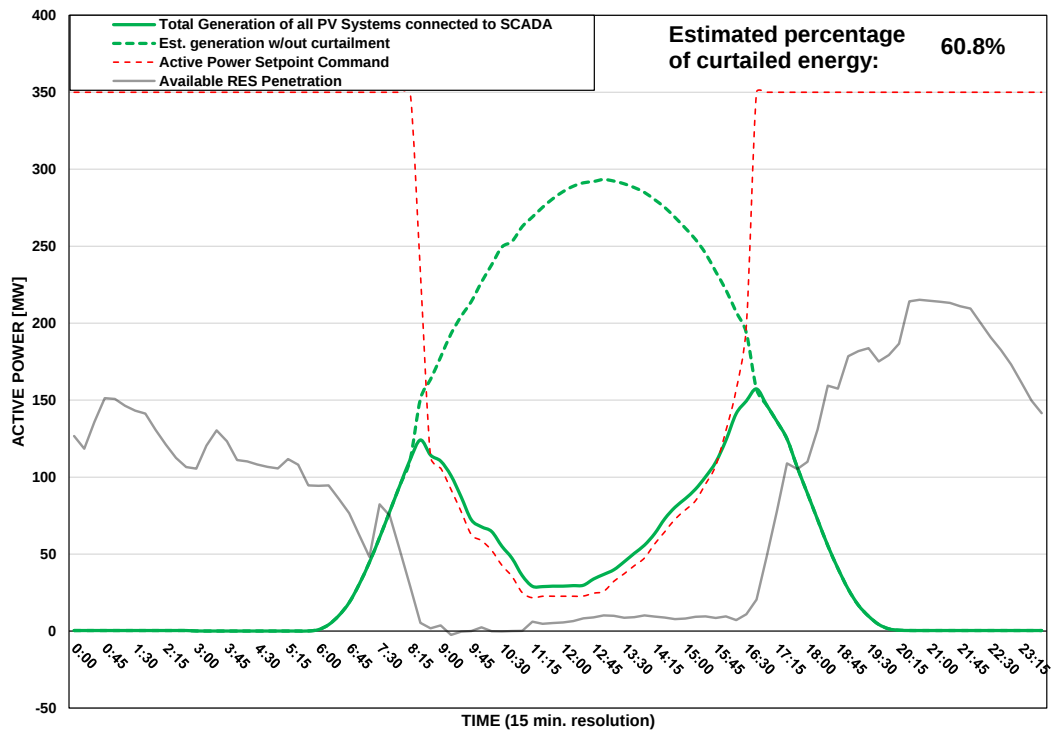

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	14/07/2025
Start of Curtailment	10:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2335.9 MWh
Total Estimated Curtailed Energy:	505.7 MWh
Percentage of Curtailed Energy:	21.6%

Scada PVs Generation on 14/07/2025 (curtailment time: 10:30 - 16:00)

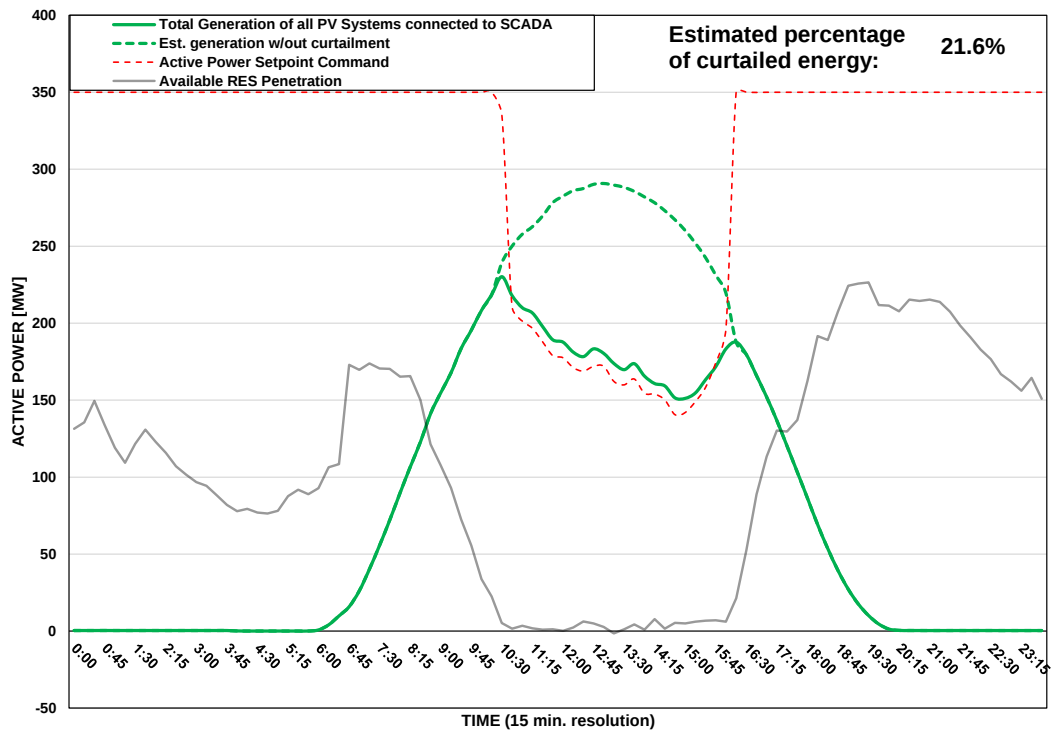


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	15/07/2025
Start of Curtailment	11:15
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2175.4 MWh
Total Estimated Curtailed Energy:	99.7 MWh
Percentage of Curtailed Energy:	4.6%

Scada PVs Generation on 15/07/2025 (curtailment time: 11:15 - 14:00)

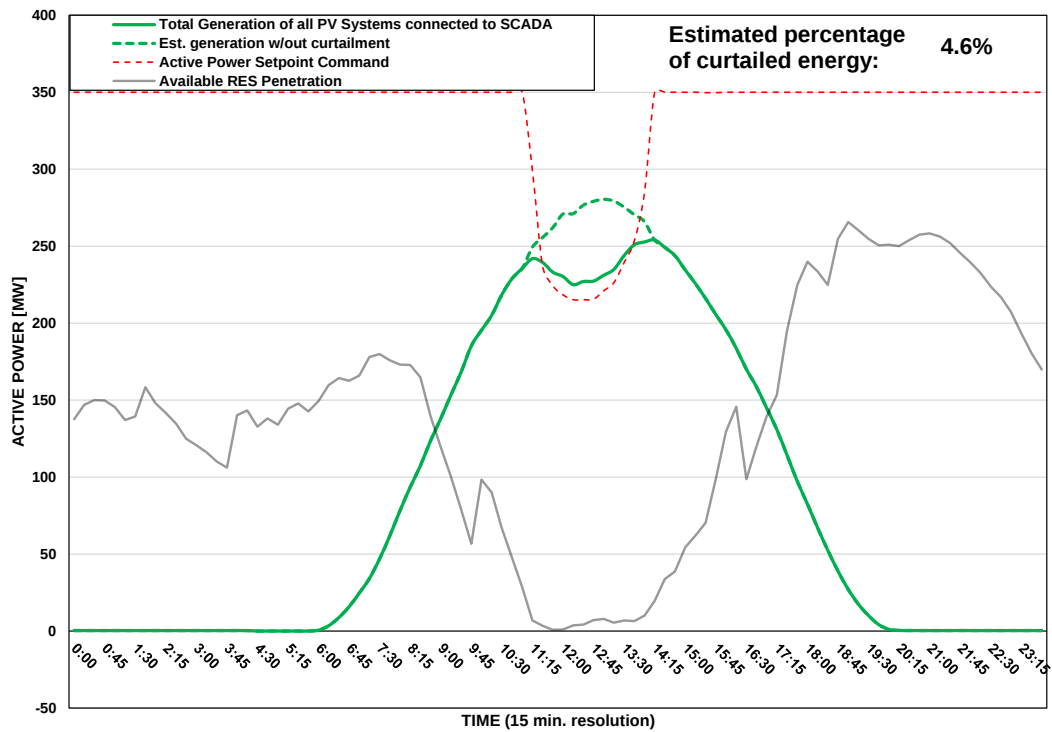


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	16/07/2025
Start of Curtailment	11:00
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1870.3 MWh
Total Estimated Curtailed Energy:	105.3 MWh
Percentage of Curtailed Energy:	5.6%

Scada PVs Generation on 16/07/2025 (curtailment time: 11:00 - 13:15)

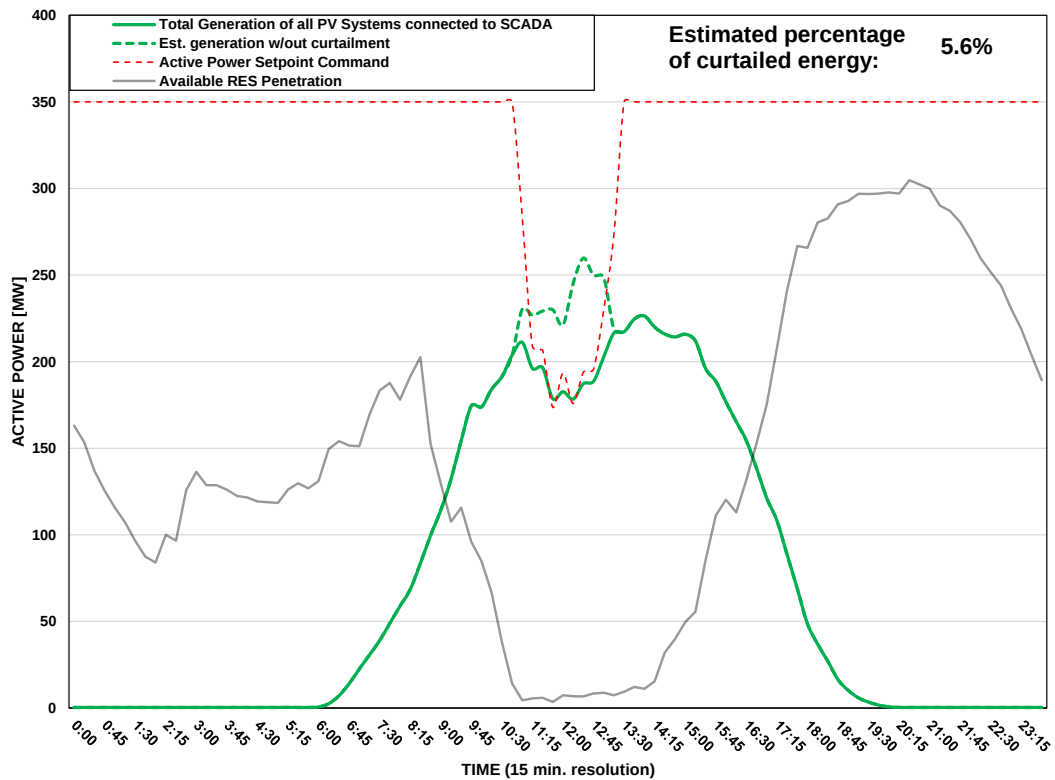

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	18/07/2025
Start of Curtailment	10:00
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2295.1 MWh
Total Estimated Curtailed Energy:	561.9 MWh
Percentage of Curtailed Energy:	24.5%

Scada PVs Generation on 18/07/2025 (curtailment time: 10:00 - 15:30)

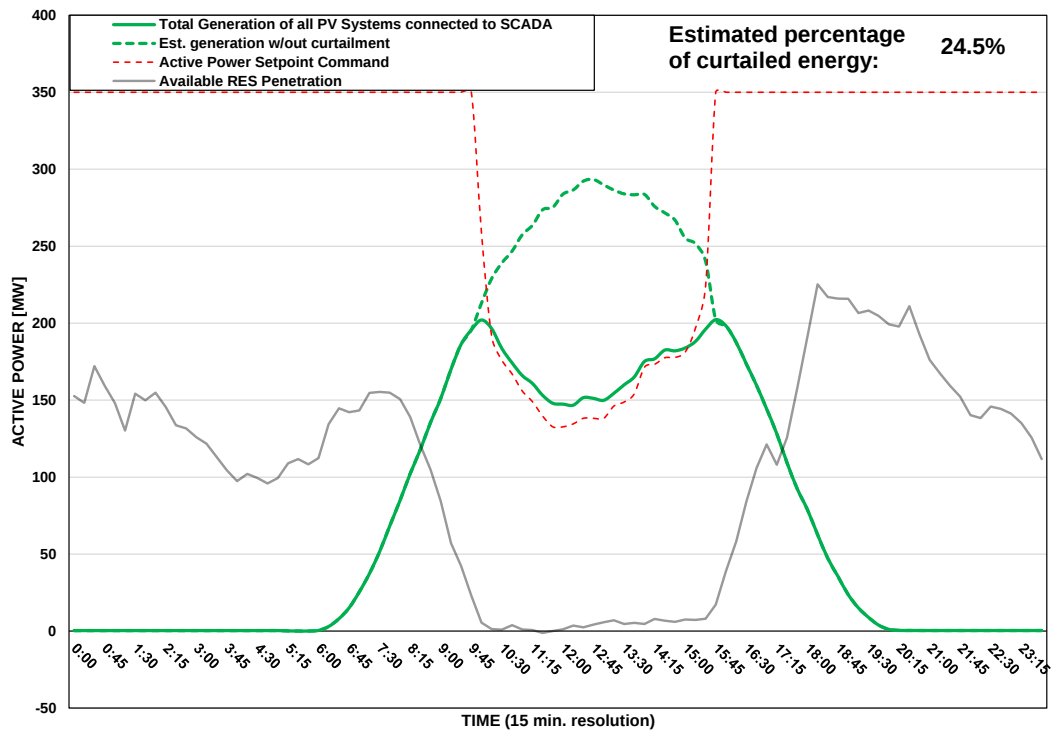


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/07/2025
Start of Curtailment	9:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2328.5 MWh
Total Estimated Curtailed Energy:	792.9 MWh
Percentage of Curtailed Energy:	34.1%

Scada PVs Generation on 19/07/2025 (curtailment time: 09:30 - 16:00)

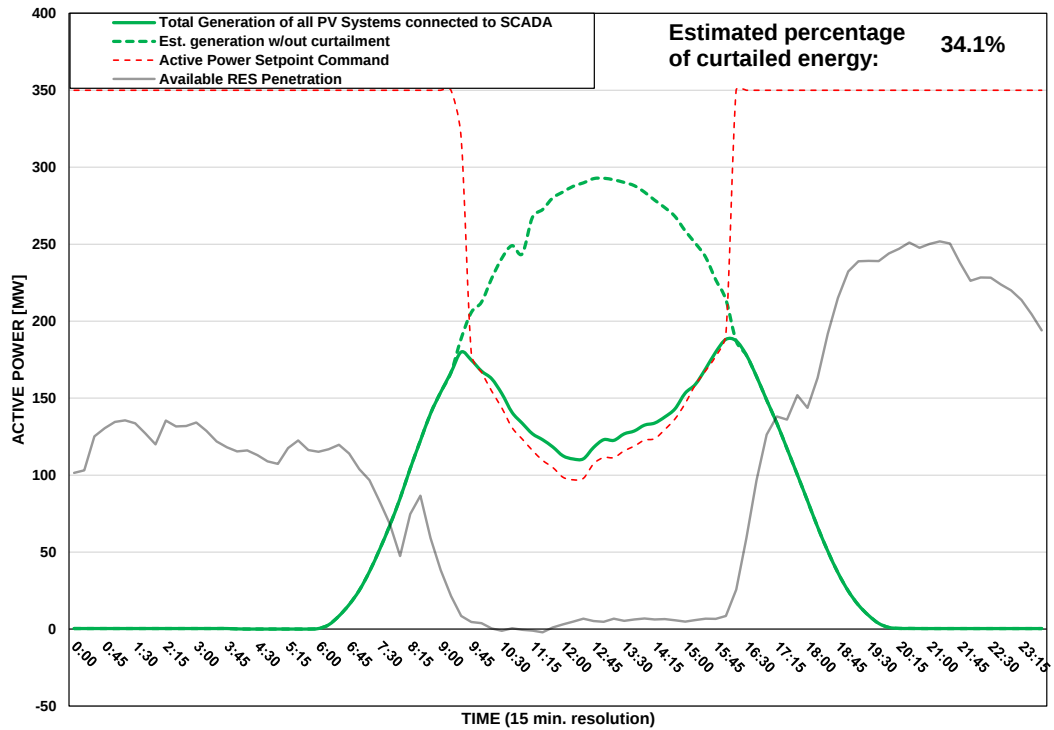


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	20/07/2025
Start of Curtailment	9:00
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2298.2 MWh
Total Estimated Curtailed Energy:	863.1 MWh
Percentage of Curtailed Energy:	37.6%

Scada PVs Generation on 20/07/2025 (curtailment time: 09:00 - 15:45)

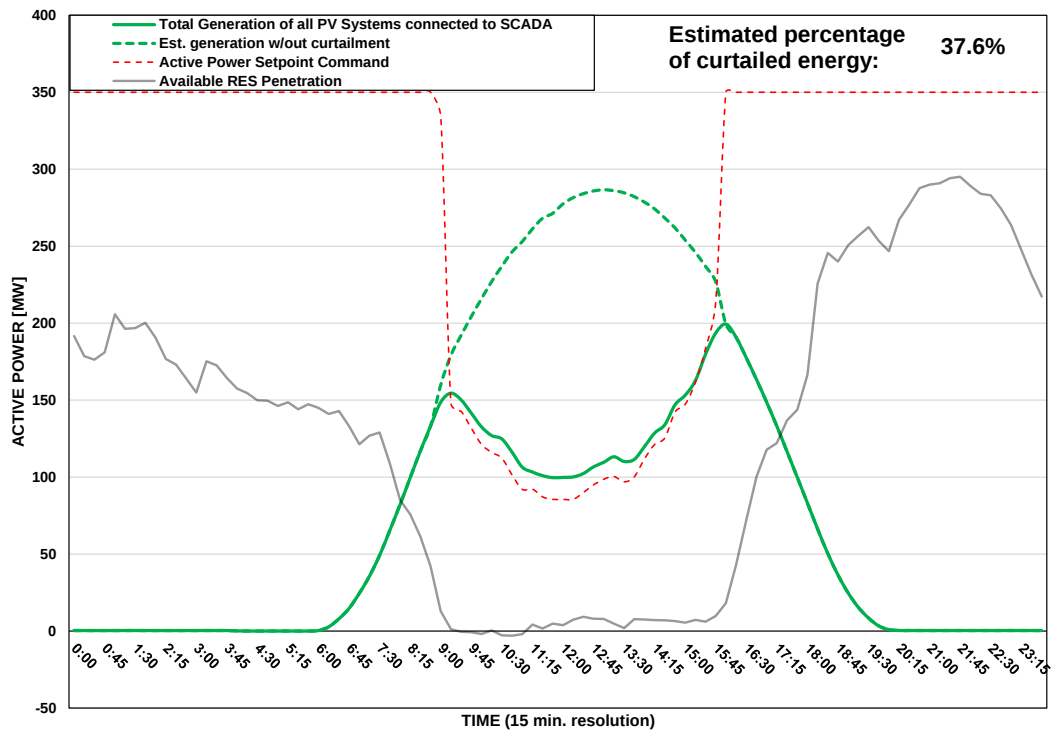


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	21/07/2025
Start of Curtailment	11:45
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2202.5 MWh
Total Estimated Curtailed Energy:	33.9 MWh
Percentage of Curtailed Energy:	1.5%

Scada PVs Generation on 21/07/2025 (curtailment time: 11:45 - 13:00)

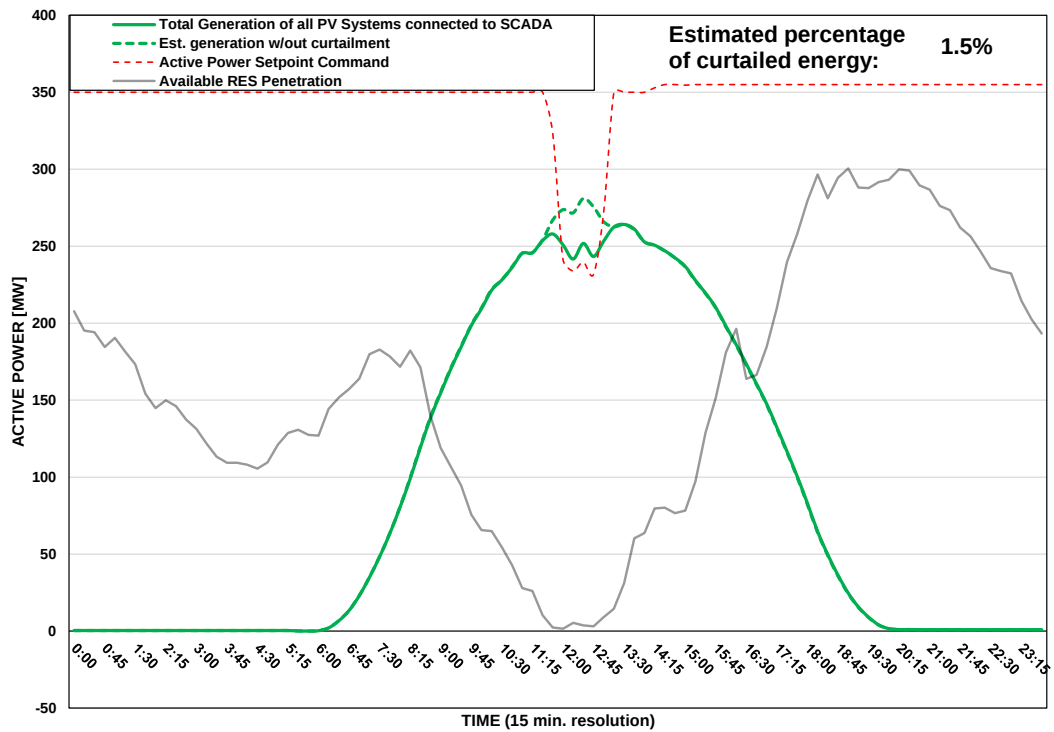

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	23/07/2025
Start of Curtailment	11:15
End of Curtailment	13:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2273.7 MWh
Total Estimated Curtailed Energy:	43.9 MWh
Percentage of Curtailed Energy:	1.9%

Scada PVs Generation on 23/07/2025 (curtailment time: 11:15 - 13:00)

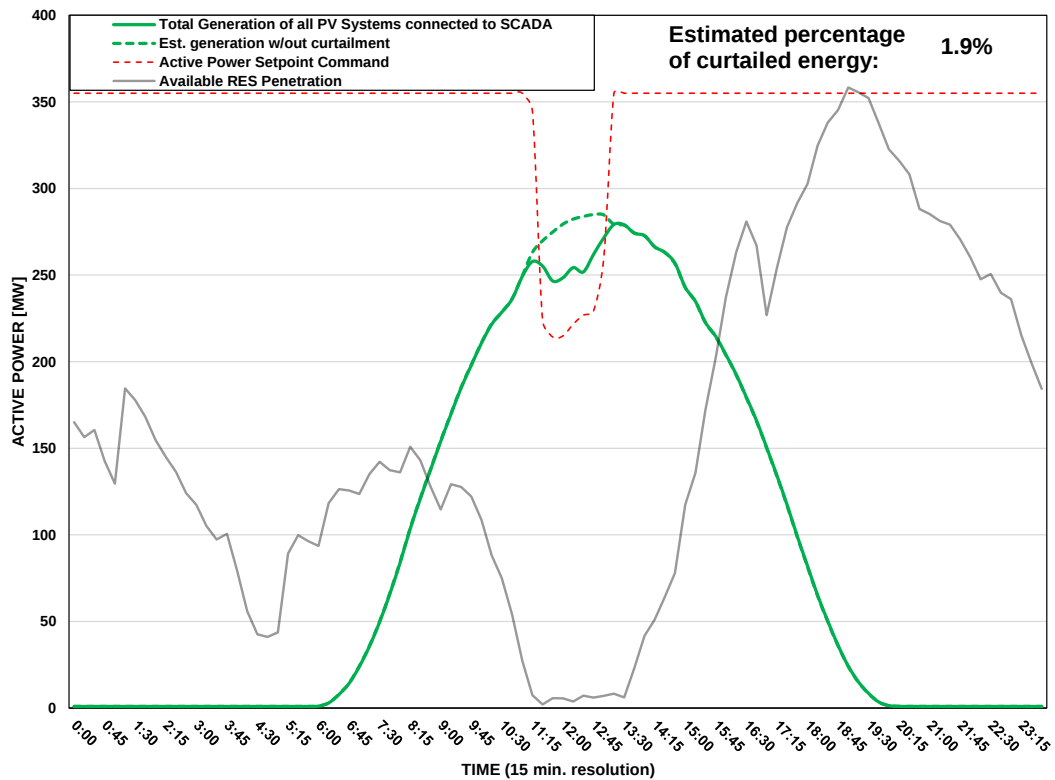

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	24/07/2025
Start of Curtailment	10:30
End of Curtailment	13:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2273.1 MWh
Total Estimated Curtailed Energy:	201.9 MWh
Percentage of Curtailed Energy:	8.9%

Scada PVs Generation on 24/07/2025 (curtailment time: 10:30 - 13:45)

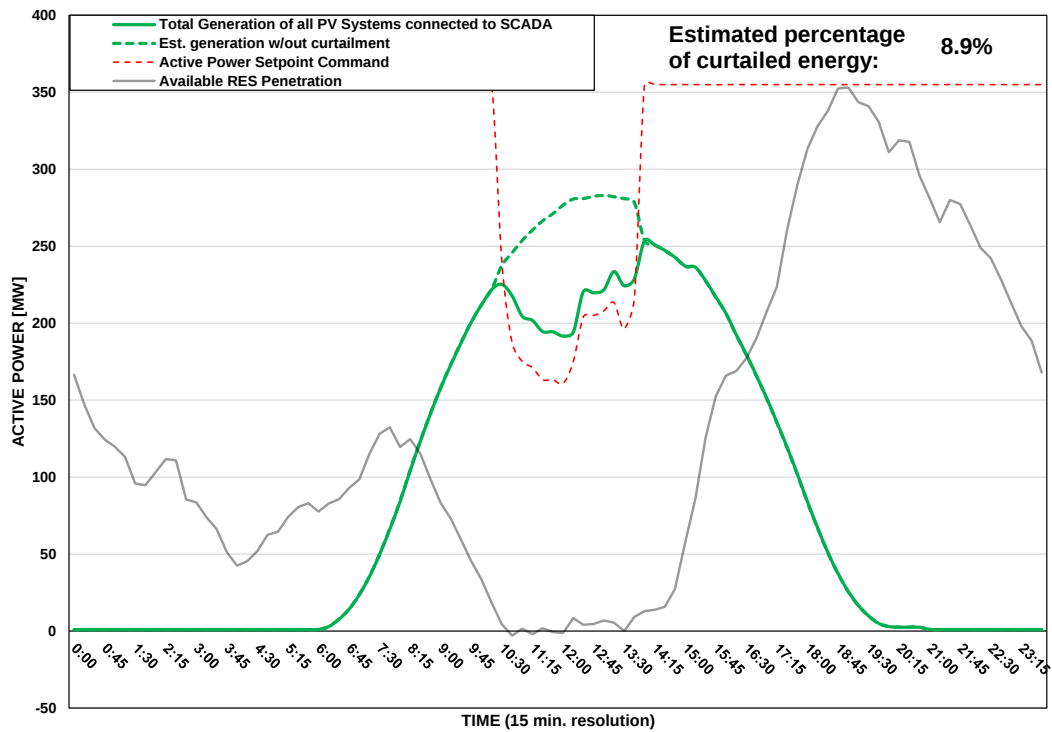

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	26/07/2025
Start of Curtailment	10:45
End of Curtailment	12:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2189.5 MWh
Total Estimated Curtailed Energy:	57.3 MWh
Percentage of Curtailed Energy:	2.6%

Scada PVs Generation on 26/07/2025 (curtailment time: 10:45 - 12:30)

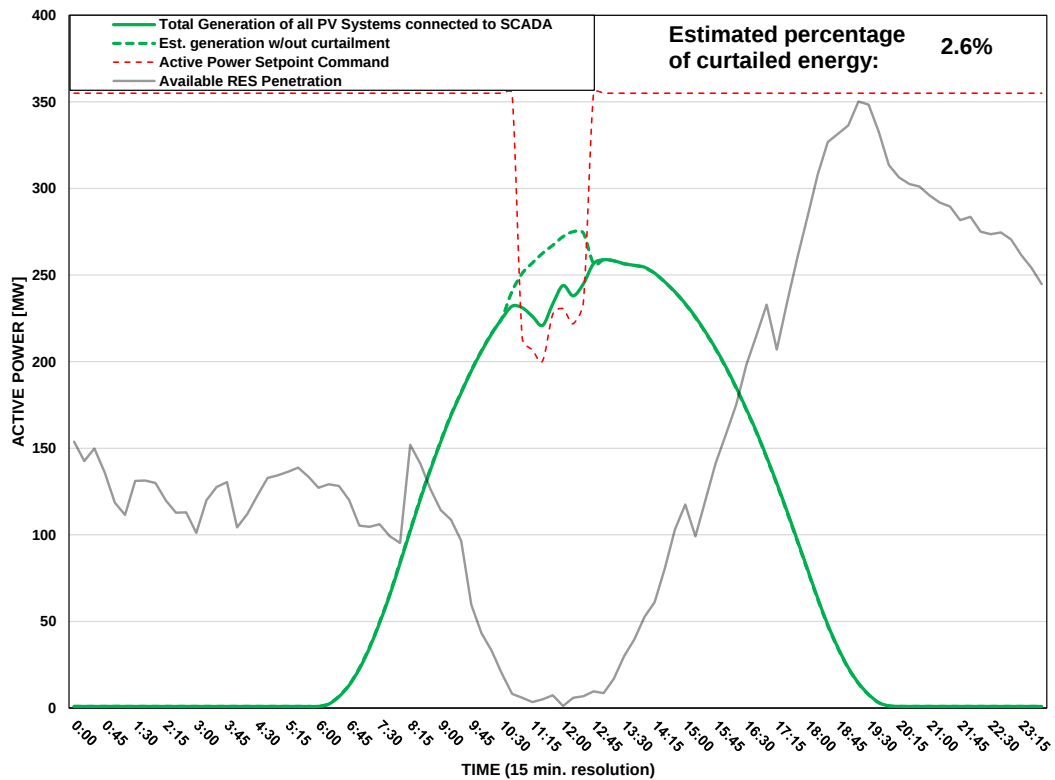


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	27/07/2025
Start of Curtailment	9:15
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2269.4 MWh
Total Estimated Curtailed Energy:	656.2 MWh
Percentage of Curtailed Energy:	28.9%

Scada PVs Generation on 27/07/2025 (curtailment time: 09:15 - 15:15)

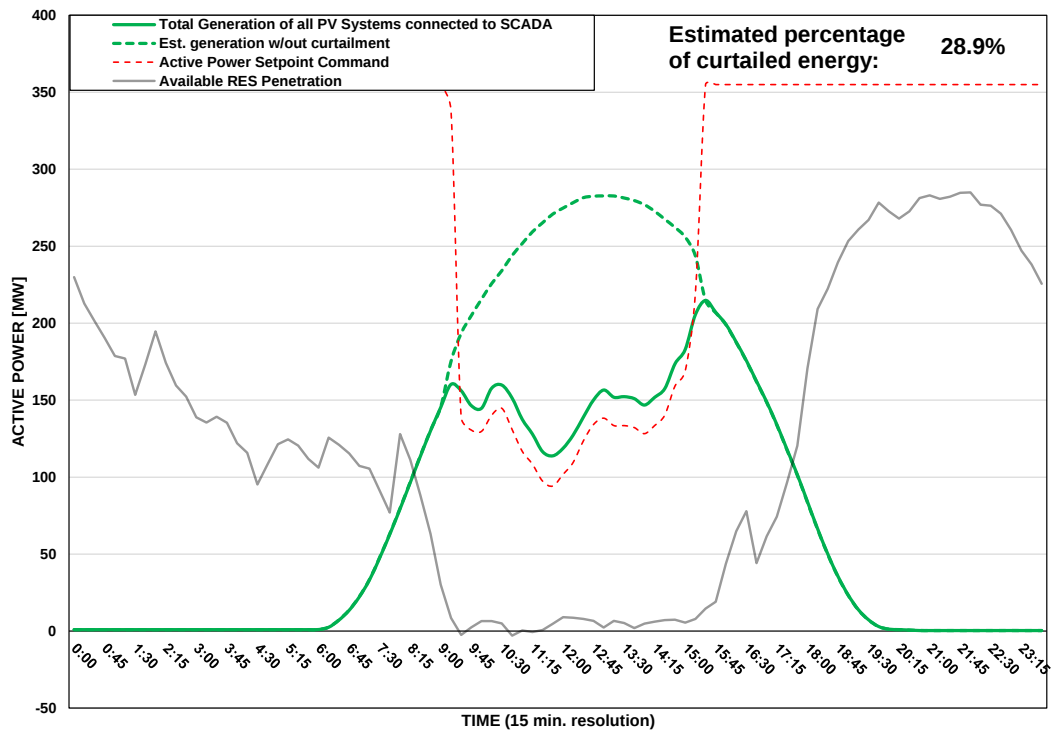

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	28/07/2025
Start of Curtailment	10:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2337 MWh
Total Estimated Curtailed Energy:	344.8 MWh
Percentage of Curtailed Energy:	14.8%

Scada PVs Generation on 28/07/2025 (curtailment time: 10:00 - 14:45)

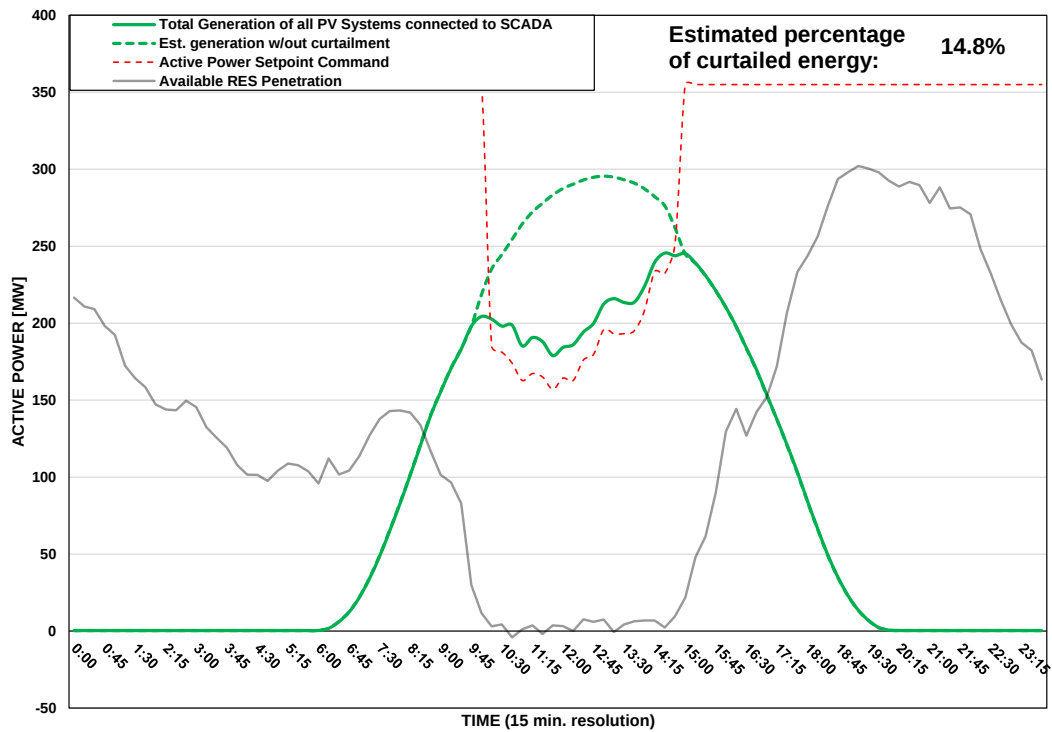


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	29/07/2025
Start of Curtailment	11:30
End of Curtailment	13:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2239.2 MWh
Total Estimated Curtailed Energy:	53.8 MWh
Percentage of Curtailed Energy:	2.4%

Scada PVs Generation on 29/07/2025 (curtailment time: 11:30 - 13:15)

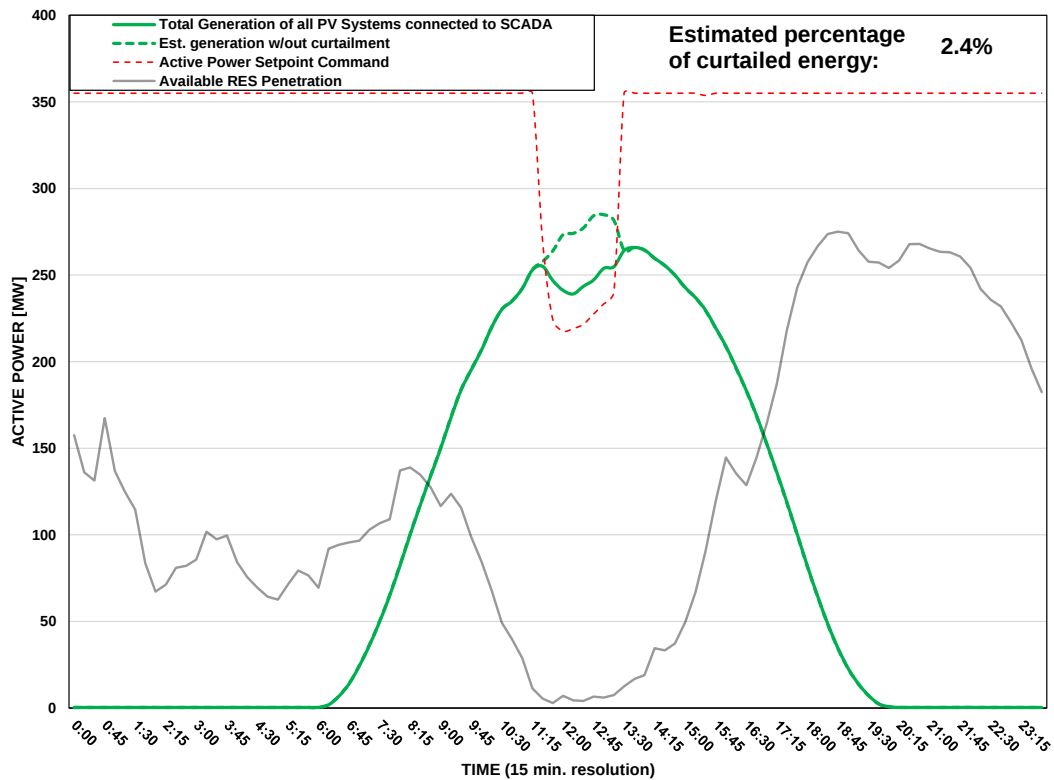


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	30/07/2025
Start of Curtailment	11:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2279.9 MWh
Total Estimated Curtailed Energy:	456.2 MWh
Percentage of Curtailed Energy:	20.0%

Scada PVs Generation on 30/07/2025 (curtailment time: 11:15 - 15:45)

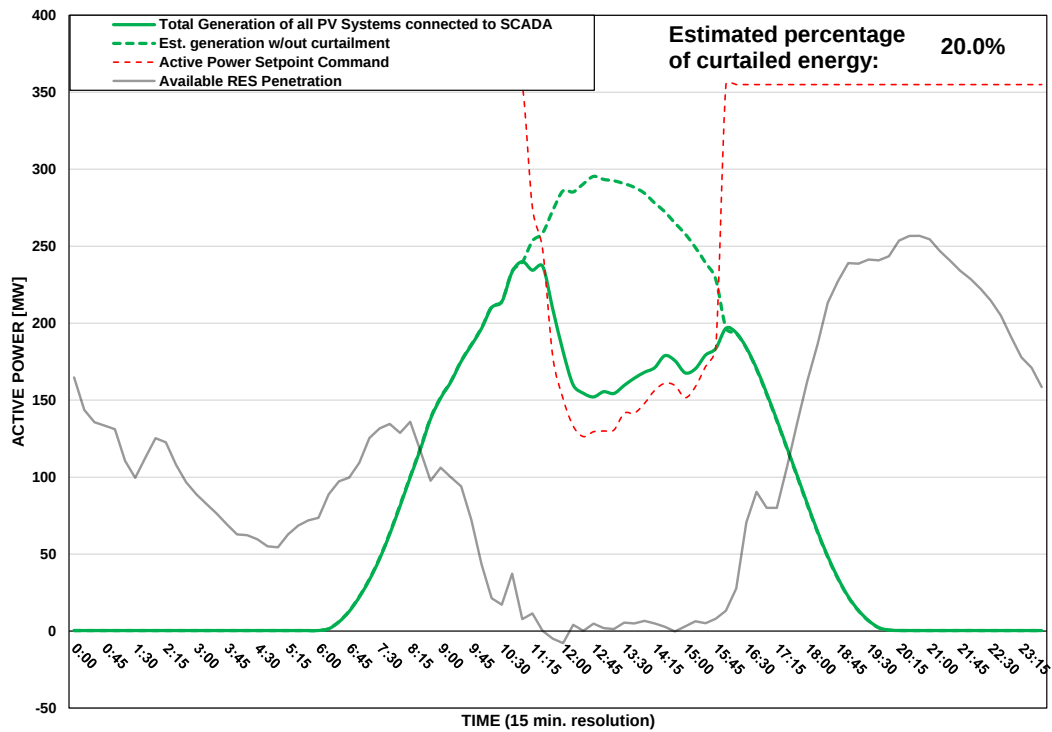

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	31/07/2025
Start of Curtailment	9:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2338.2 MWh
Total Estimated Curtailed Energy:	652.5 MWh
Percentage of Curtailed Energy:	27.9%

Scada PVs Generation on 31/07/2025 (curtailment time: 09:45 - 15:30)

