


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	01/08/2025
Start of Curtailment	9:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2330.2 MWh
Total Estimated Curtailed Energy:	936.9 MWh
Percentage of Curtailed Energy:	40.2%

Scada PVs Generation on 01/08/2025 (curtailment time: 09:15 - 15:45)

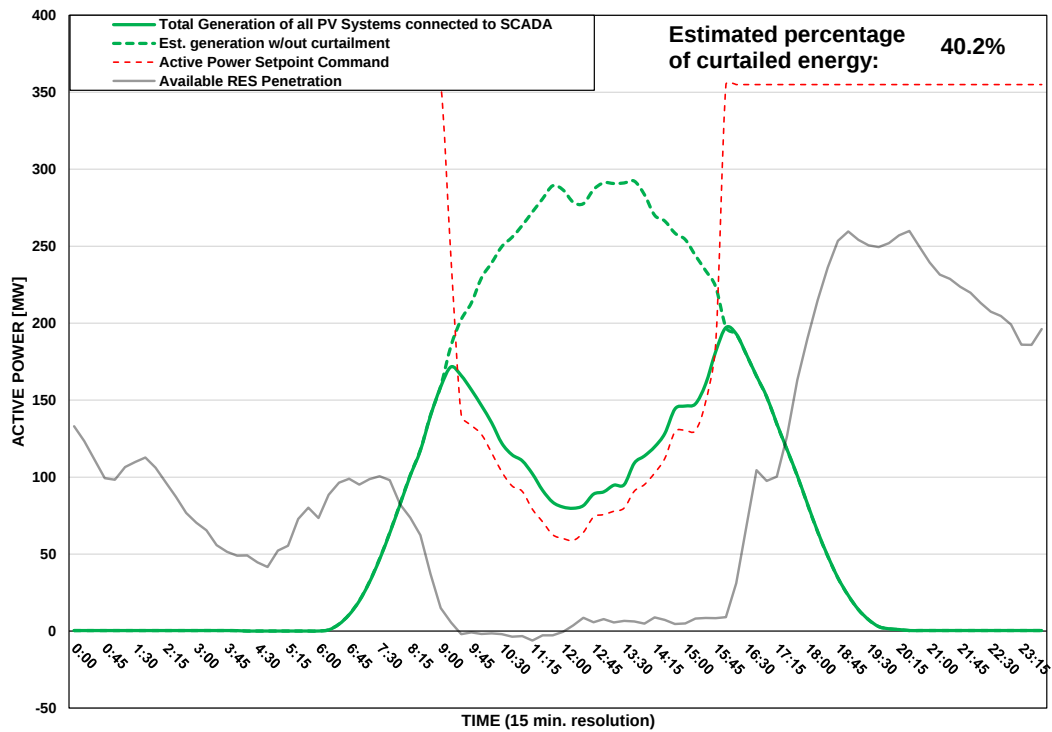

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	02/08/2025
Start of Curtailment	9:00
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2264.9 MWh
Total Estimated Curtailed Energy:	1013.9 MWh
Percentage of Curtailed Energy:	44.8%

Scada PVs Generation on 02/08/2025 (curtailment time: 09:00 - 15:45)

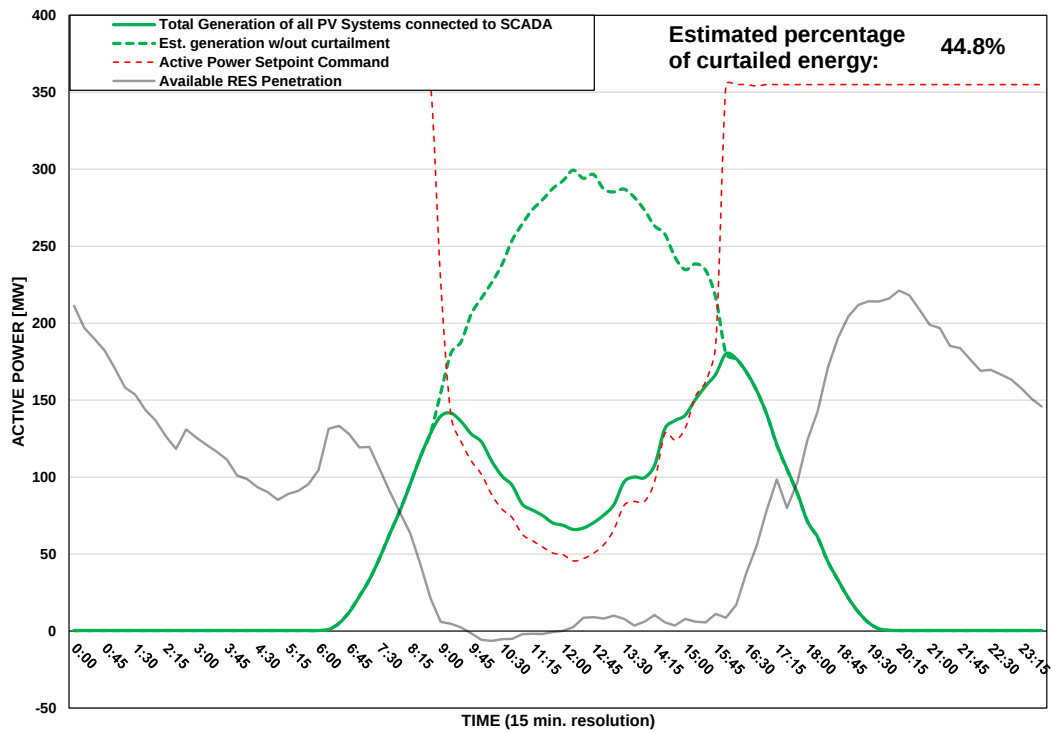


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	03/08/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:15	Cut-off areas using IoT: PV-NIC3, PV-PAF1
End of Curtailment	16:30	
Instruction from TSOC	YES	Start of cut-off: 11:00 End of cut-off: 14:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2324.2 MWh	
Total Estimated Curtailed Energy:	1602.2 MWh	Total Est. Energy of the cut-off PV systems using IoT: 33.1MWh
Percentage of Curtailed Energy:	68.9%	

Scada PVs Generation on 03/08/2025 (curtailment time: 08:15 - 16:30)

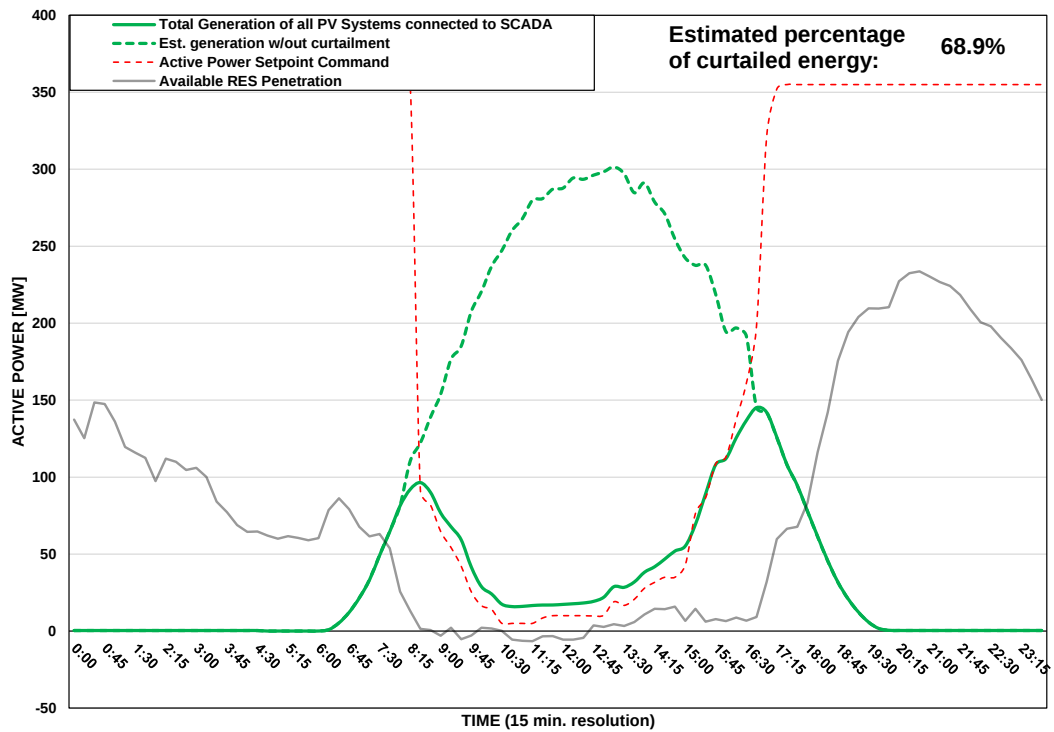

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	04/08/2025
Start of Curtailment	10:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2333.7 MWh
Total Estimated Curtailed Energy:	423.8 MWh
Percentage of Curtailed Energy:	18.2%

Scada PVs Generation on 04/08/2025 (curtailment time: 10:00 - 14:45)

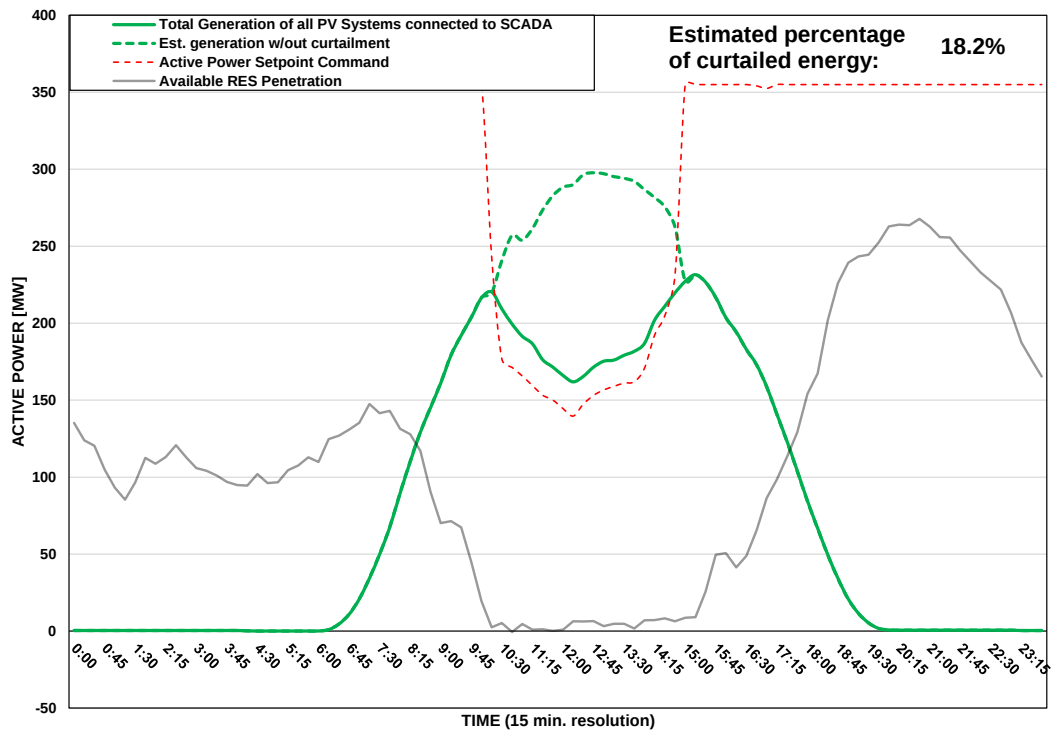


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	05/08/2025
Start of Curtailment	10:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2286.9 MWh
Total Estimated Curtailed Energy:	347.2 MWh
Percentage of Curtailed Energy:	15.2%

Scada PVs Generation on 05/08/2025 (curtailment time: 10:30 - 15:00)

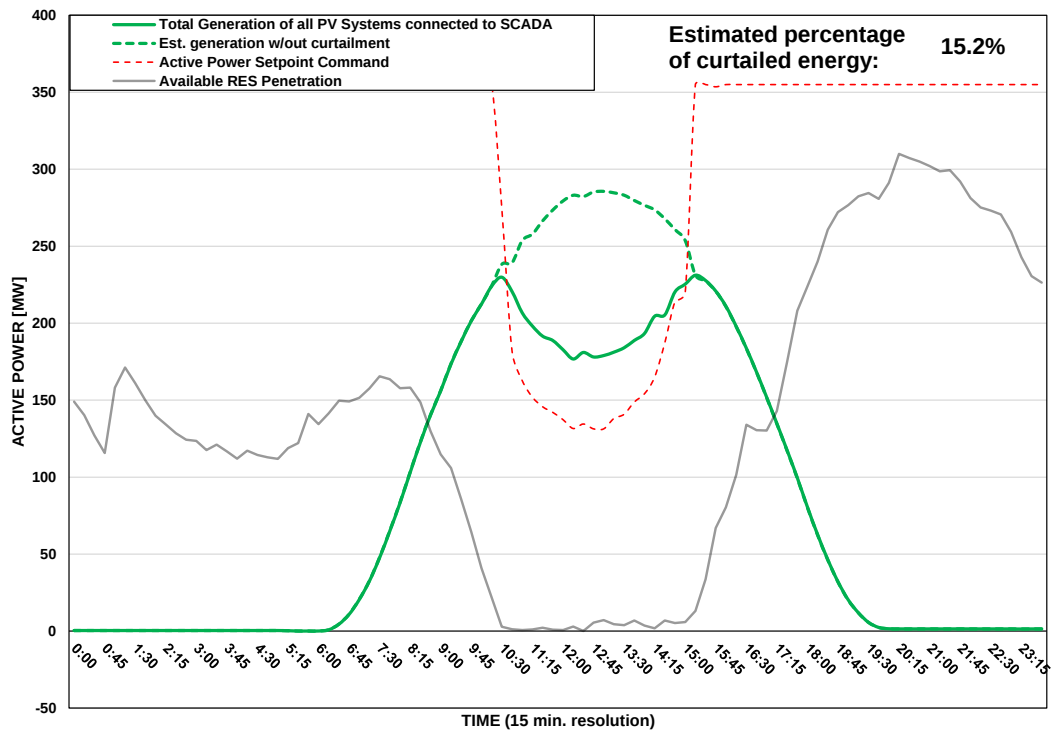

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	06/08/2025
Start of Curtailment	10:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2296 MWh
Total Estimated Curtailed Energy:	456.5 MWh
Percentage of Curtailed Energy:	19.9%

Scada PVs Generation on 06/08/2025 (curtailment time: 10:30 - 15:30)

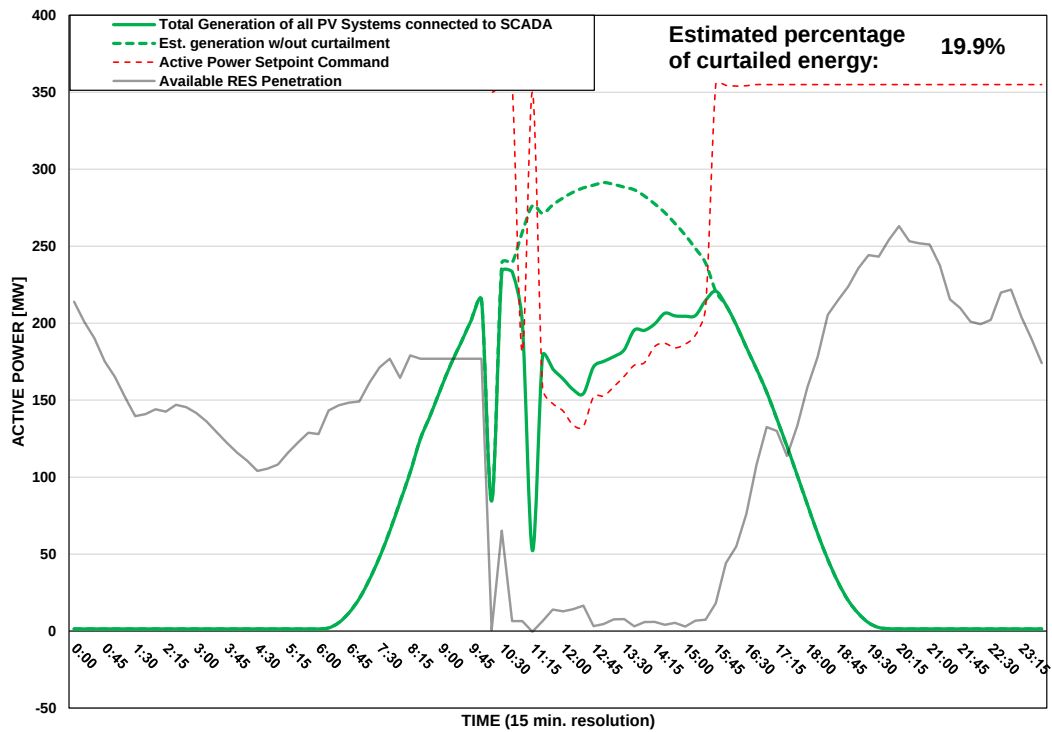


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	07/08/2025
Start of Curtailment	10:00
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2394.5 MWh
Total Estimated Curtailed Energy:	410.3 MWh
Percentage of Curtailed Energy:	17.1%

Scada PVs Generation on 07/08/2025 (curtailment time: 10:00 - 14:45)

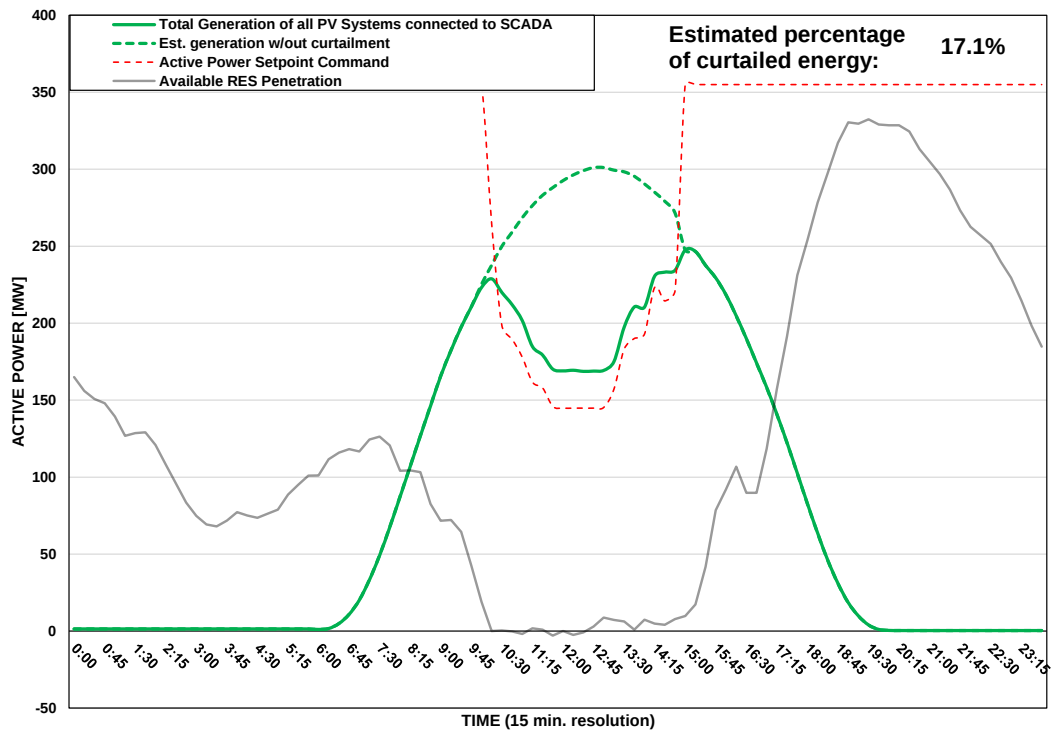


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	08/08/2025
Start of Curtailment	10:15
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2352.2 MWh
Total Estimated Curtailed Energy:	171.6 MWh
Percentage of Curtailed Energy:	7.3%

Scada PVs Generation on 08/08/2025 (curtailment time: 10:15 - 13:30)

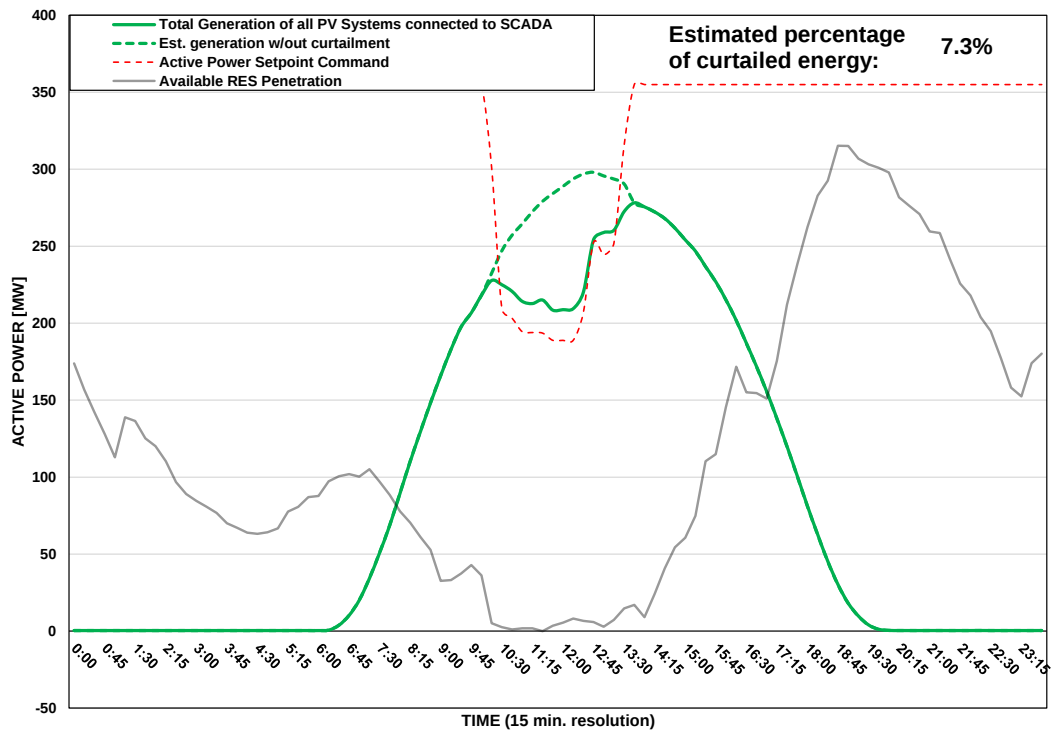

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	09/08/2025
Start of Curtailment	8:45
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2251.4 MWh
Total Estimated Curtailed Energy:	509.2 MWh
Percentage of Curtailed Energy:	22.6%

Scada PVs Generation on 09/08/2025 (curtailment time: 08:45 - 14:30)

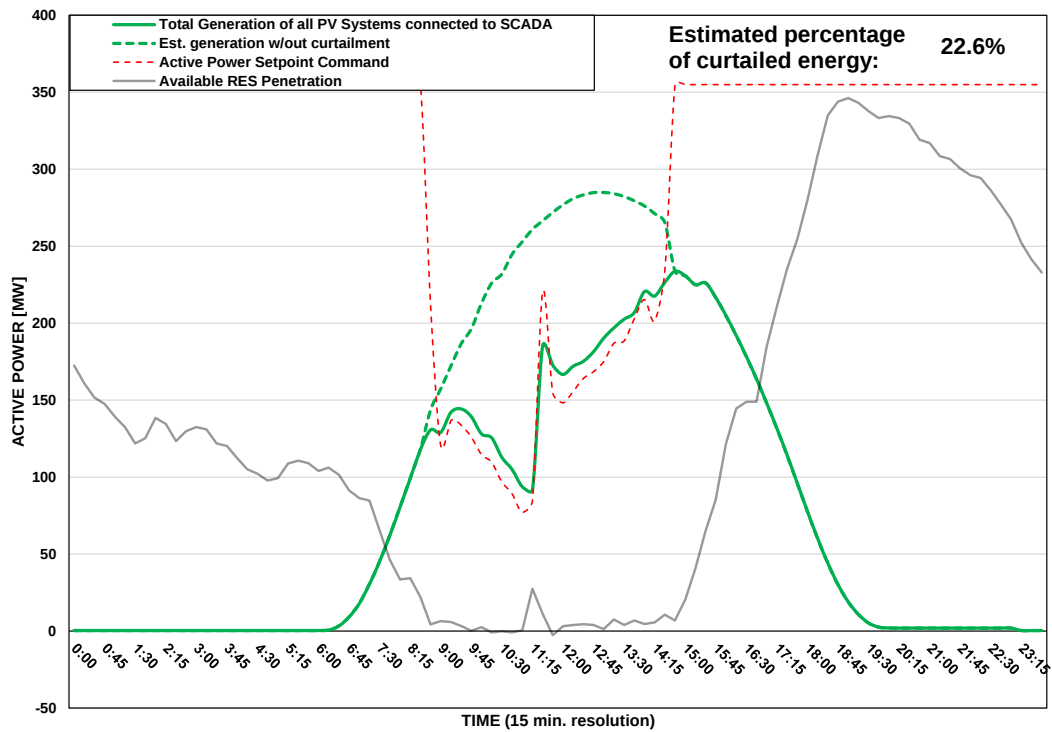

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	10/08/2025
Start of Curtailment	8:30
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2300.3 MWh
Total Estimated Curtailed Energy:	943.7 MWh
Percentage of Curtailed Energy:	41.0%

Scada PVs Generation on 10/08/2025 (curtailment time: 08:30 - 15:15)

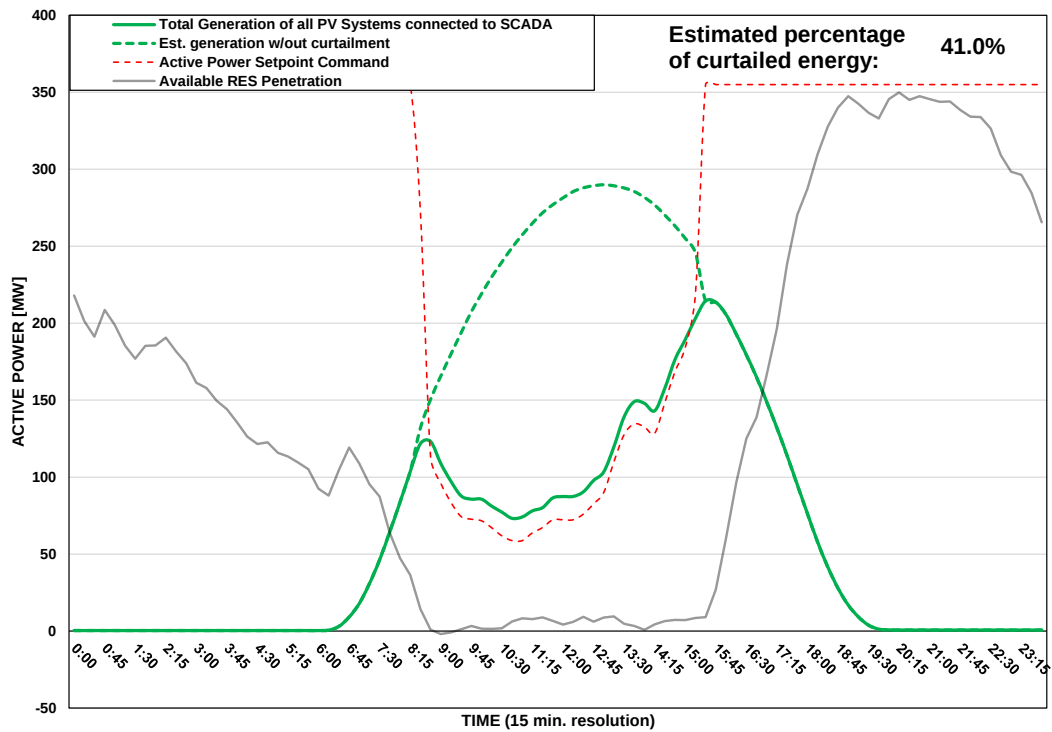

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	11/08/2025
Start of Curtailment	10:30
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2231.6 MWh
Total Estimated Curtailed Energy:	119 MWh
Percentage of Curtailed Energy:	5.3%

Scada PVs Generation on 11/08/2025 (curtailment time: 10:30 - 13:30)

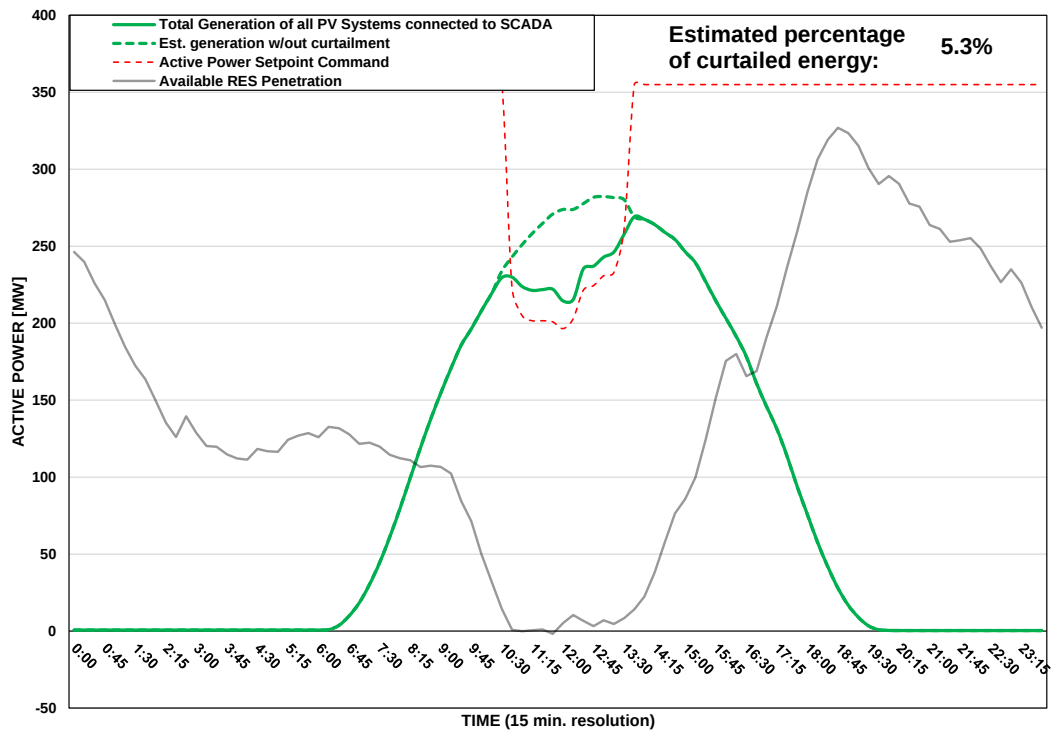

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	12/08/2025
Start of Curtailment	8:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2260 MWh
Total Estimated Curtailed Energy:	527.6 MWh
Percentage of Curtailed Energy:	23.3%

Scada PVs Generation on 12/08/2025 (curtailment time: 08:45 - 14:15)

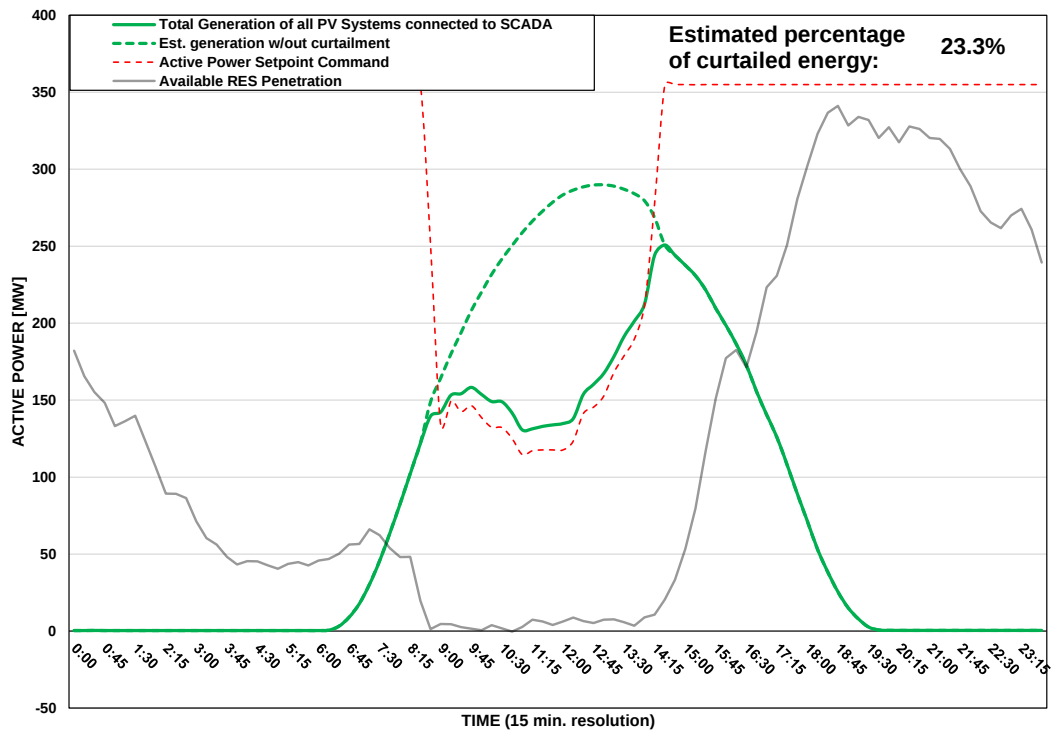

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	13/08/2025
Start of Curtailment	9:30
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2184.7 MWh
Total Estimated Curtailed Energy:	418.3 MWh
Percentage of Curtailed Energy:	19.1%

Scada PVs Generation on 13/08/2025 (curtailment time: 09:30 - 14:00)

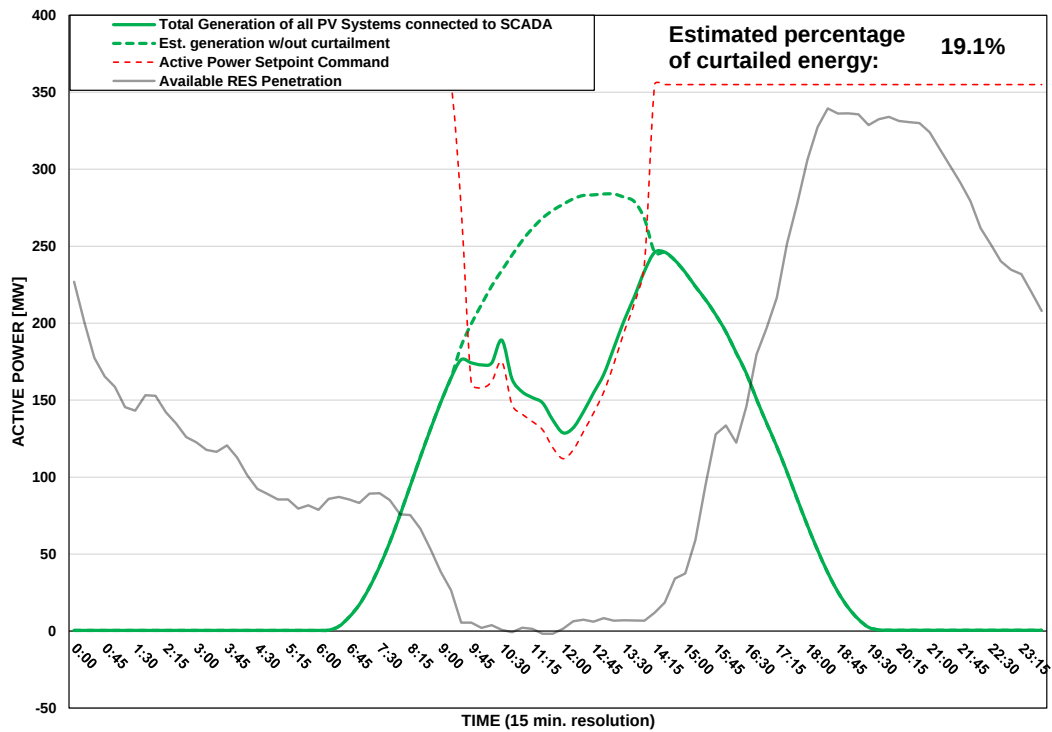


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	14/08/2025
Start of Curtailment	10:15
End of Curtailment	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2114.9 MWh
Total Estimated Curtailed Energy:	285.5 MWh
Percentage of Curtailed Energy:	13.5%

Scada PVs Generation on 14/08/2025 (curtailment time: 10:15 - 14:00)

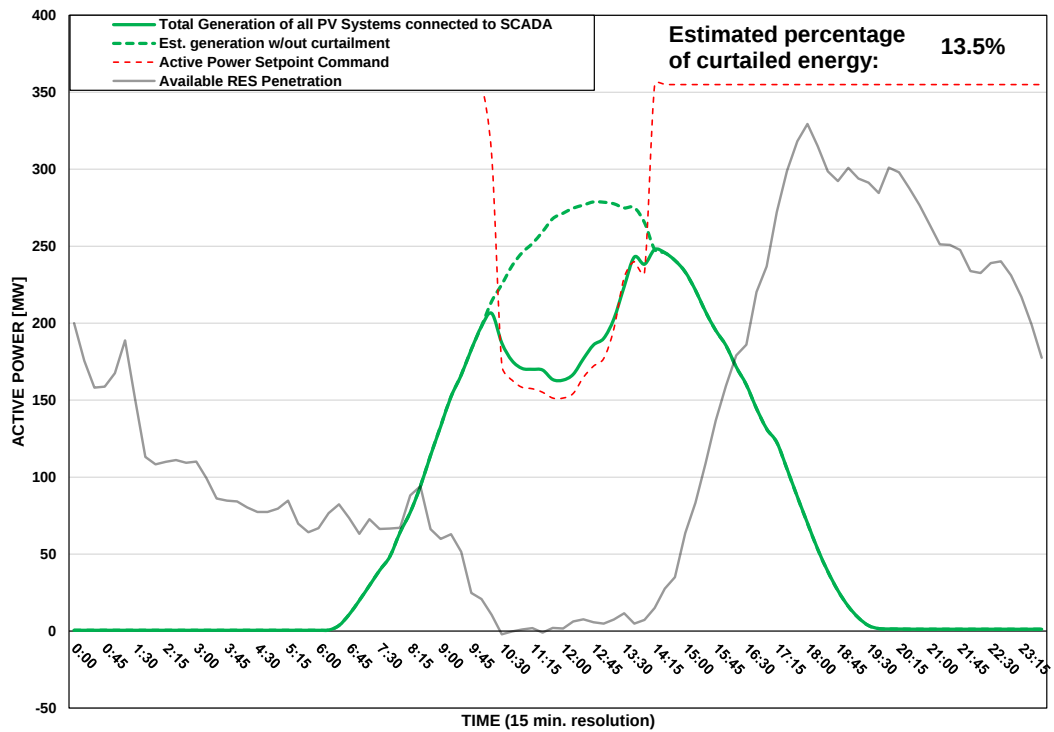

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	15/08/2025
Start of Curtailment	8:15
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2325 MWh
Total Estimated Curtailed Energy:	1418.1 MWh
Percentage of Curtailed Energy:	61.0%

Scada PVs Generation on 15/08/2025 (curtailment time: 08:15 - 16:30)

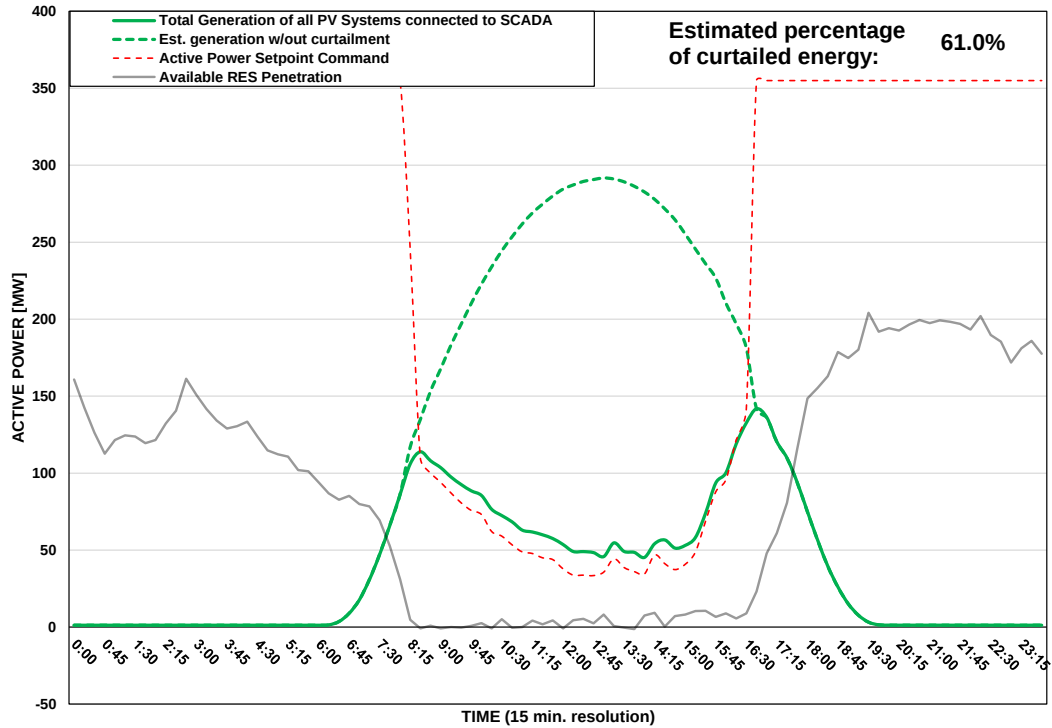


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	16/08/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:30	Cut-off areas using IoT: PV-LIM3
End of Curtailment	16:15	
Instruction from TSOC	YES	Start of cut-off: 11:15 End of cut-off: 13:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2340.5 MWh	
Total Estimated Curtailed Energy:	1369.1 MWh	Total Est. Energy of the cut-off PV systems using IoT: 12.9MWh
Percentage of Curtailed Energy:	58.5%	

Scada PVs Generation on 16/08/2025 (curtailment time: 08:30 - 16:15)

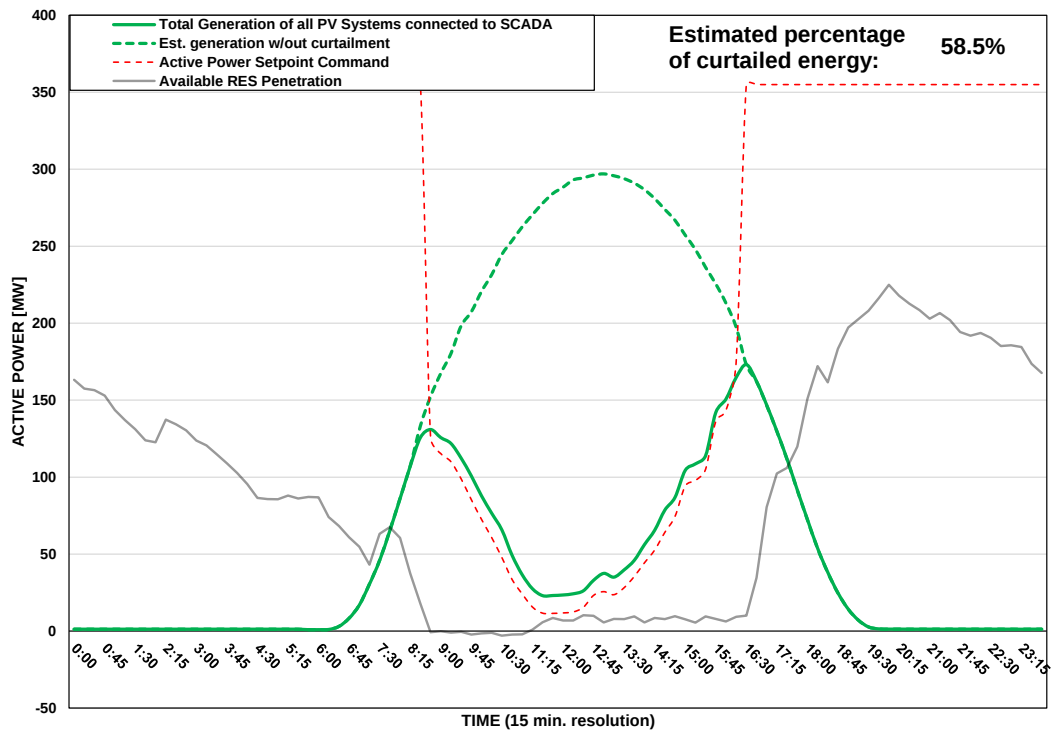


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	17/08/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:30	Cut-off areas using IoT: PV-NIC2, PV-LCA/FAM3
End of Curtailment	16:30	
Instruction from TSOC	YES	Start of cut-off: 10:45 End of cut-off: 14:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2286.5 MWh	
Total Estimated Curtailed Energy:	1519.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 85.8MWh
Percentage of Curtailed Energy:	66.4%	

Scada PVs Generation on 17/08/2025 (curtailment time: 08:30 - 16:30)

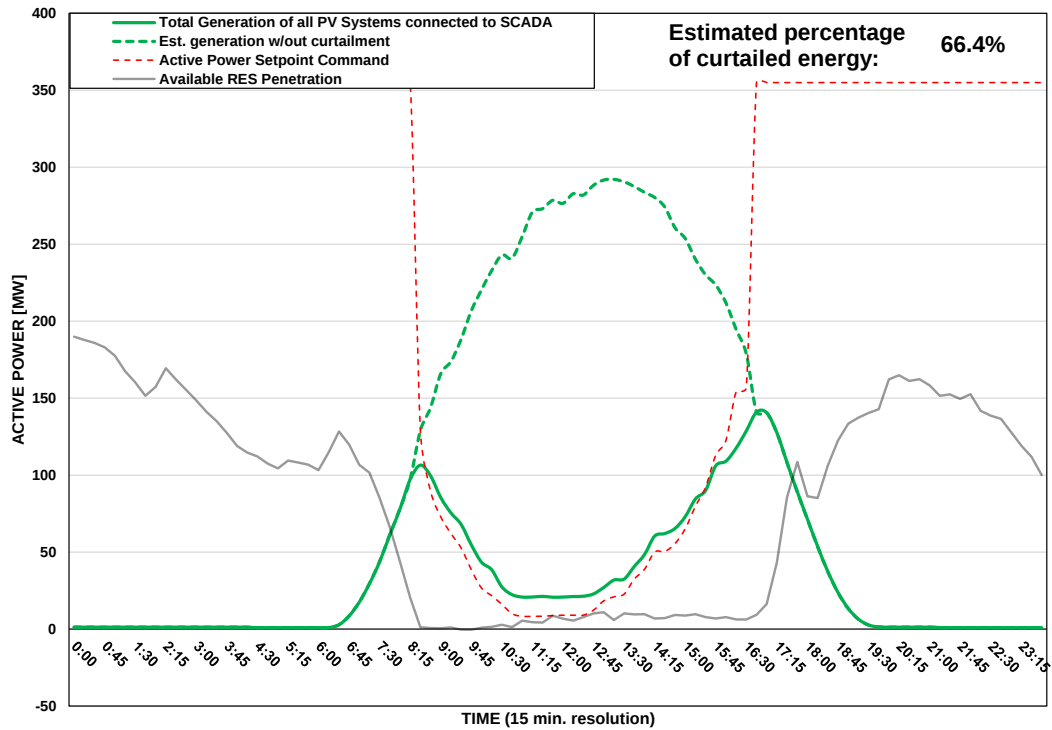


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	18/08/2025
Start of Curtailment	9:30
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2309.4 MWh
Total Estimated Curtailed Energy:	897.6 MWh
Percentage of Curtailed Energy:	38.9%

Scada PVs Generation on 18/08/2025 (curtailment time: 09:30 - 16:00)

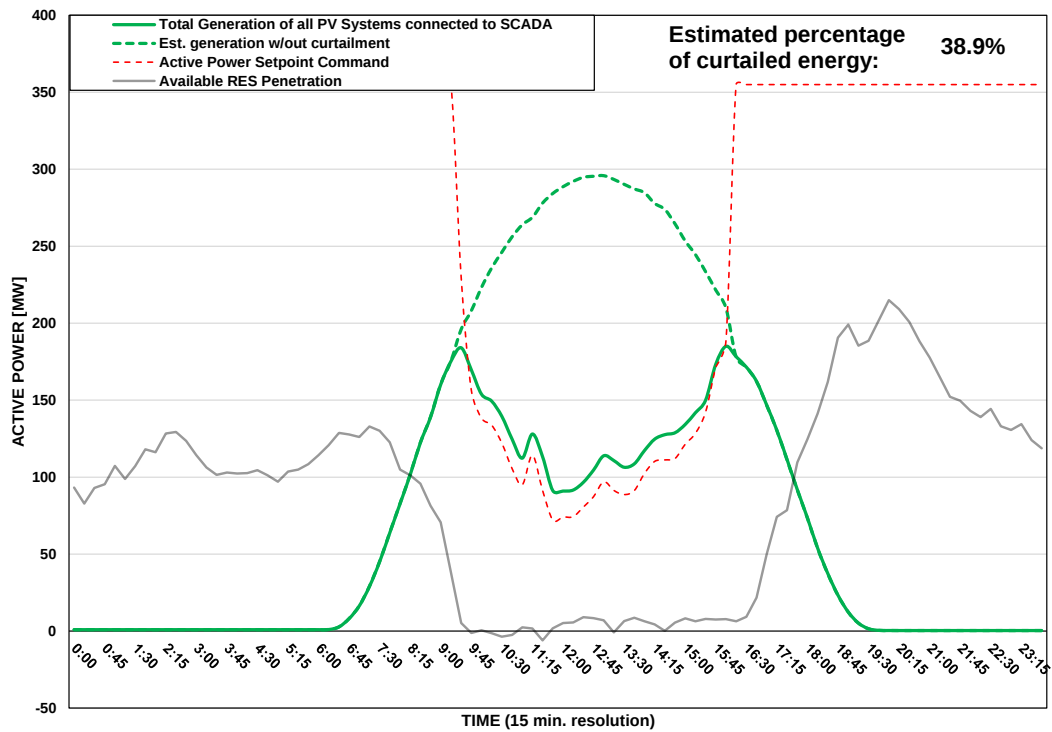


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/08/2025
Start of Curtailment	8:45
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2306.7 MWh
Total Estimated Curtailed Energy:	1033.6 MWh
Percentage of Curtailed Energy:	44.8%

Scada PVs Generation on 19/08/2025 (curtailment time: 08:45 - 16:00)

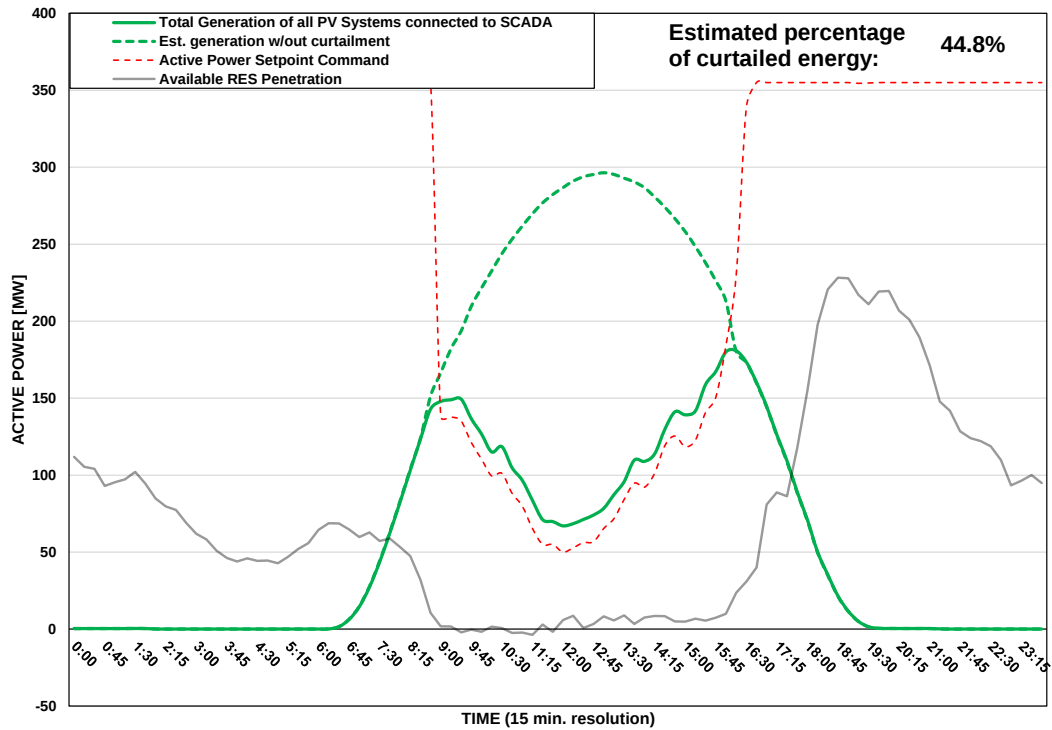


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	20/08/2025
Start of Curtailment	9:00
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2331.9 MWh
Total Estimated Curtailed Energy:	1018.2 MWh
Percentage of Curtailed Energy:	43.7%

Scada PVs Generation on 20/08/2025 (curtailment time: 09:00 - 16:15)

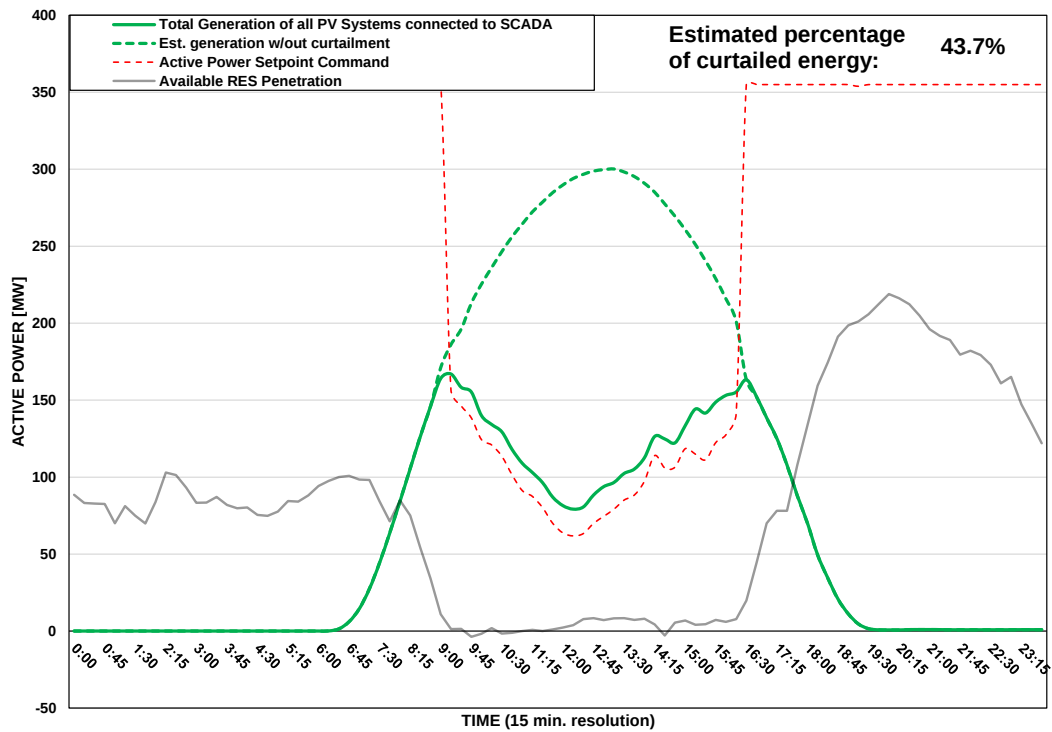

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	21/08/2025
Start of Curtailment	9:30
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2177.7 MWh
Total Estimated Curtailed Energy:	457.2 MWh
Percentage of Curtailed Energy:	21.0%

Scada PVs Generation on 21/08/2025 (curtailment time: 09:30 - 14:30)

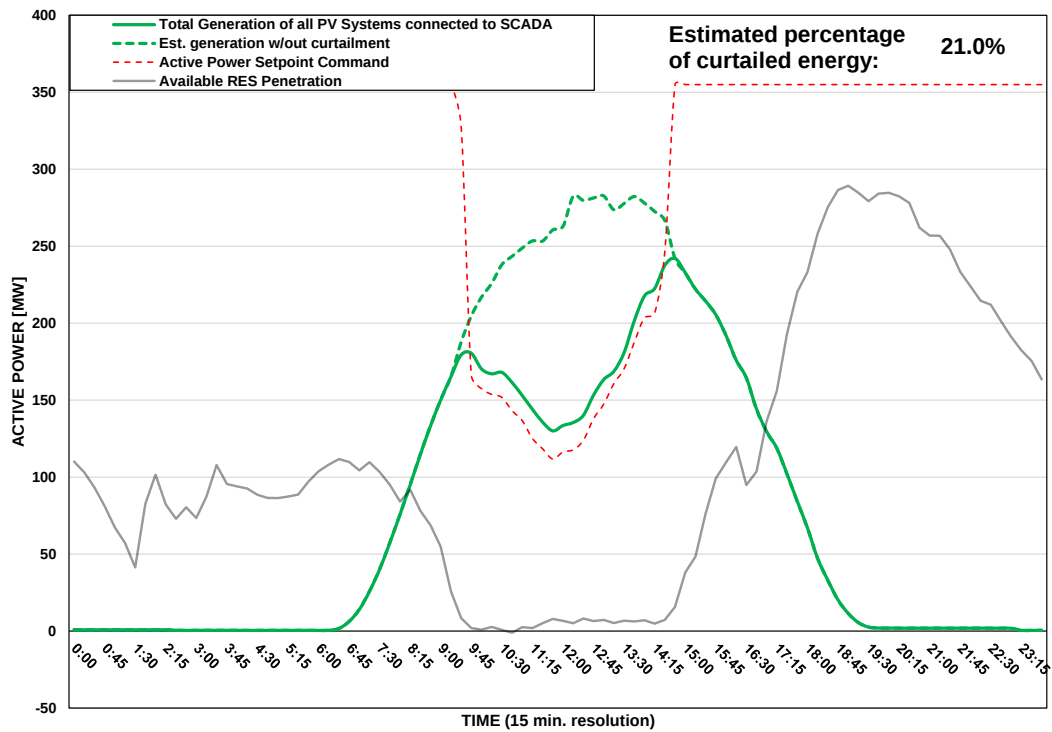


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	22/08/2025
Start of Curtailment	10:00
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2234.4 MWh
Total Estimated Curtailed Energy:	260.4 MWh
Percentage of Curtailed Energy:	11.7%

Scada PVs Generation on 22/08/2025 (curtailment time: 10:00 - 14:15)

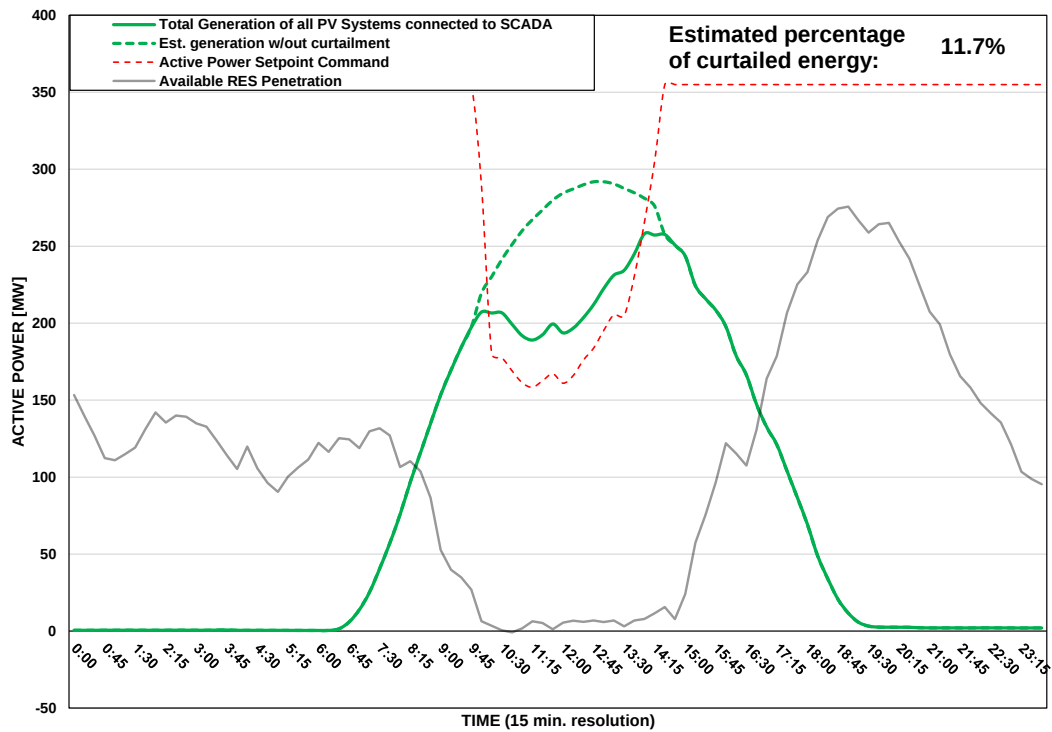

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	23/08/2025
Start of Curtailment	8:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2284.9 MWh
Total Estimated Curtailed Energy:	698.6 MWh
Percentage of Curtailed Energy:	30.6%

Scada PVs Generation on 23/08/2025 (curtailment time: 08:45 - 15:30)

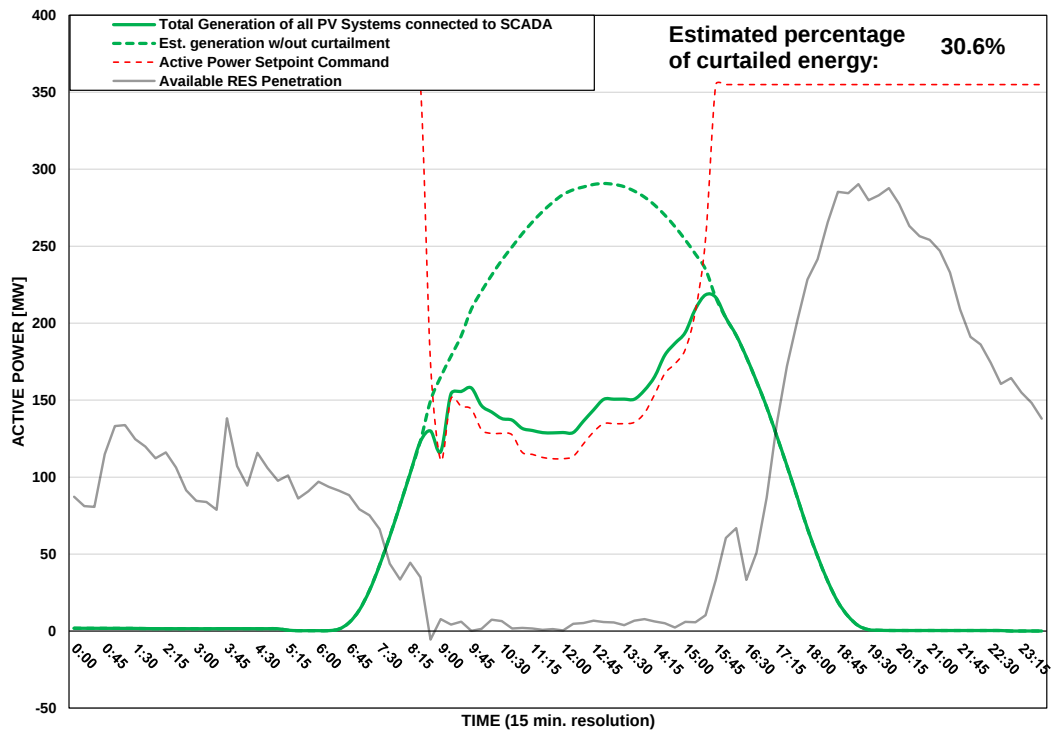


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	24/08/2025
Start of Curtailment	8:45
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2267.9 MWh
Total Estimated Curtailed Energy:	1093.8 MWh
Percentage of Curtailed Energy:	48.2%

Scada PVs Generation on 24/08/2025 (curtailment time: 08:45 - 16:15)

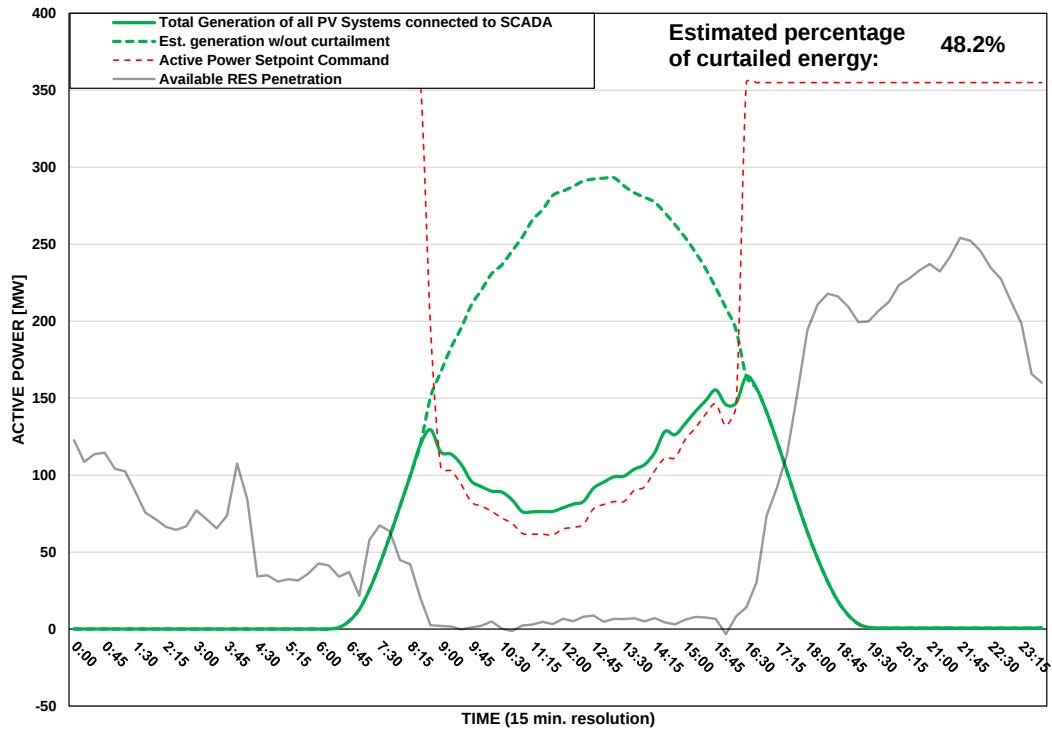

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	25/08/2025
Start of Curtailment	10:45
End of Curtailment	13:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2120.3 MWh
Total Estimated Curtailed Energy:	192.2 MWh
Percentage of Curtailed Energy:	9.1%

Scada PVs Generation on 25/08/2025 (curtailment time: 10:45 - 13:30)

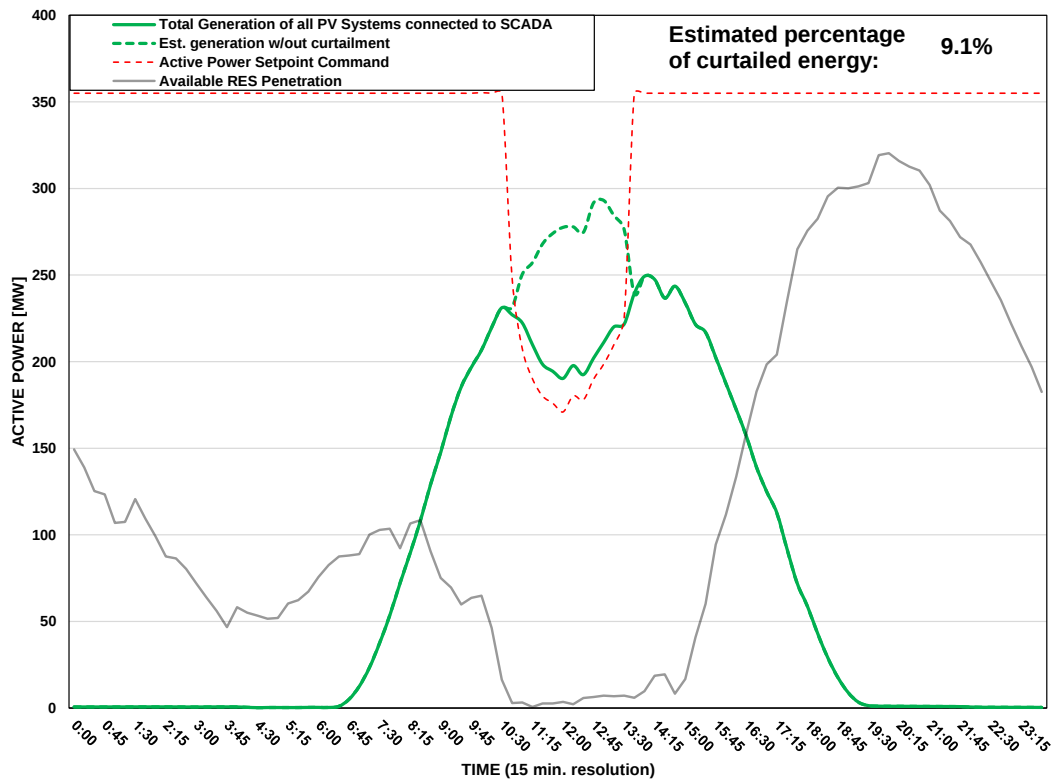


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	26/08/2025
Start of Curtailment	10:30
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2155 MWh
Total Estimated Curtailed Energy:	254.2 MWh
Percentage of Curtailed Energy:	11.8%

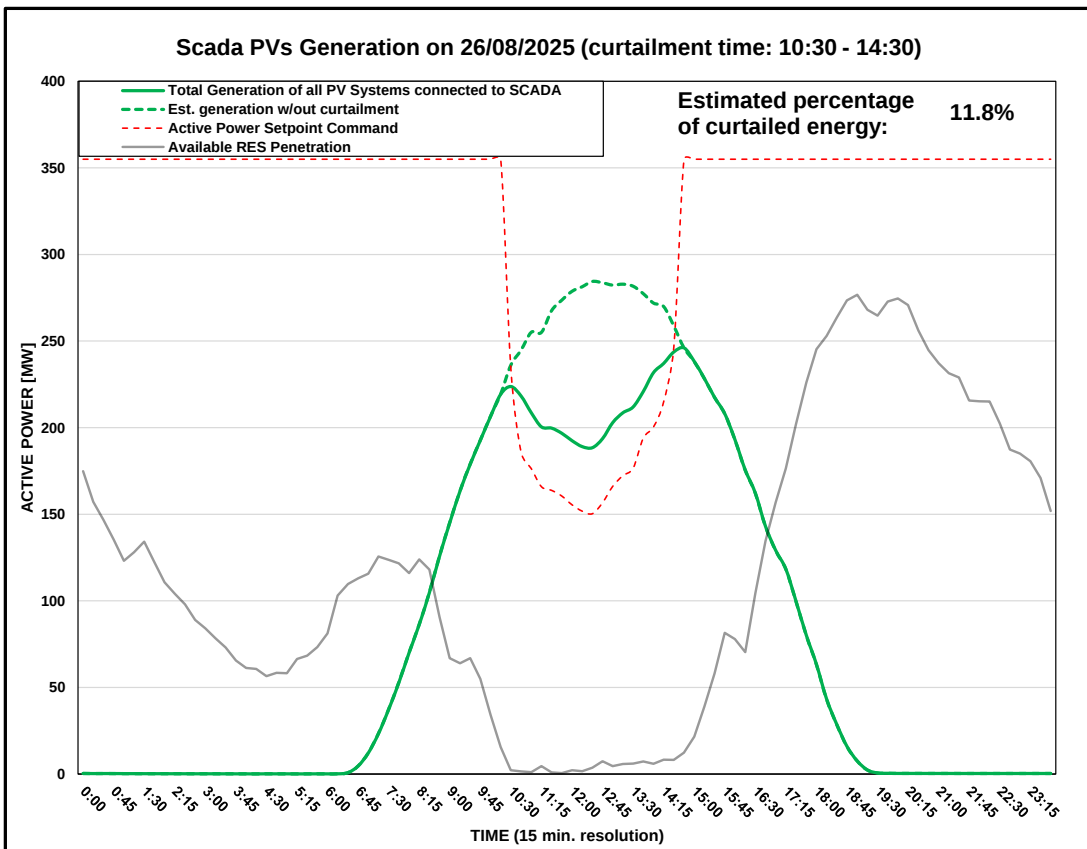

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	27/08/2025
Start of Curtailment	9:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2117.5 MWh
Total Estimated Curtailed Energy:	492.2 MWh
Percentage of Curtailed Energy:	23.2%

Scada PVs Generation on 27/08/2025 (curtailment time: 09:45 - 15:30)

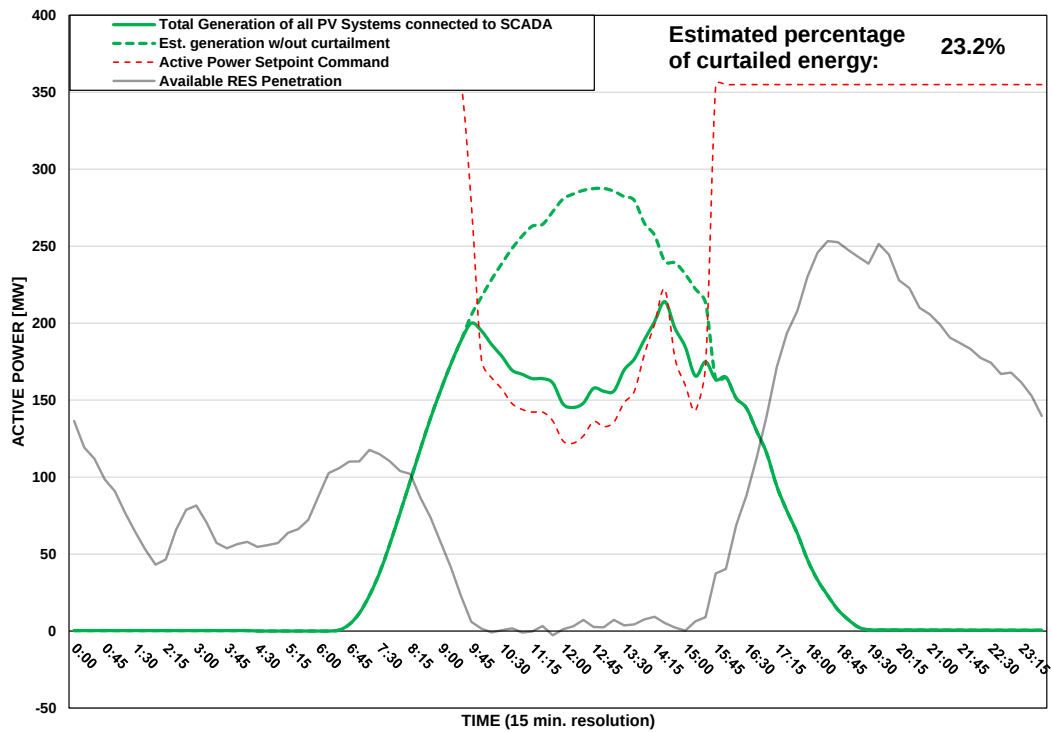


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	28/08/2025
Start of Curtailment	9:15
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2239.9 MWh
Total Estimated Curtailed Energy:	1011.6 MWh
Percentage of Curtailed Energy:	45.2%

Scada PVs Generation on 28/08/2025 (curtailment time: 09:15 - 16:15)

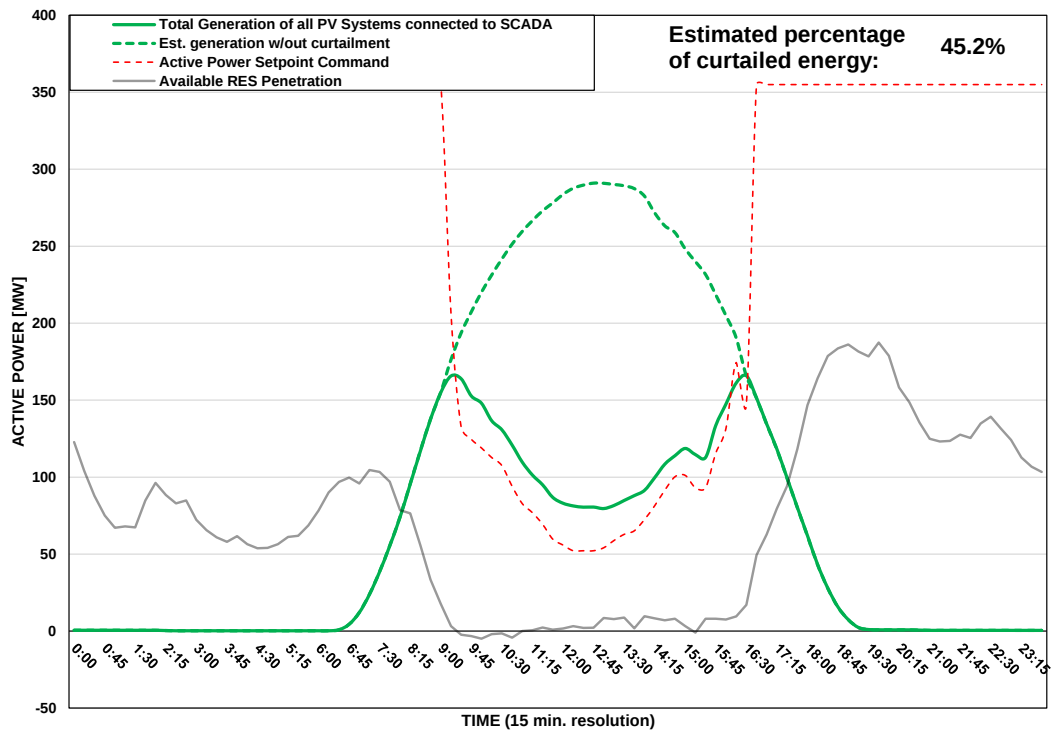

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	29/08/2025
Start of Curtailment	9:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2249.6 MWh
Total Estimated Curtailed Energy:	973.8 MWh
Percentage of Curtailed Energy:	43.3%

Scada PVs Generation on 29/08/2025 (curtailment time: 09:15 - 16:00)

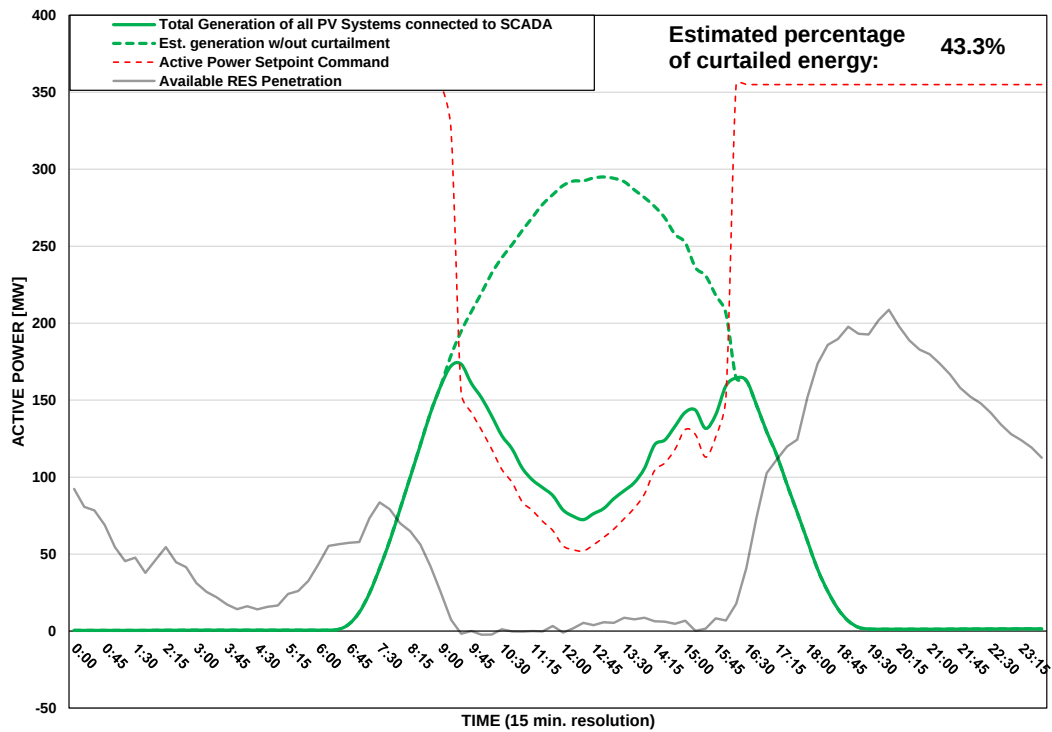

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	30/08/2025
Start of Curtailment	9:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2212.2 MWh
Total Estimated Curtailed Energy:	1110.5 MWh
Percentage of Curtailed Energy:	50.2%

Scada PVs Generation on 30/08/2025 (curtailment time: 09:00 - 16:00)

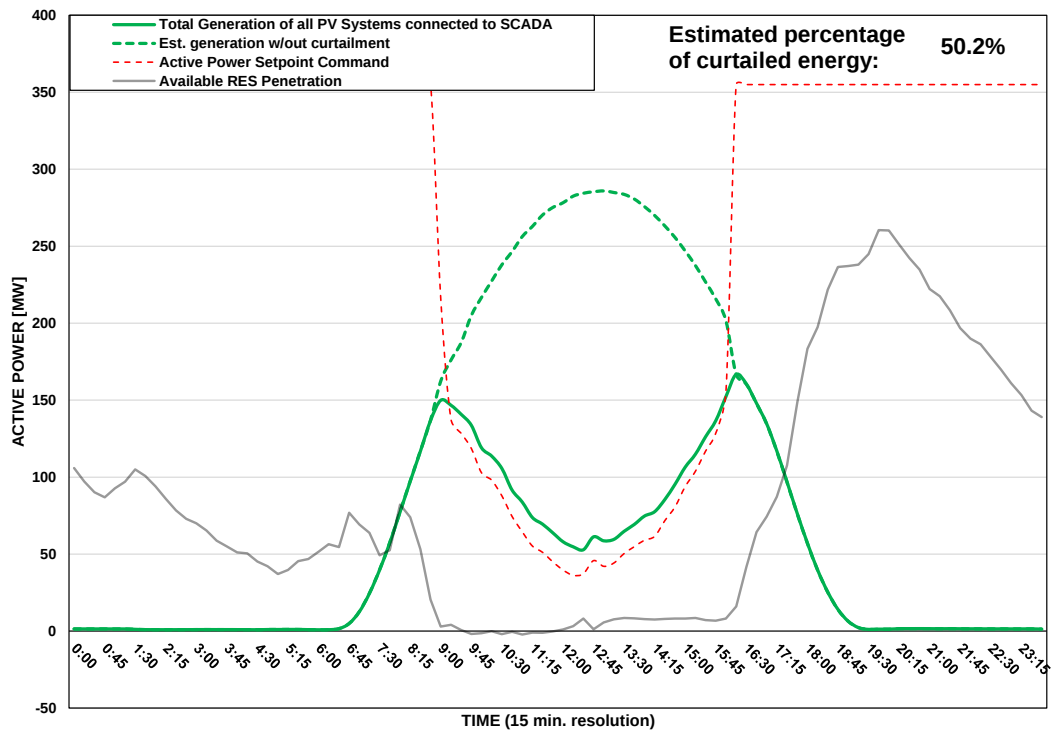

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	31/08/2025
Start of Curtailment	7:45
End of Curtailment	16:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2269.4 MWh
Total Estimated Curtailed Energy:	1441.1 MWh
Percentage of Curtailed Energy:	63.5%

Scada PVs Generation on 31/08/2025 (curtailment time: 07:45 - 16:45)

