


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	01/09/2025
Start of Curtailment	9:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2243.4 MWh
Total Estimated Curtailed Energy:	488.5 MWh
Percentage of Curtailed Energy:	21.8%

Scada PVs Generation on 01/09/2025 (curtailment time: 09:45 - 15:45)

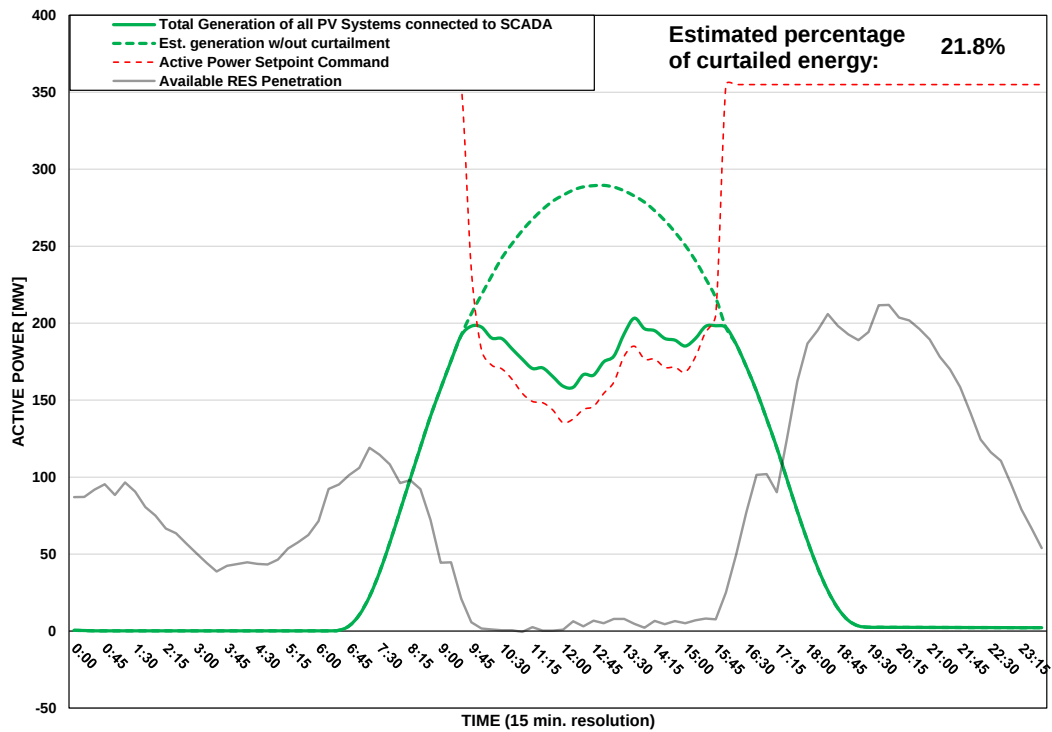


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	02/09/2025
Start of Curtailment	10:15
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2222.4 MWh
Total Estimated Curtailed Energy:	363.1 MWh
Percentage of Curtailed Energy:	16.3%

Scada PVs Generation on 02/09/2025 (curtailment time: 10:15 - 15:15)

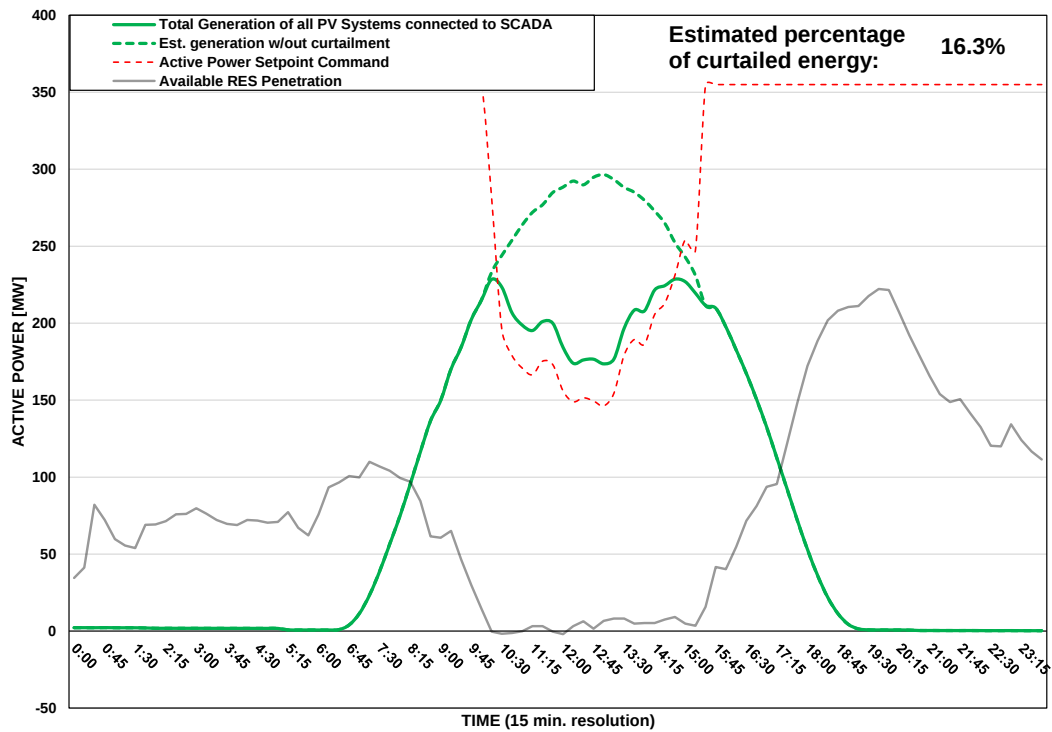

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	03/09/2025
Start of Curtailment	10:30
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2059.9 MWh
Total Estimated Curtailed Energy:	437.9 MWh
Percentage of Curtailed Energy:	21.3%

Scada PVs Generation on 03/09/2025 (curtailment time: 10:30 - 15:30)

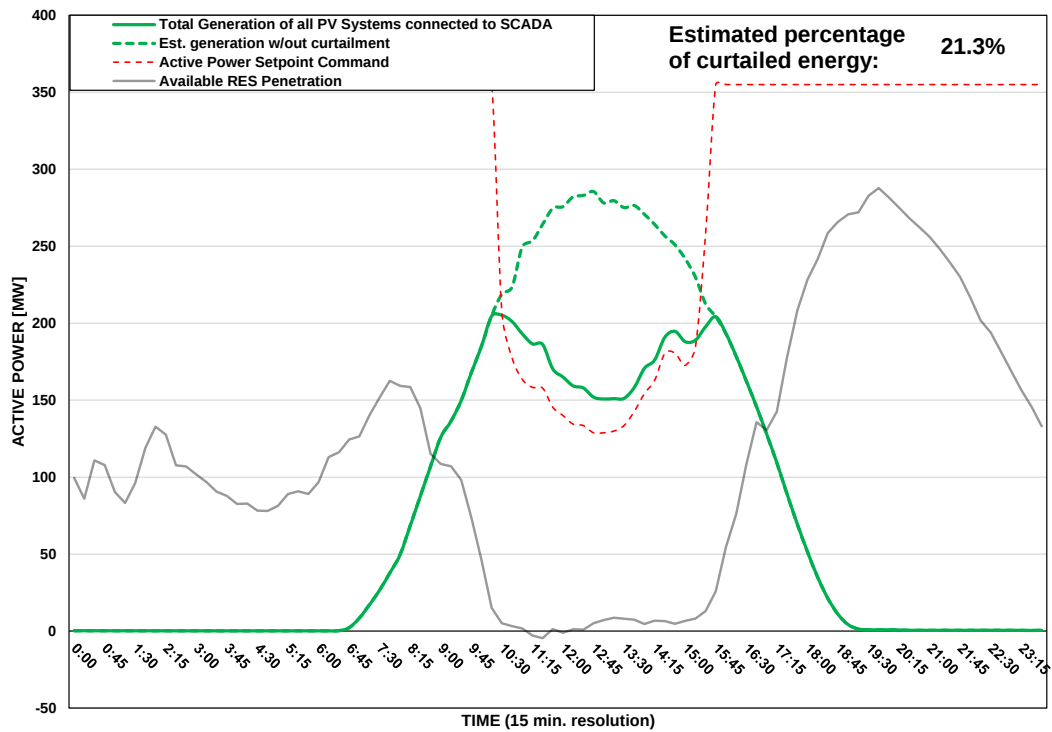

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	04/09/2025
Start of Curtailment	10:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2114.5 MWh
Total Estimated Curtailed Energy:	555.6 MWh
Percentage of Curtailed Energy:	26.3%

Scada PVs Generation on 04/09/2025 (curtailment time: 10:00 - 15:15)

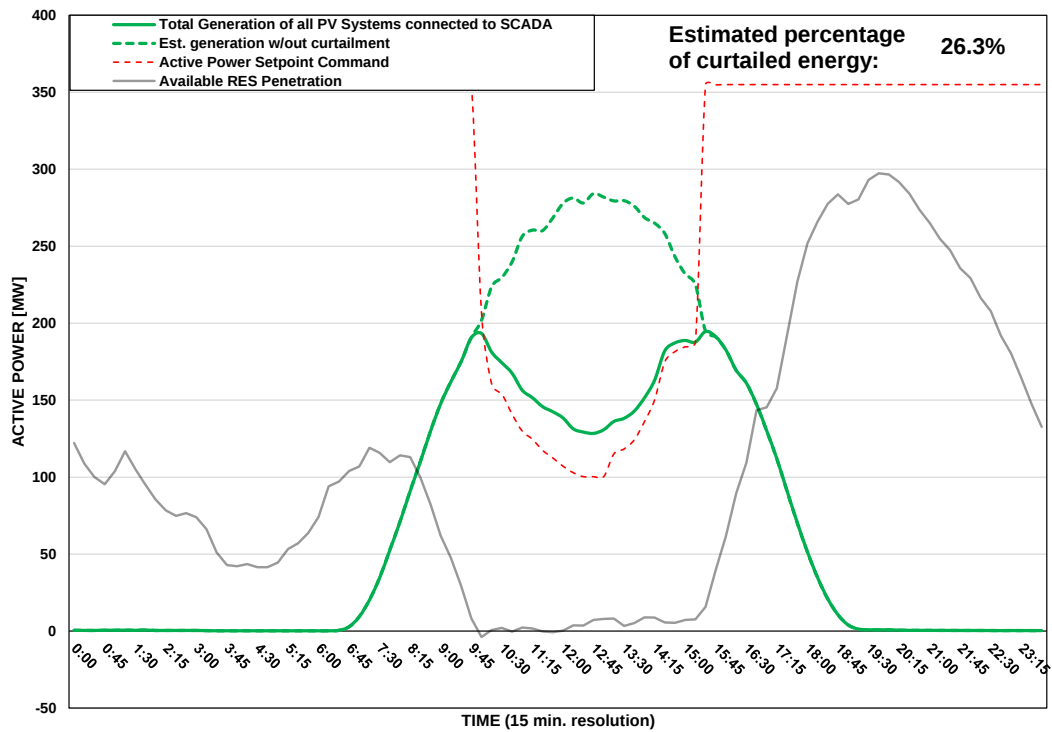


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	05/09/2025
Start of Curtailment	9:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2132.3 MWh
Total Estimated Curtailed Energy:	429.4 MWh
Percentage of Curtailed Energy:	20.1%

Scada PVs Generation on 05/09/2025 (curtailment time: 09:45 - 14:15)

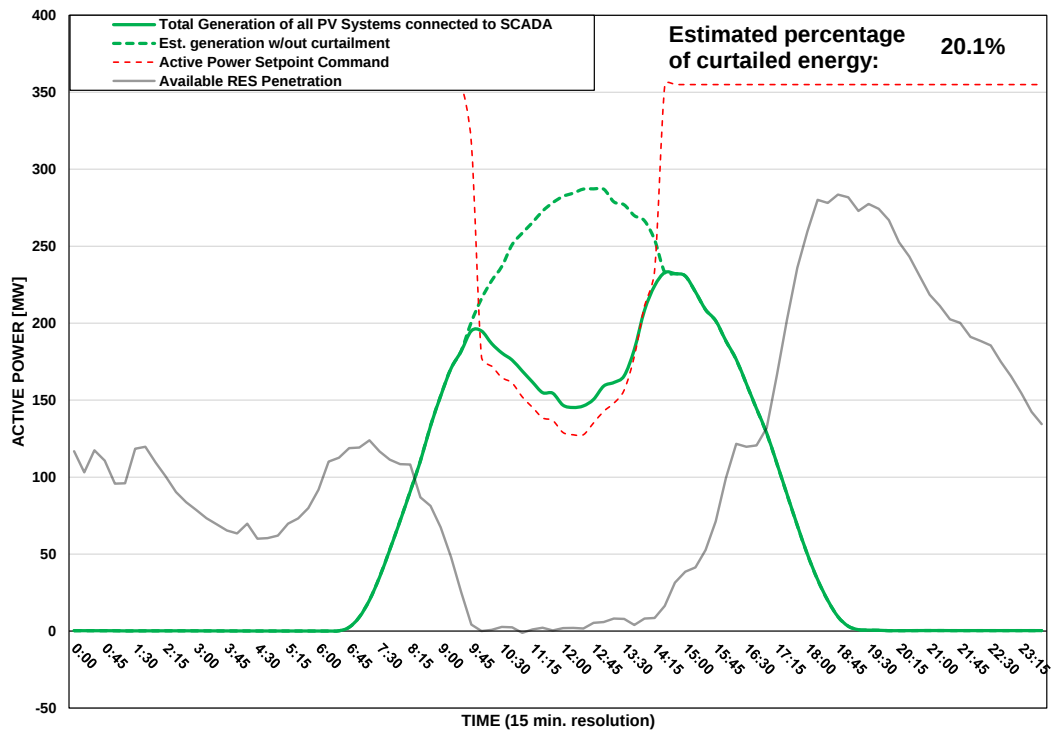

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	06/09/2025
Start of Curtailment	9:15
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2101 MWh
Total Estimated Curtailed Energy:	695.1 MWh
Percentage of Curtailed Energy:	33.1%

Scada PVs Generation on 06/09/2025 (curtailment time: 09:15 - 16:00)

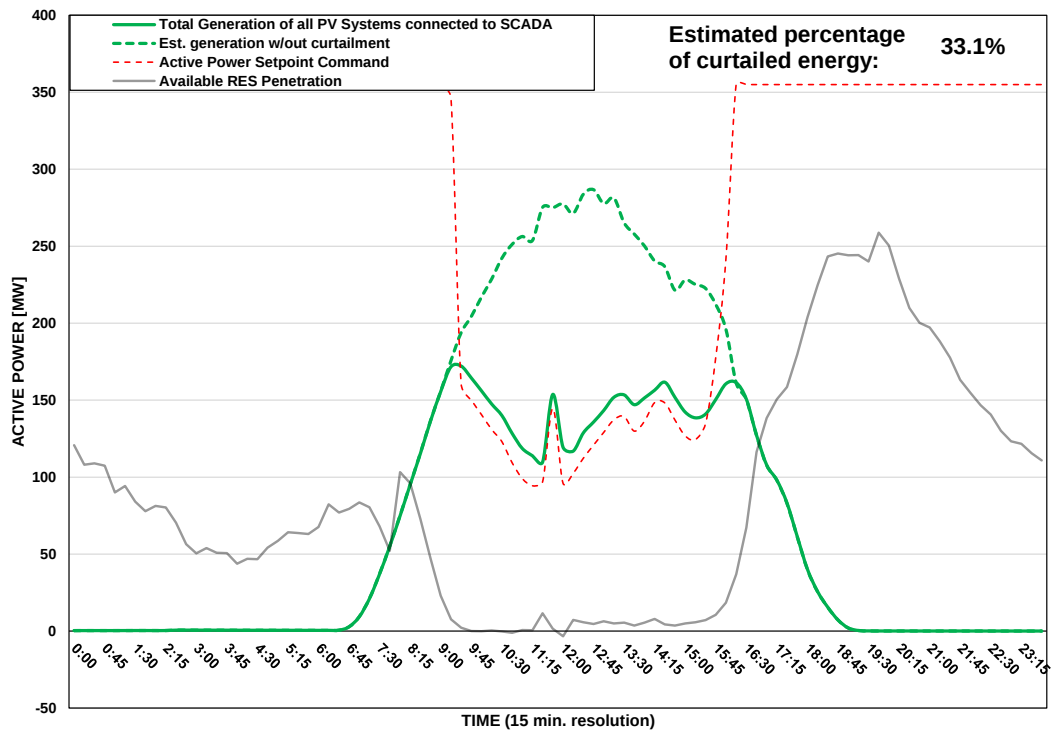


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	07/09/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:30	Cut-off areas using IoT: PV-NIC1
End of Curtailment	17:00	
Instruction from TSOC	YES	Start of cut-off: 11:30 End of cut-off: 14:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2150.8 MWh	
Total Estimated Curtailed Energy:	1446.5 MWh	Total Est. Energy of the cut-off PV systems using IoT: 42.2MWh
Percentage of Curtailed Energy:	67.3%	

Scada PVs Generation on 07/09/2025 (curtailment time: 08:30 - 17:00)

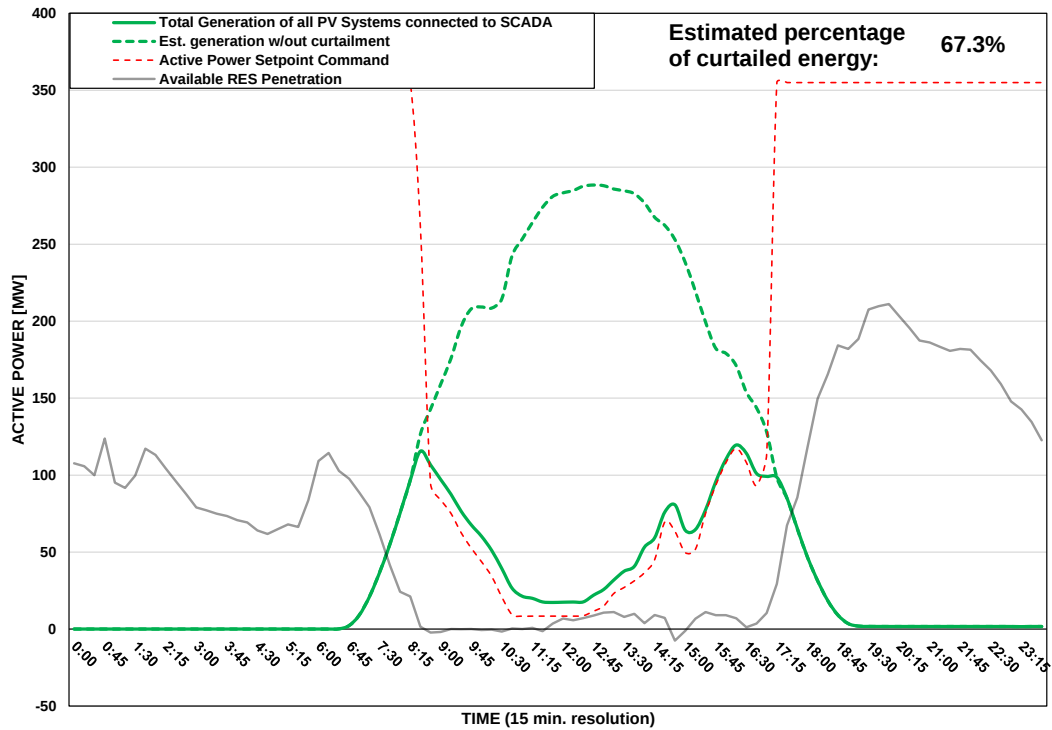

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	08/09/2025
Start of Curtailment	9:15
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2028.2 MWh
Total Estimated Curtailed Energy:	805.5 MWh
Percentage of Curtailed Energy:	39.7%

Scada PVs Generation on 08/09/2025 (curtailment time: 09:15 - 15:30)

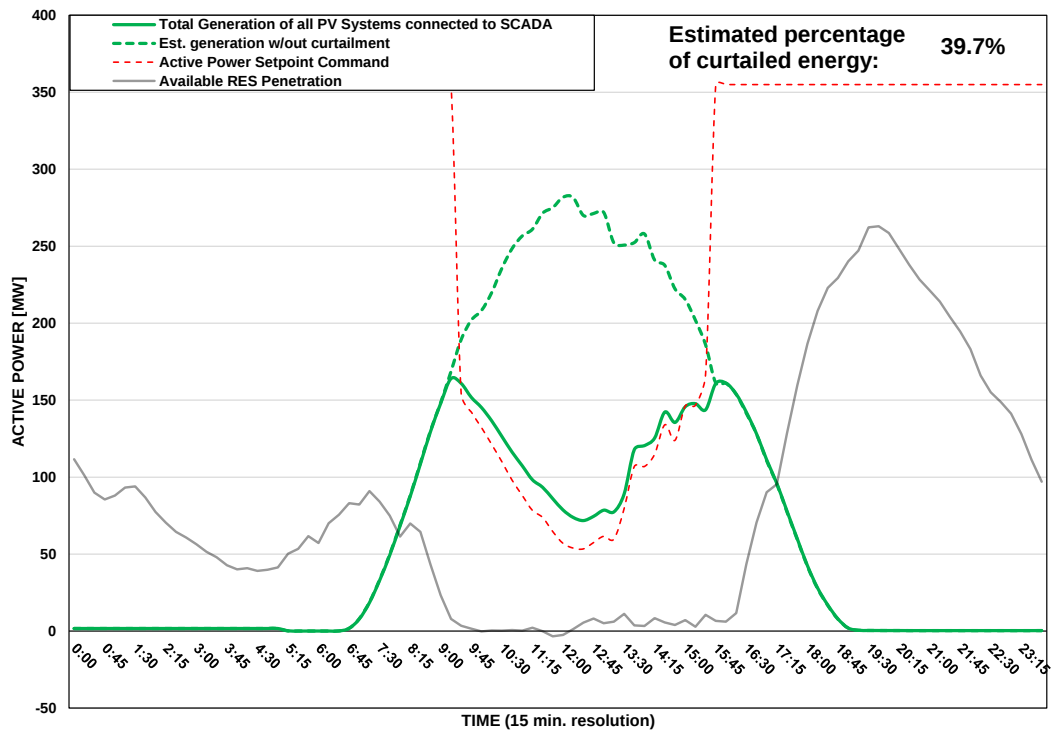


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	09/09/2025
Start of Curtailment	9:15
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1934.5 MWh
Total Estimated Curtailed Energy:	727.8 MWh
Percentage of Curtailed Energy:	37.6%

Scada PVs Generation on 09/09/2025 (curtailment time: 09:15 - 14:30)

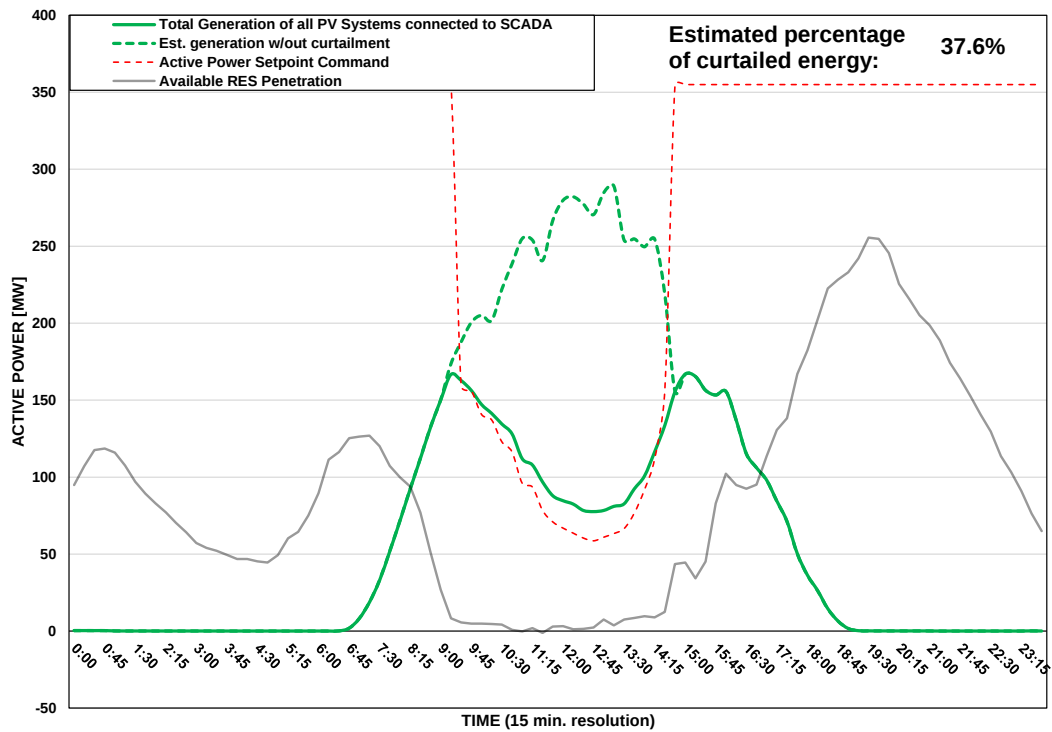


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	10/09/2025
Start of Curtailment	9:00
End of Curtailment	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2165 MWh
Total Estimated Curtailed Energy:	1026 MWh
Percentage of Curtailed Energy:	47.4%

Scada PVs Generation on 10/09/2025 (curtailment time: 09:00 - 16:30)

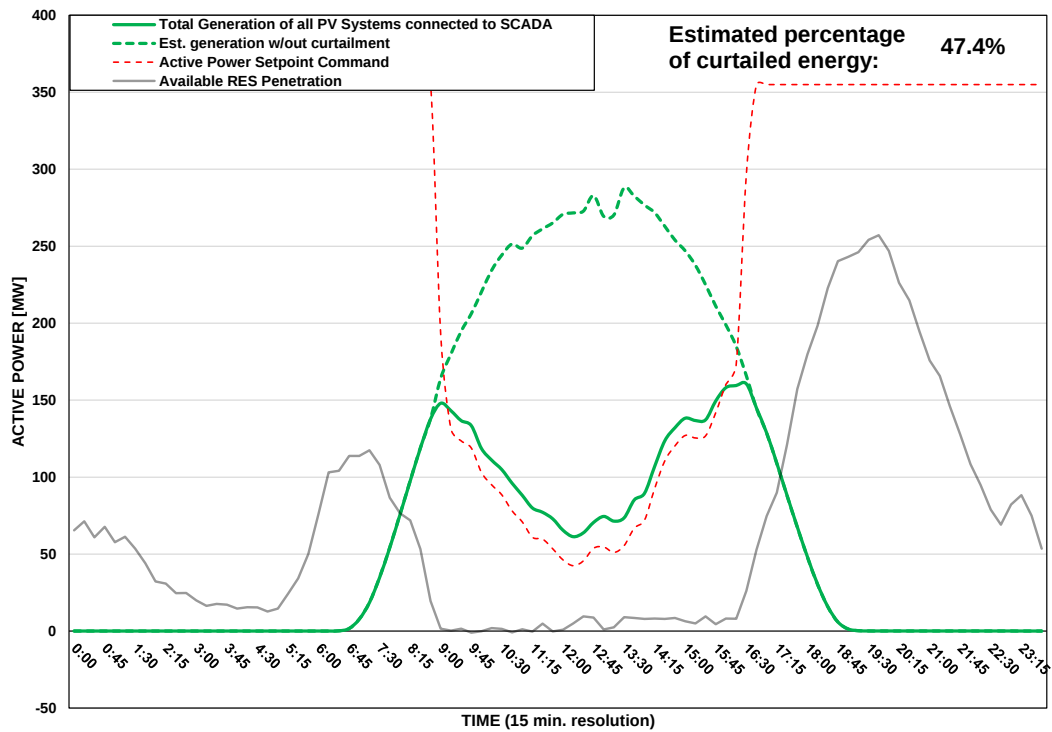

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	11/09/2025
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2221.2 MWh
Total Estimated Curtailed Energy:	1030.7 MWh
Percentage of Curtailed Energy:	46.4%

Scada PVs Generation on 11/09/2025 (curtailment time: 08:45 - 15:45)

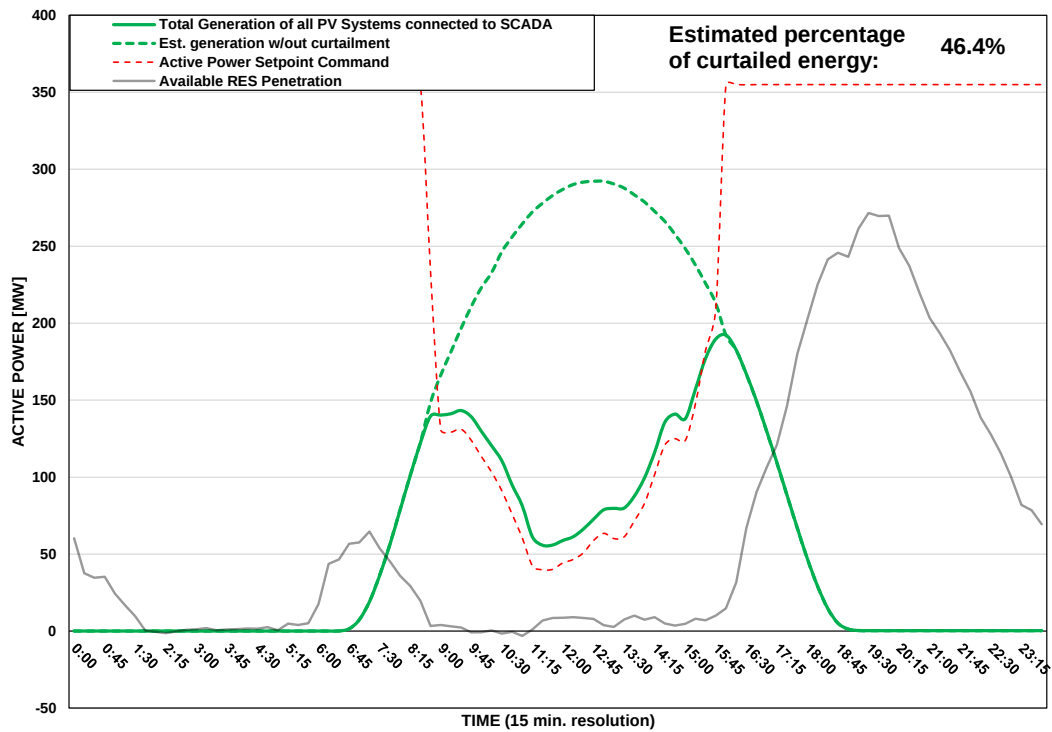

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	12/09/2025
Start of Curtailment	9:00
End of Curtailment	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2170.8 MWh
Total Estimated Curtailed Energy:	876.3 MWh
Percentage of Curtailed Energy:	40.4%

Scada PVs Generation on 12/09/2025 (curtailment time: 09:00 - 15:15)

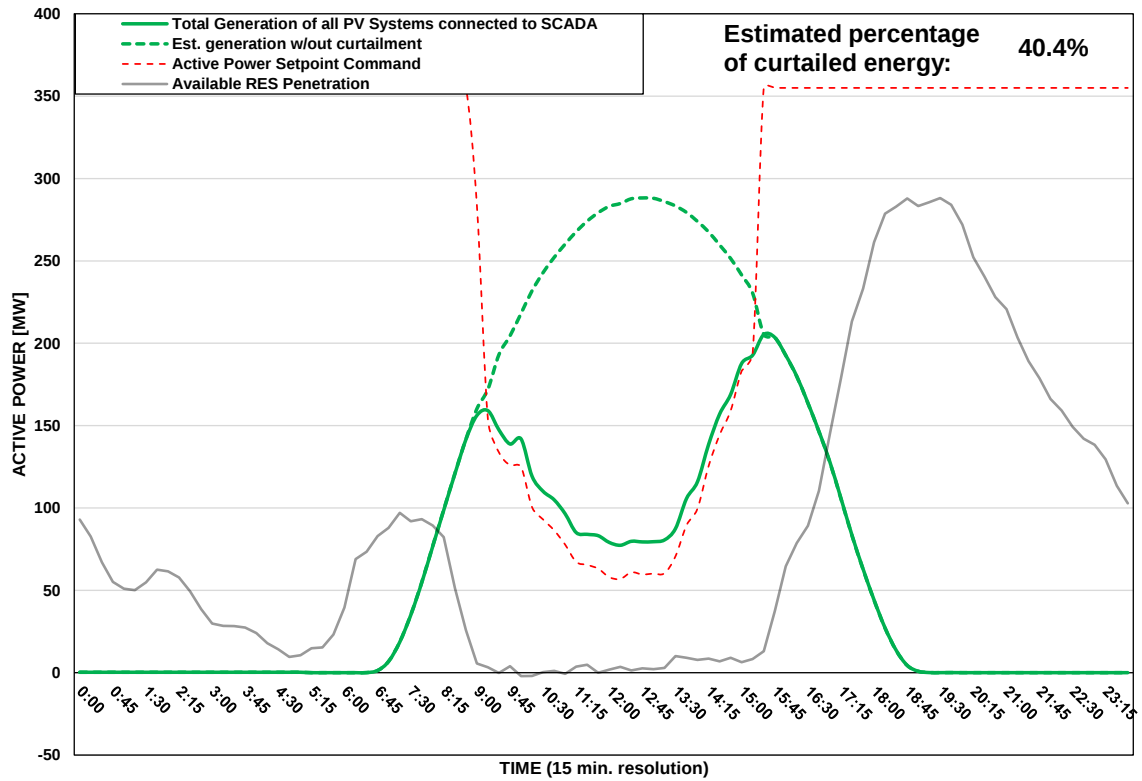


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	13/09/2025
Start of Curtailment	9:00
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2142.1 MWh
Total Estimated Curtailed Energy:	844.5 MWh
Percentage of Curtailed Energy:	39.4%

Scada PVs Generation on 13/09/2025 (curtailment time: 09:00 - 15:30)

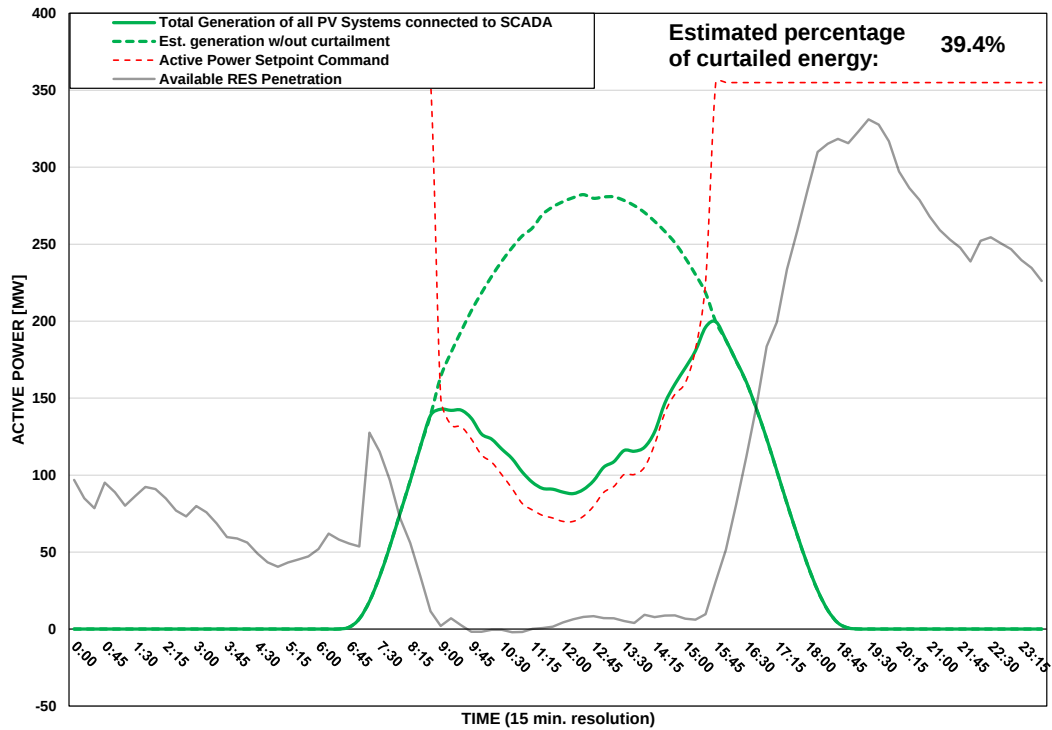

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	14/09/2025
Start of Curtailment	8:45
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2088.6 MWh
Total Estimated Curtailed Energy:	1043.5 MWh
Percentage of Curtailed Energy:	50.0%

Scada PVs Generation on 14/09/2025 (curtailment time: 08:45 - 15:45)

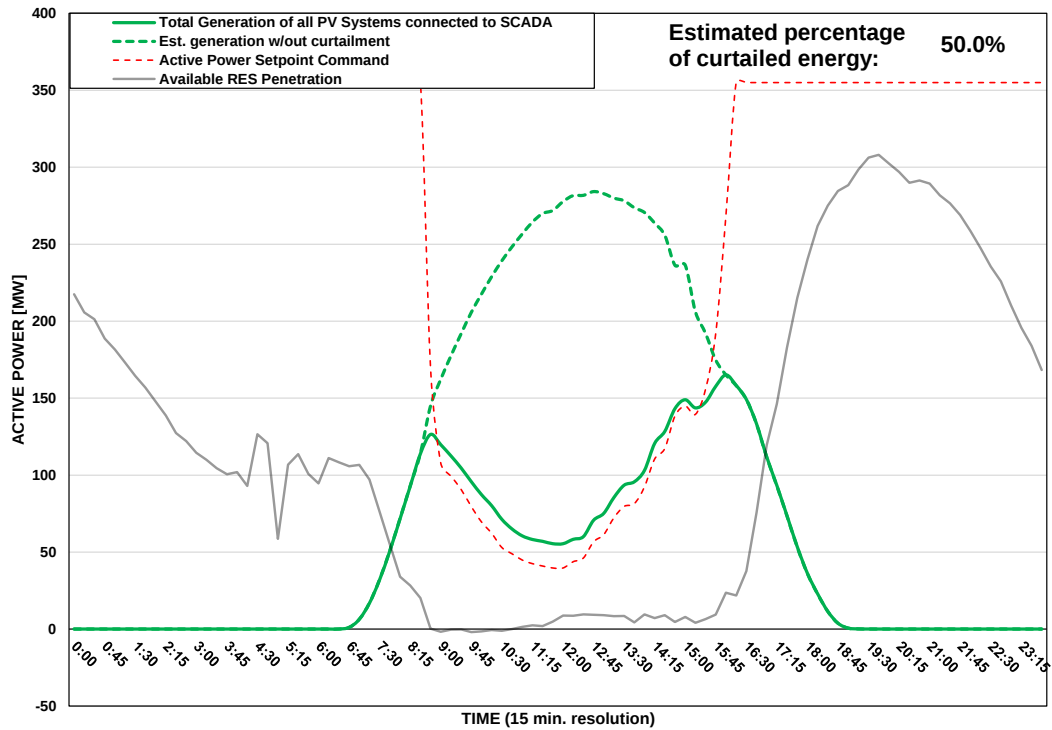


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	15/09/2025
Start of Curtailment	9:45
End of Curtailment	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2130.6 MWh
Total Estimated Curtailed Energy:	501.8 MWh
Percentage of Curtailed Energy:	23.6%

Scada PVs Generation on 15/09/2025 (curtailment time: 09:45 - 14:45)

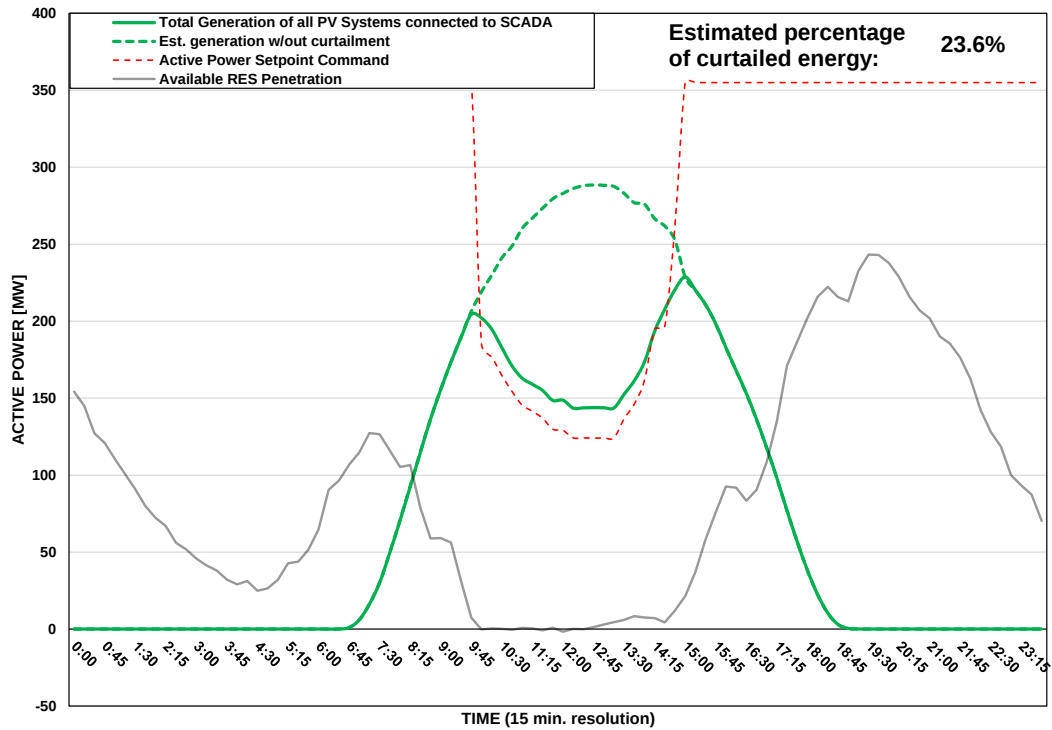

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	16/09/2025
Start of Curtailment	9:15
End of Curtailment	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2074.5 MWh
Total Estimated Curtailed Energy:	522.7 MWh
Percentage of Curtailed Energy:	25.2%

Scada PVs Generation on 16/09/2025 (curtailment time: 09:15 - 14:30)

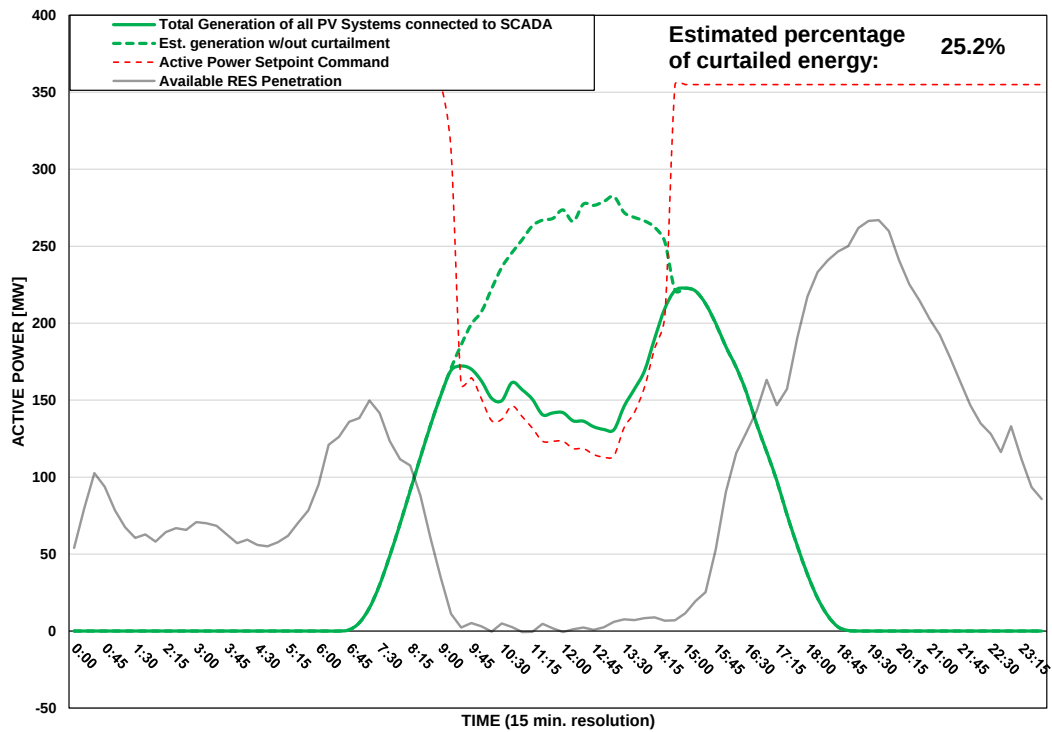

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	17/09/2025
Start of Curtailment	9:45
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2067.6 MWh
Total Estimated Curtailed Energy:	441.6 MWh
Percentage of Curtailed Energy:	21.4%

Scada PVs Generation on 17/09/2025 (curtailment time: 09:45 - 14:15)

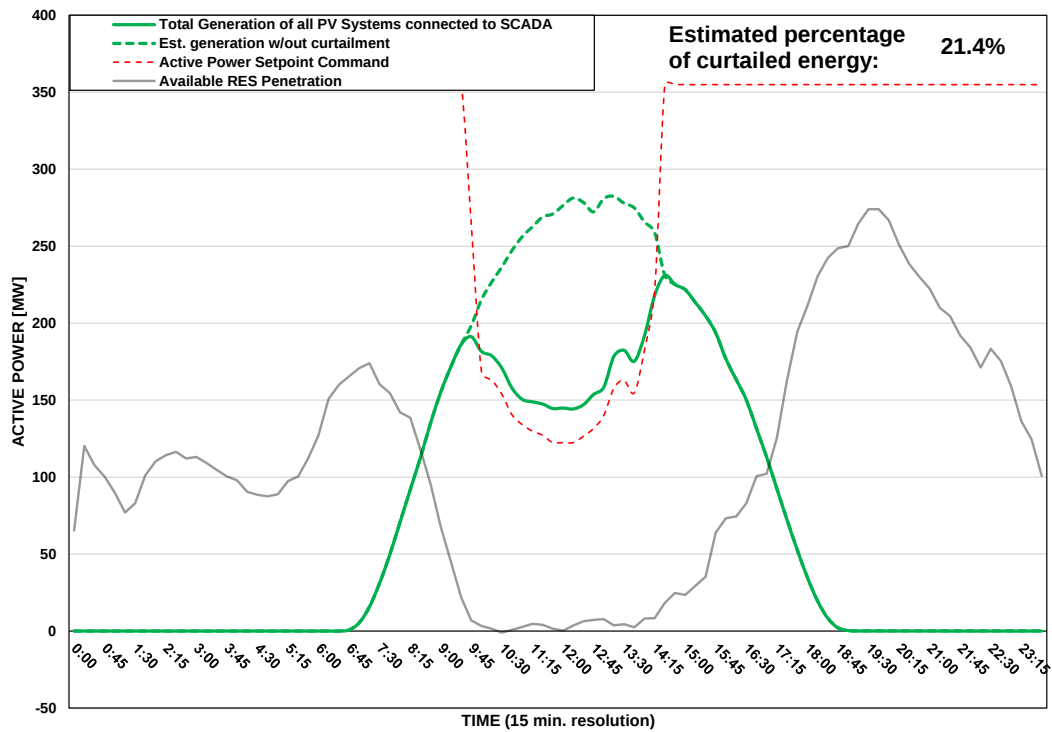


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	18/09/2025
Start of Curtailment	10:15
End of Curtailment	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2099.6 MWh
Total Estimated Curtailed Energy:	411.7 MWh
Percentage of Curtailed Energy:	19.6%

Scada PVs Generation on 18/09/2025 (curtailment time: 10:15 - 14:15)

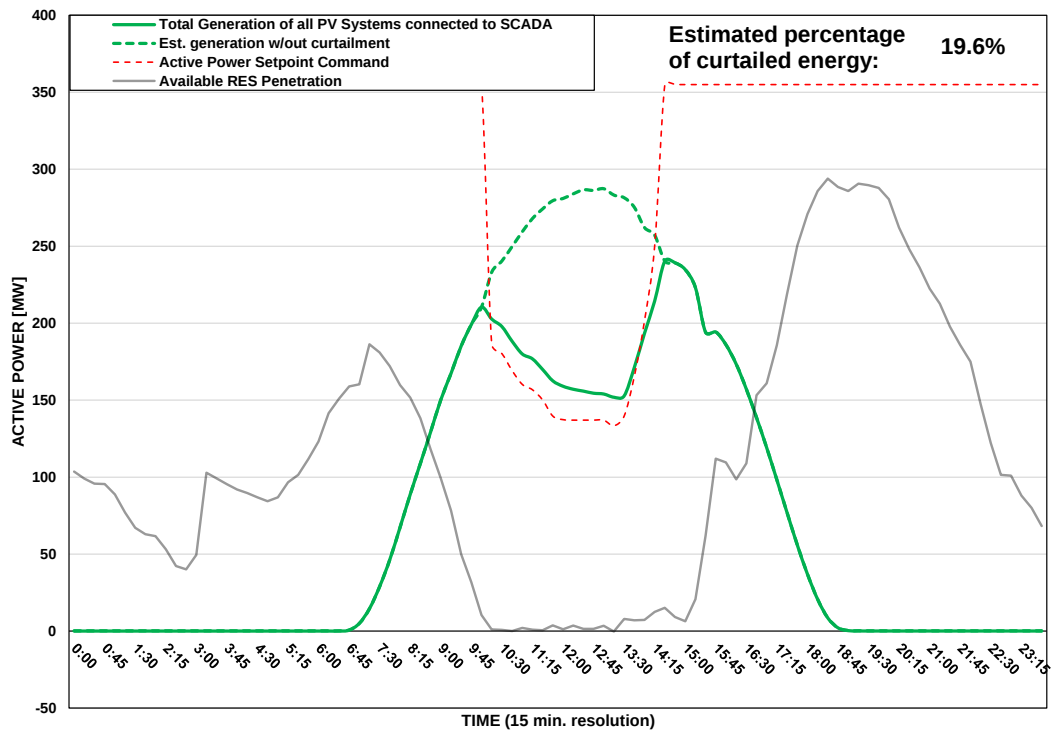


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/09/2025
Start of Curtailment	9:15
End of Curtailment	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2059.2 MWh
Total Estimated Curtailed Energy:	1028.4 MWh
Percentage of Curtailed Energy:	49.9%

Scada PVs Generation on 19/09/2025 (curtailment time: 09:15 - 15:45)

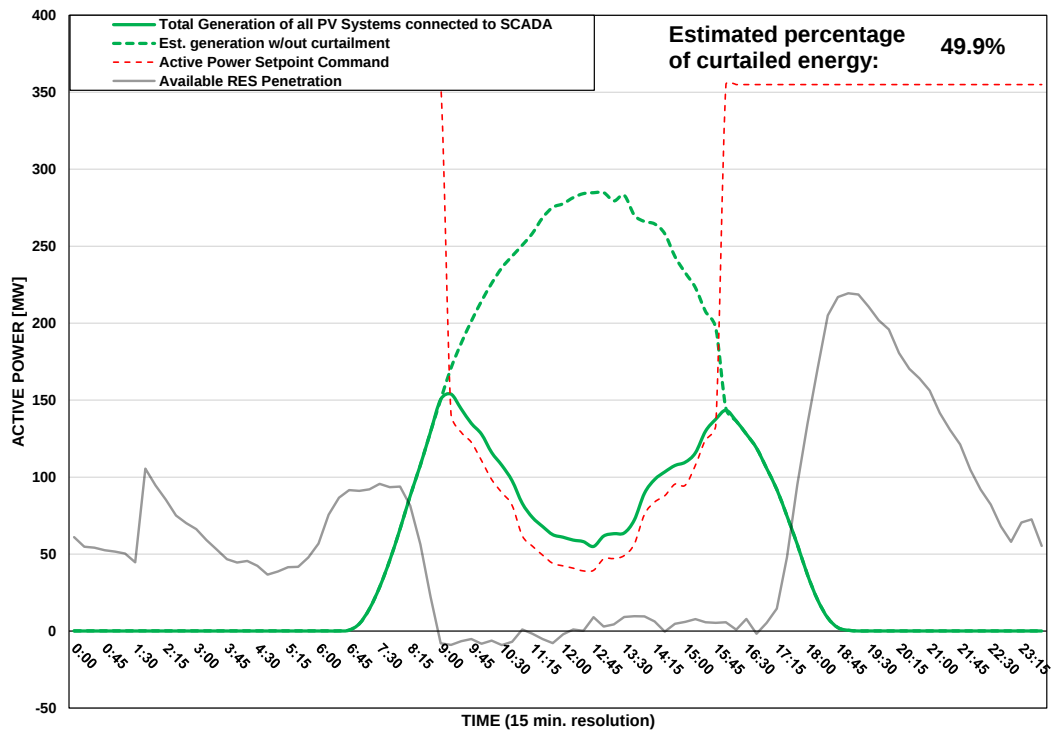


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	20/09/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:15	Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-LIM3, PV-PAF1
End of Curtailment	17:00	
Instruction from TSOC	YES	Start of cut-off: 10:45 End of cut-off: 15:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2119.5 MWh	
Total Estimated Curtailed Energy:	1516.1 MWh	Total Est. Energy of the cut-off PV systems using IoT: 101.9MWh
Percentage of Curtailed Energy:	71.5%	

Scada PVs Generation on 20/09/2025 (curtailment time: 08:15 - 17:00)

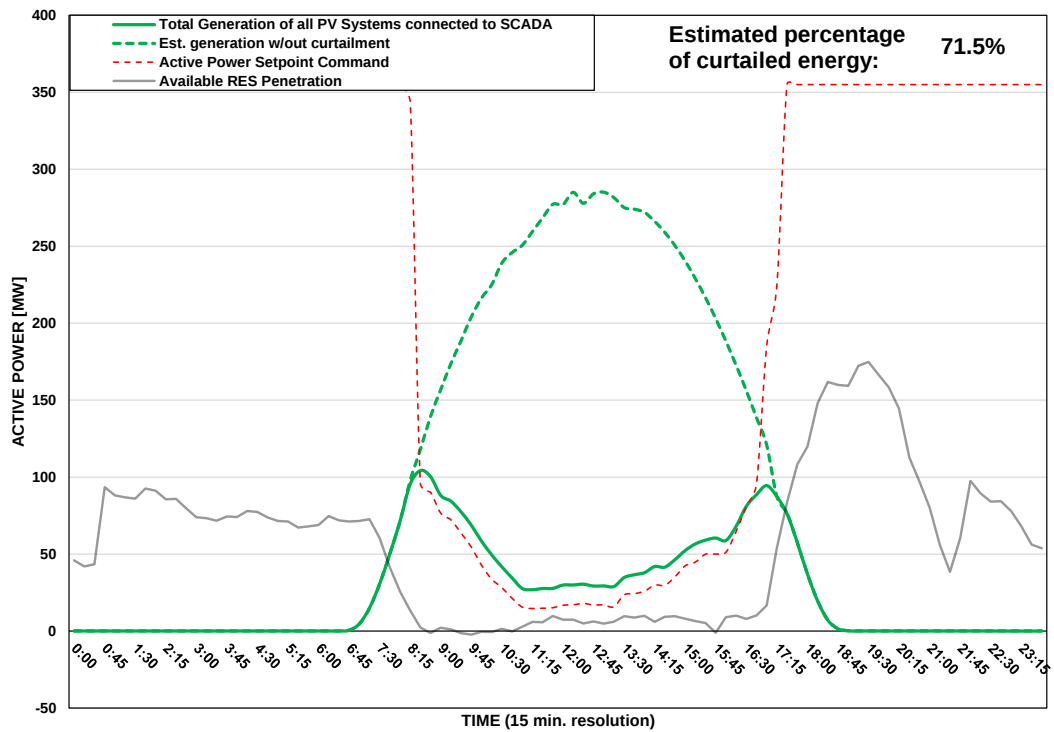


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	21/09/2025	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment	8:00	Cut-off areas using RIPPLE: NIC 1, LAR 2, PAF 2
End of Curtailment	17:00	Cut-off areas using IoT: PV-LCA/FAM1, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV-PAF3
Instruction from TSOC	YES	Start of cut-off: 09:30 End of cut-off: 16:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2106.5 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 228.7MWh
Total Estimated Curtailed Energy:	1573.7 MWh	Total Est. Energy of the cut-off PV systems using IoT: 216.7MWh
Percentage of Curtailed Energy:	74.7%	

Scada PVs Generation on 21/09/2025 (curtailment time: 08:00 - 17:00)

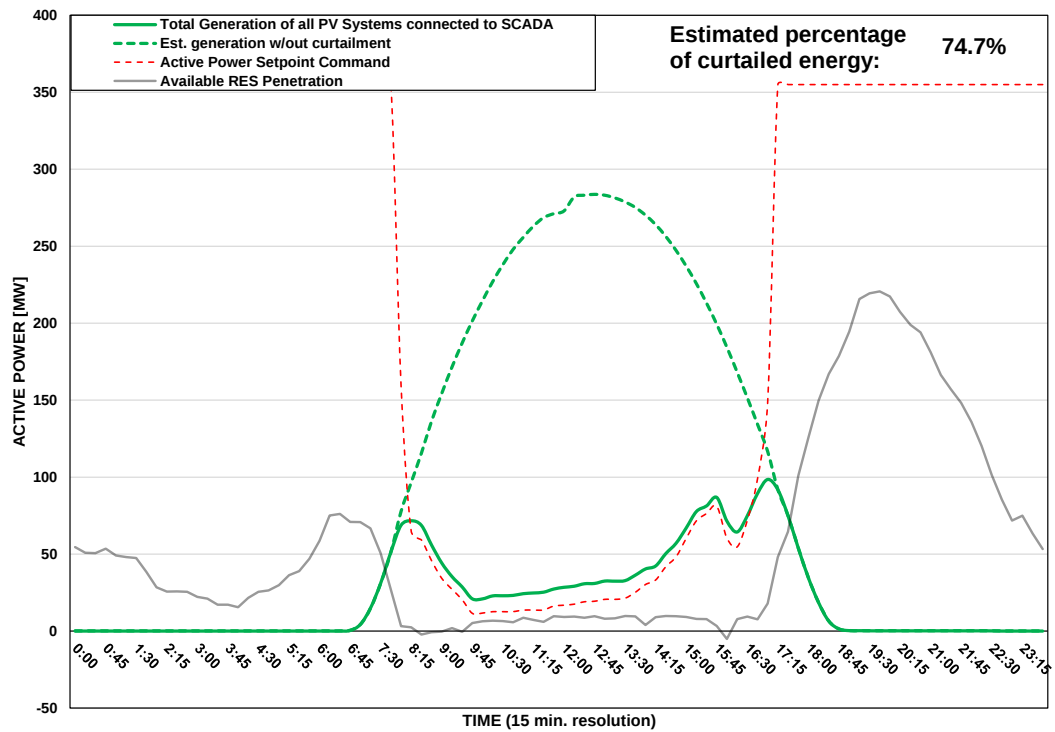


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	22/09/2025
Start of Curtailment	9:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2098.4 MWh
Total Estimated Curtailed Energy:	753.3 MWh
Percentage of Curtailed Energy:	35.9%

Scada PVs Generation on 22/09/2025 (curtailment time: 09:30 - 16:15)

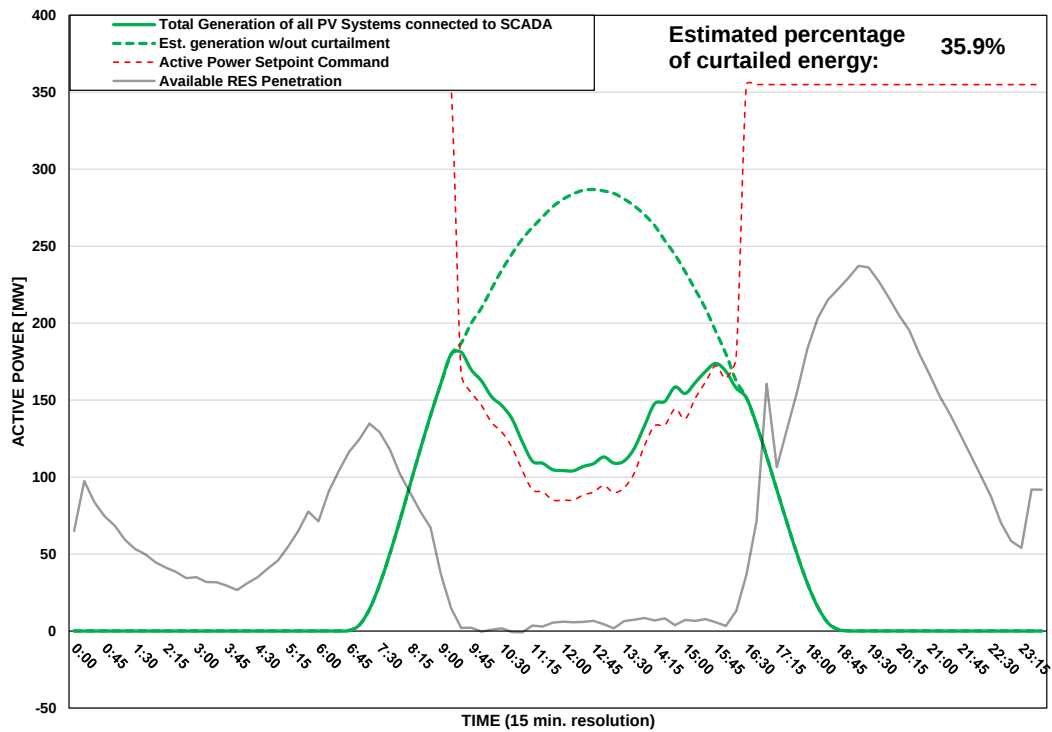

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	23/09/2025
Start of Curtailment	9:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2107.8 MWh
Total Estimated Curtailed Energy:	546.6 MWh
Percentage of Curtailed Energy:	25.9%

Scada PVs Generation on 23/09/2025 (curtailment time: 09:45 - 15:30)

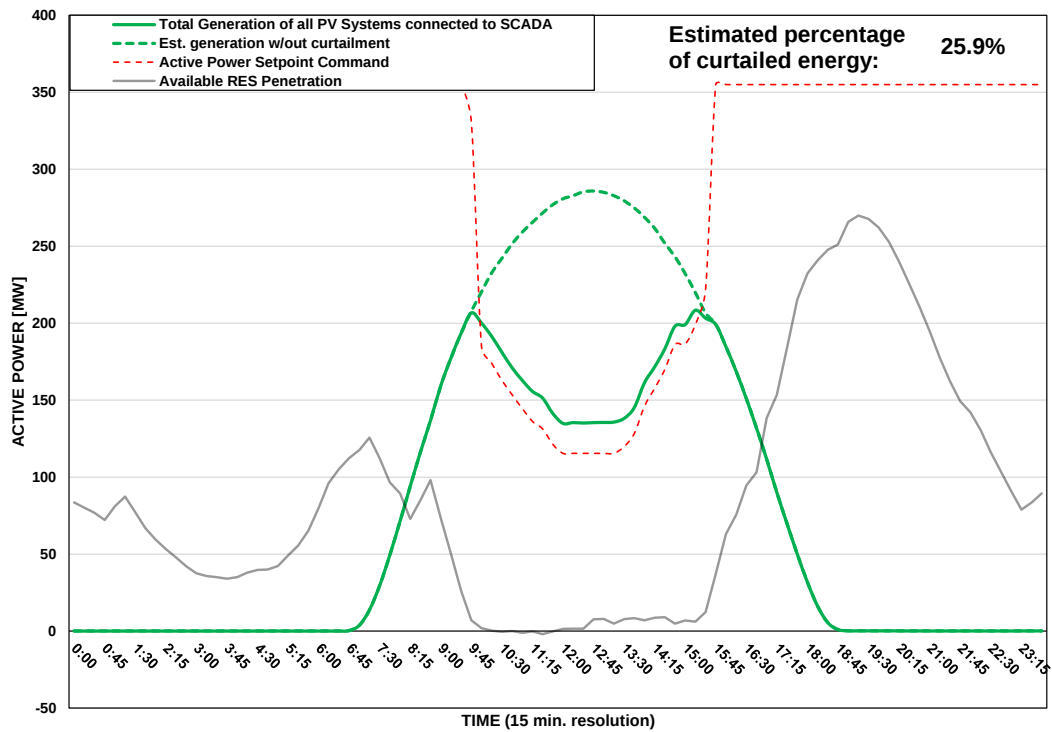

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	24/09/2025
Start of Curtailment	9:45
End of Curtailment	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2058.9 MWh
Total Estimated Curtailed Energy:	452 MWh
Percentage of Curtailed Energy:	22.0%

Scada PVs Generation on 24/09/2025 (curtailment time: 09:45 - 15:30)

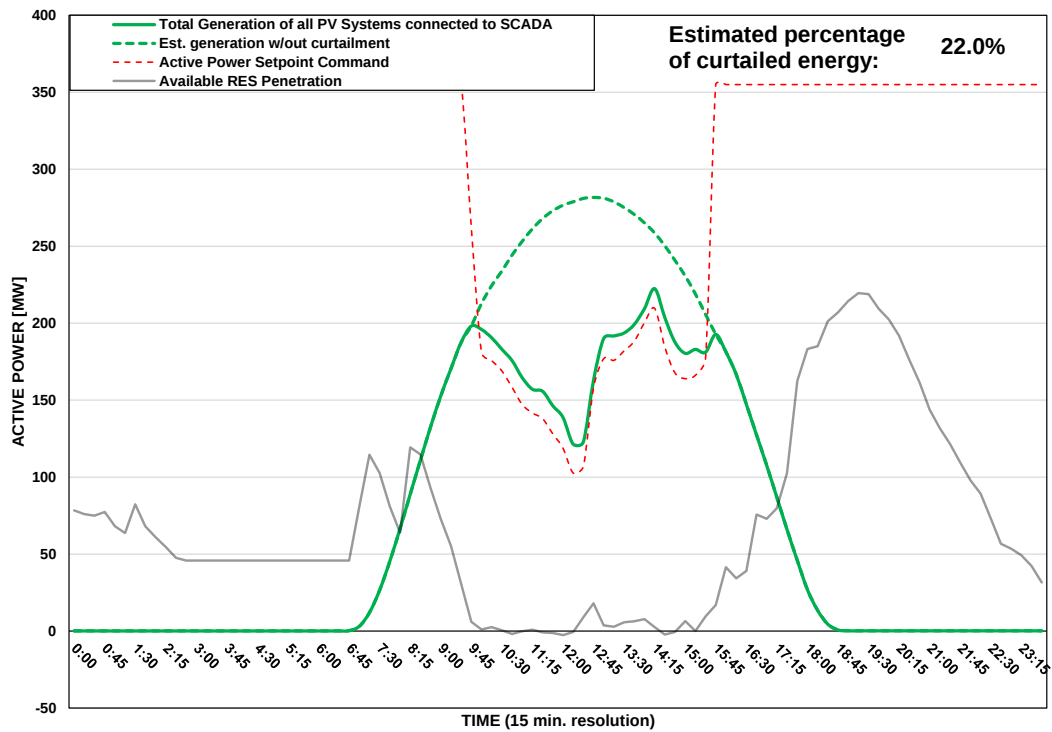

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	25/09/2025
Start of Curtailment	10:00
End of Curtailment	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1981.7 MWh
Total Estimated Curtailed Energy:	601.3 MWh
Percentage of Curtailed Energy:	30.3%

Scada PVs Generation on 25/09/2025 (curtailment time: 10:00 - 16:00)

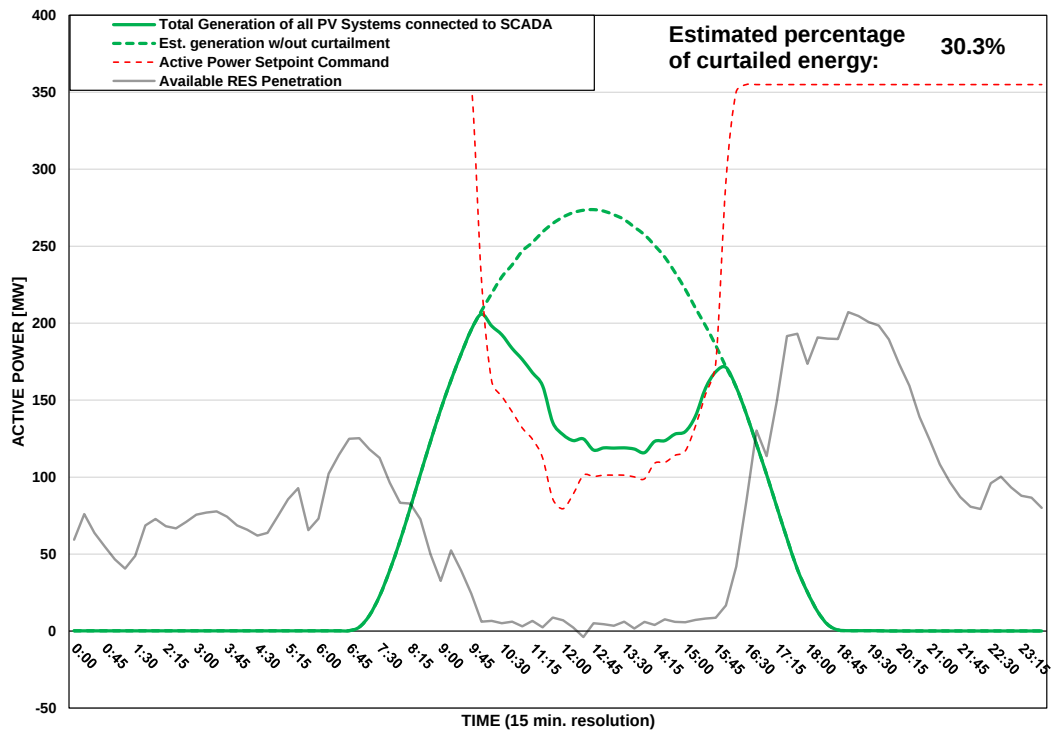

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	26/09/2025
Start of Curtailment	9:30
End of Curtailment	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1965.2 MWh
Total Estimated Curtailed Energy:	600 MWh
Percentage of Curtailed Energy:	30.5%

Scada PVs Generation on 26/09/2025 (curtailment time: 09:30 - 15:00)

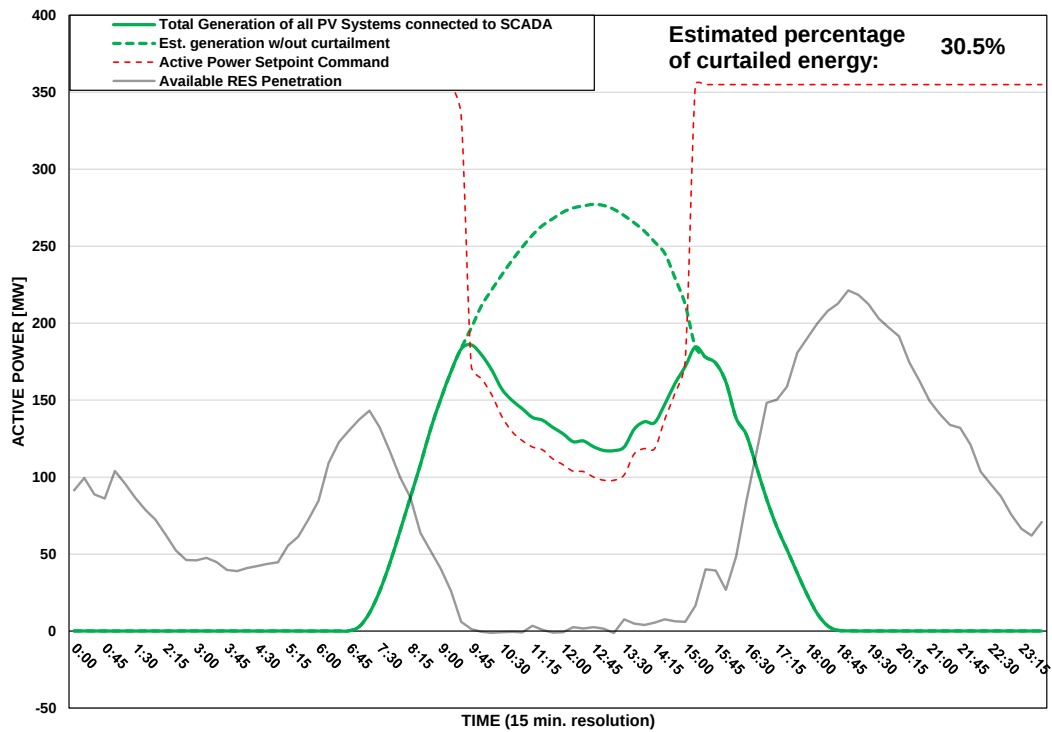

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	27/09/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	8:45	Cut-off areas using IoT: PV-NIC4
End of Curtailment	15:45	
Instruction from TSOC	YES	Start of cut-off: 11:15 End of cut-off: 13:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	1989.2 MWh	
Total Estimated Curtailed Energy:	1145.6 MWh	Total Est. Energy of the cut-off PV systems using IoT: 8.7MWh
Percentage of Curtailed Energy:	57.6%	

Scada PVs Generation on 27/09/2025 (curtailment time: 08:45 - 15:45)

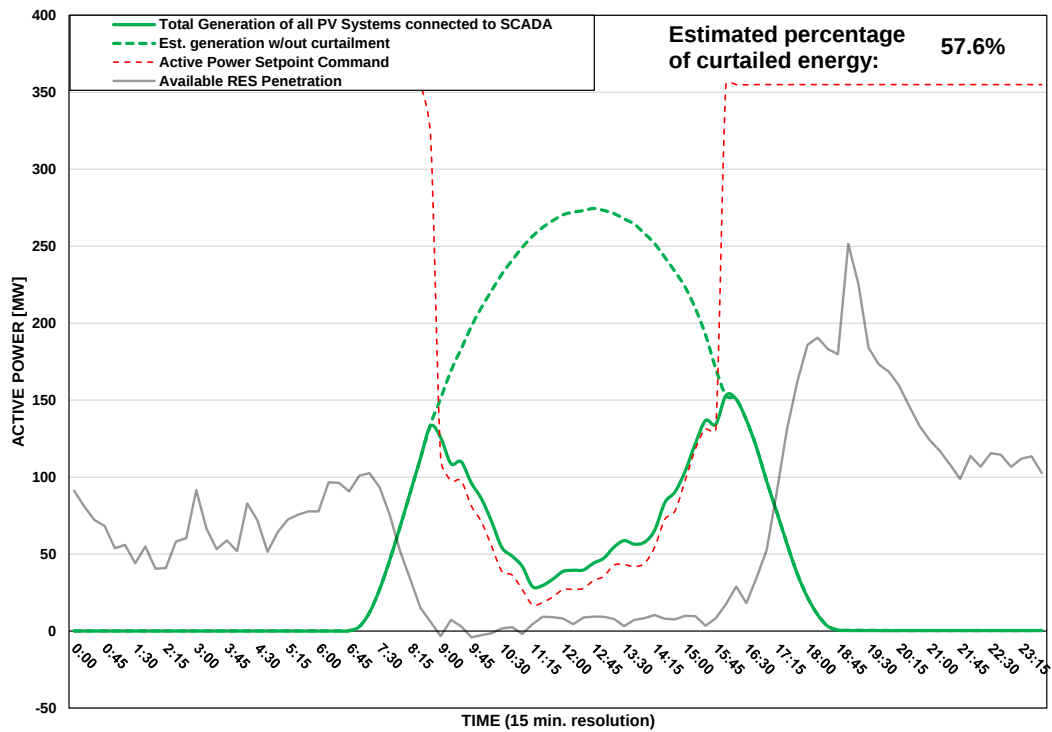


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	28/09/2025	Cut-off of PV Systems using RIPPLE:
Start of Curtailment	8:30	Cut-off areas using RIPPLE: LIM 2
End of Curtailment	16:45	
Instruction from TSOC	YES	Start of cut-off: 11:30 End of cut-off: 13:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	1981.6 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 34.9MWh
Total Estimated Curtailed Energy:	1325.7 MWh	
Percentage of Curtailed Energy:	66.9%	

Scada PVs Generation on 28/09/2025 (curtailment time: 08:30 - 16:45)

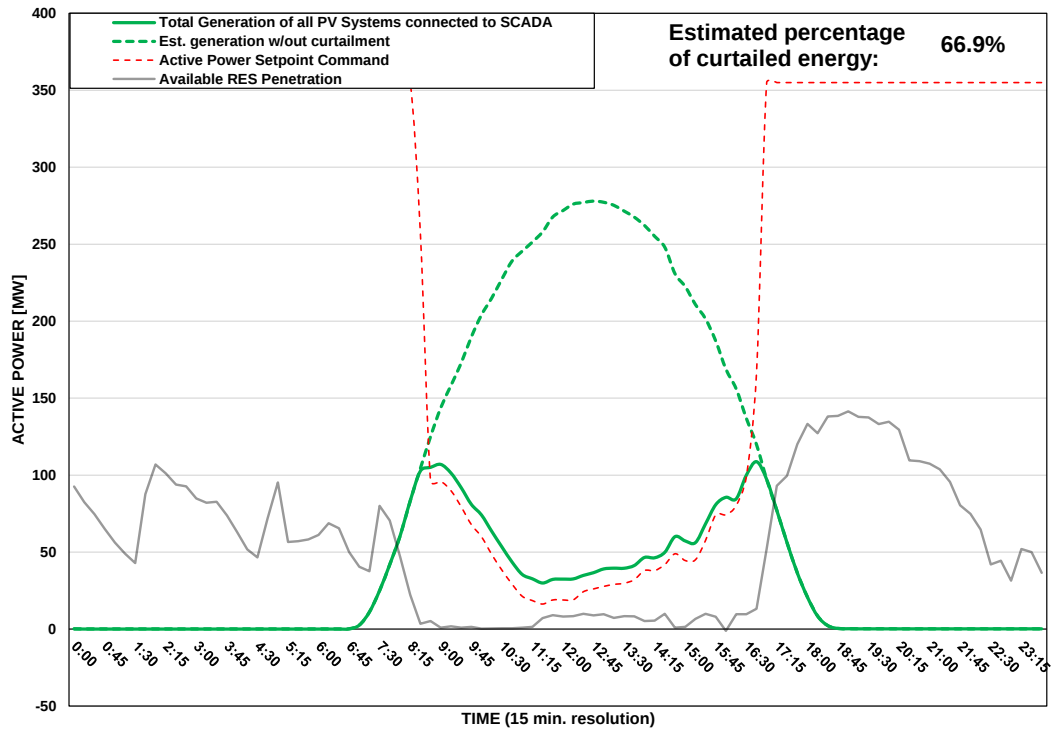


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	29/09/2025
Start of Curtailment	9:30
End of Curtailment	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1997.8 MWh
Total Estimated Curtailed Energy:	902.8 MWh
Percentage of Curtailed Energy:	45.2%

Scada PVs Generation on 29/09/2025 (curtailment time: 09:30 - 16:15)

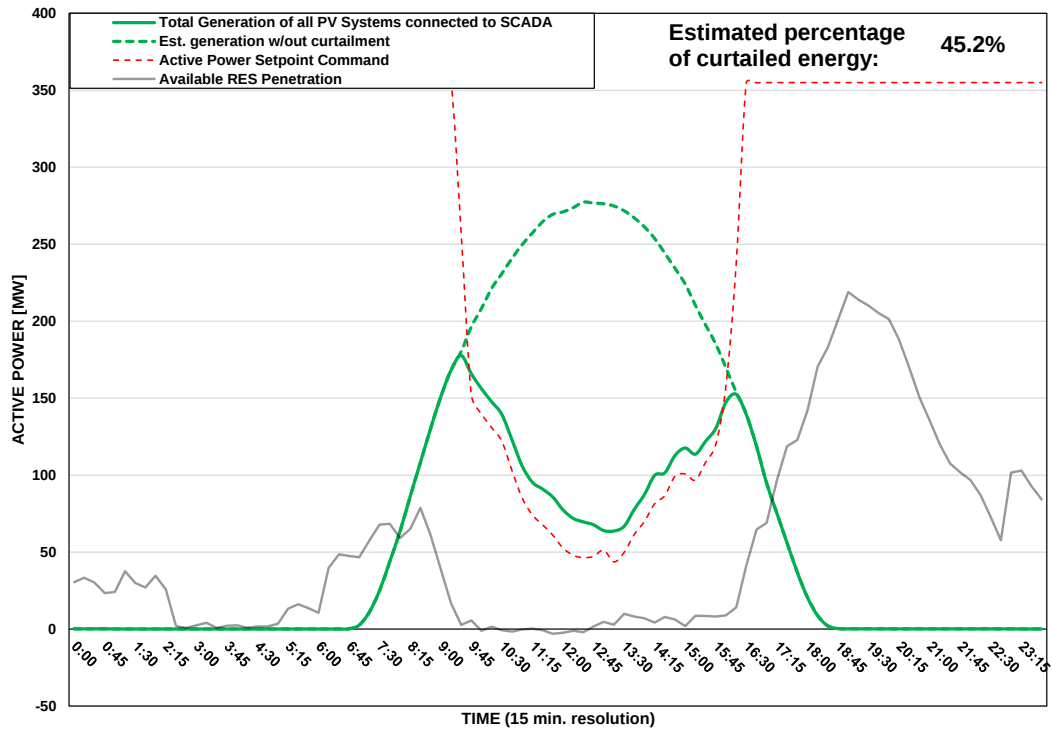

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	30/09/2025	Cut-off of PV Systems using IoT:
Start of Curtailment	9:30	Cut-off areas using IoT: PV-ARTICLE 22
End of Curtailment	16:45	
Instruction from TSOC	YES	Start of cut-off: 12:00 End of cut-off: 17:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	1938.4 MWh	
Total Estimated Curtailed Energy:	1082.8 MWh	Total Est. Energy of the cut-off PV systems using IoT: 13.7MWh
Percentage of Curtailed Energy:	55.9%	

Scada PVs Generation on 30/09/2025 (curtailment time: 09:30 - 16:45)

